


SIEMENS

Ingenuity for life

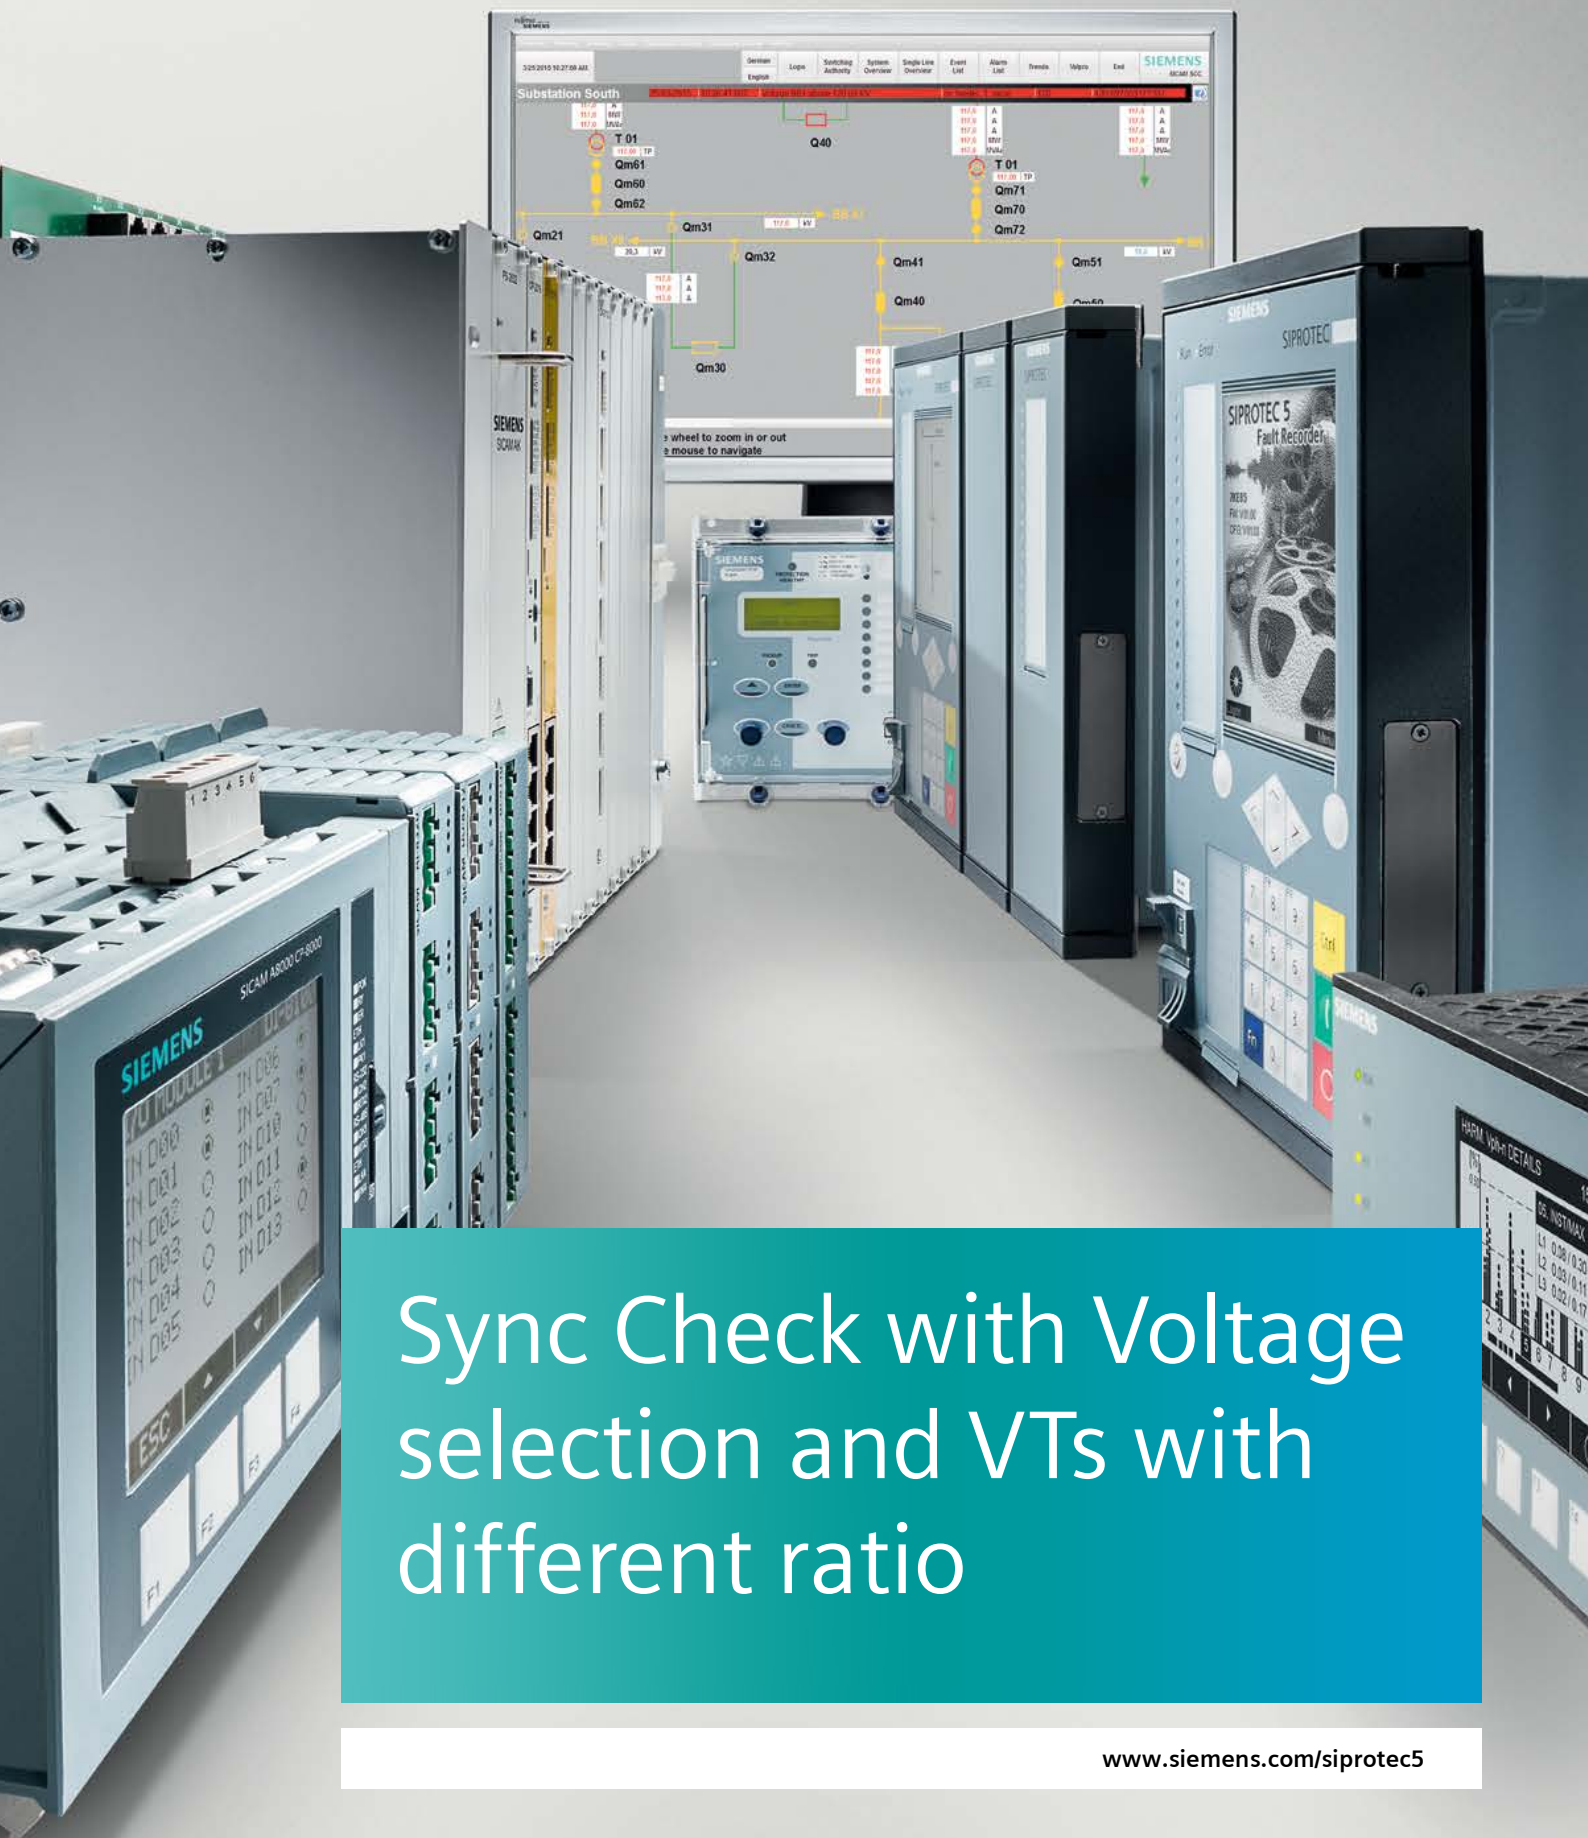

Sync Check with Voltage selection and VTs with different ratio

SIPROTEC 5 Application

Sync Check with Voltage selection and VTs with different ratio

SIPROTEC 5 Application

Sync Check with Voltage selection and VTs with different ratio

APN-026, Edition 1

Content

1	Sync Check with Voltage selection and VTs with different ratio	3
1.1	Introduction	3
1.2	Application	4
1.3	DIGSI Settings	5
1.4	Tests	6

1 Sync Check with Voltage selection and VTs with different ratio


1.1 Introduction

The effective protection of an electrical system depends not only on the protection device itself but also on the appropriated power supply, in terms of availability and reliability. Nevertheless, some simple applications in industrial and commercial facilities as well as in rural areas, cannot bear the associated cost to a continuous voltage DC system, such rectifier and battery bank for the protection device and circuit breaker. Moreover in some specific applications, as those in the renewable distributed generation field, there is neither AC power supply nor DC power supply at the facility.

This application note describes the possibilities to overcome the limitations on power supply granting higher reliability with either no additional investment or at a marginal cost.

The VT ratio of all VTs "connected" to either V_{syn1} or V_{syn2} must be the identical. If different VT values are set DIGSI will show an inconsistency and the configuration cannot be loaded into the device. (The VT at V_{sync1} may be different from the VT at V_{sync2})

In this description a "work around" is shown for the case when different VT ratios are applied. The selection logic is covered in the separate application note SIP5-APN-004.

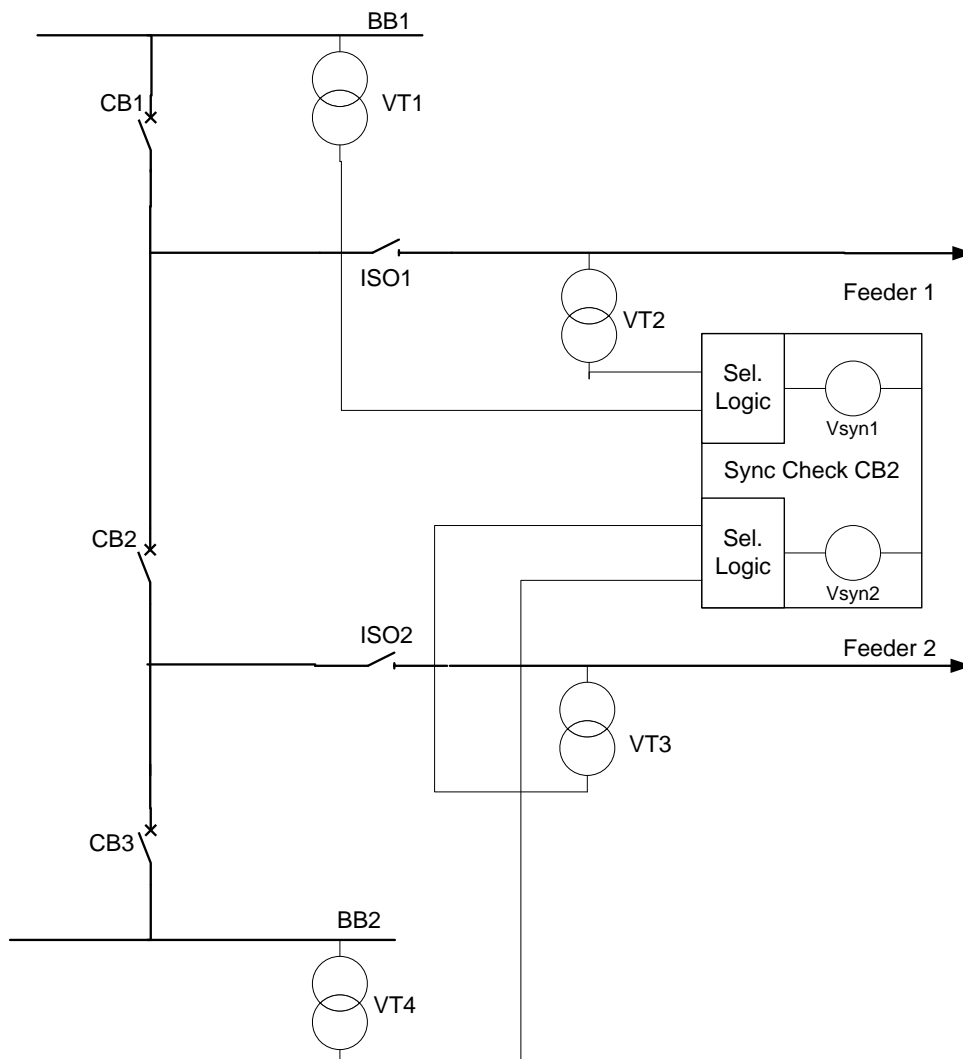

SIPROTEC 5 Applikation

Sync Check with Voltage selection and VTs with different ratio

Figure 1: Single line showing VTs for sync check.

VT ratios for the example shown in Figure 1:

VT	Connection	Ratio
VT1	Vsyn1	230 kV / 110 V
VT2	Vsyn1	220 kV / 110 V
VT3	Vsyn2	220 kV / 110 V
VT4	Vsyn2	220 kV / 110 V

Table 1: VT ratio from plant data

This presents two problems:

1. The primary rated voltage of VT3 and VT4 are not the same as VT1 which is used as reference in this example. Under this condition the sync check expects a power transformer with corresponding ratio between these measuring points. The primary rated voltage must be set the same by applying the work around covered by Note 1 below.
2. The ratio of VT1 and VT2 are not the same although they are both assigned to Vsync1. This is not permitted. The ratios must be set the same by applying the work around covered by Note 2 below.

1.2 Application

For the Sync Check in this example there are two requirements for the VT ratio:

1. The primary voltage must be the same for all VT used for sync check. If the primary voltage is different the sync check considers a transformer with corresponding ratio difference between the measuring points.
2. The primary and secondary voltage of VTs connected to one side (either Vsyn1 or Vsyn2) must be identical.

To illustrate the two methods that can be adopted when the VTs do not comply with the two requirements above the VT settings will be applied as follows (VT1 is chosen as reference):

VT parameters			Settings applied		
VT	Connection	Ratio	Set Rated primary voltage	Set Rated secondary voltage	Set Magnitude correction
VT1	Vsyn1	230 kV / 110 V	230 kV	110 V	1
VT2	Vsyn1	220 kV / 110 V	230 kV	110 V	0.956 (note 2)
VT3	Vsyn2	220 kV / 110 V	230 kV	115 V (note 1)	1
VT4	Vsyn2	220 kV / 110 V	230 kV	115 V (note 1)	1

Table 2: Derived VT ratio settings

Note 1 – Adapted VT is not on same side as reference CT:

Here the set VT primary rated voltage must be adapted to be the same as that of the reference VT which is VT1 in this example. The set primary voltage now deviates from the actual VT rating. The secondary rated voltage must be adapted so that the ratio remains correct:

$$\text{Set Rated secondary voltage} = \frac{\text{Set rated primary voltage}}{\text{VT primary voltage}} \cdot \text{Vt secondary voltage}$$

$$\text{Set Rated secondary voltage} = \frac{230\text{kV}}{220\text{kV}} \cdot 110\text{V}$$

$$\text{Set Rated secondary voltage} = 115\text{V}$$

Note 2 – Adapted VT is connected to the same side as reference VT:

Here the set VT primary and/or secondary rated voltage must be adapted to be the same as that of the reference VT. The set ratio now deviates from the real ratio. This ratio deviation is compensated with the Magnitude Correction setting:

$$\text{Set Magnitude correction} = \frac{\text{Set rated secondary voltage}}{\text{Set rated primary voltage}} \cdot \frac{\text{VT primary voltage}}{\text{VT secondary voltage}}$$

$$\text{Set Magnitude correction} = \frac{220\text{kV}}{110\text{ V}} \cdot \frac{110\text{ V}}{230\text{ kV}}$$

$$\text{Set Magnitude correction} = 0.956$$

1.3 DIGSI Settings

For all VTs the settings calculated above and shown in Table2 must be applied with DIGSI as shown for VT2 in screen shot below.

The screenshot displays the configuration interface for VTs in the DIGSI software. It is divided into two main sections: 'VT 3-phase' and 'VT 1'.

VT 3-phase settings:

- 11.941.8911.101: Rated primary voltage: 230.00 kV
- 11.941.8911.102: Rated secondary voltage: 110 V
- 11.941.8911.103: Matching ratio Vph / VN: 1.73
- 11.941.8911.104: VT connection: 3 ph-to-gnd volt. + VN
- 11.941.8911.106: Inverted phases: none
- 11.941.8911.111: Tracking: active
- 11.941.8911.130: Measuring-point ID: 2

Buttons for 'Add new stage' and 'Delete stage' are located below the VT 3-phase list.

VT 1 settings:

- 11.941.3811.103: Magnitude correction: 0.956
- 11.941.3811.108: Phase: VA

Figure 2: Settings of VT ratio and Magnitude correction (shown are VT2 settings)

SIPROTEC 5 Applikation

Sync Check with Voltage selection and VTs with different ratio


1.4 Tests

During final commissioning the above VT ratio settings must be checked by monitoring the measurements in the device. Prior tests with secondary injection are recommended:

VT	Assumed Primary Voltage (Ph-Ph)	Injected secondary voltage (Ph-G)	Measured values	
			Primary (Ph-Ph)	Secondary (Ph-Ph)
VT1 230k/110	220 kV	60.75 V	220 kV	105.2 V
VT2 220k/110	220 kV	63.51 V	220 kV	105.2 V
VT3 220k/110	220 kV	63.51 V	220 kV	110 V
VT4 220k/110	220 kV	63.51 V	220 kV	110 V

Table 3: Test values for secondary injection

While injecting the secondary voltage, the measured values can be checked:

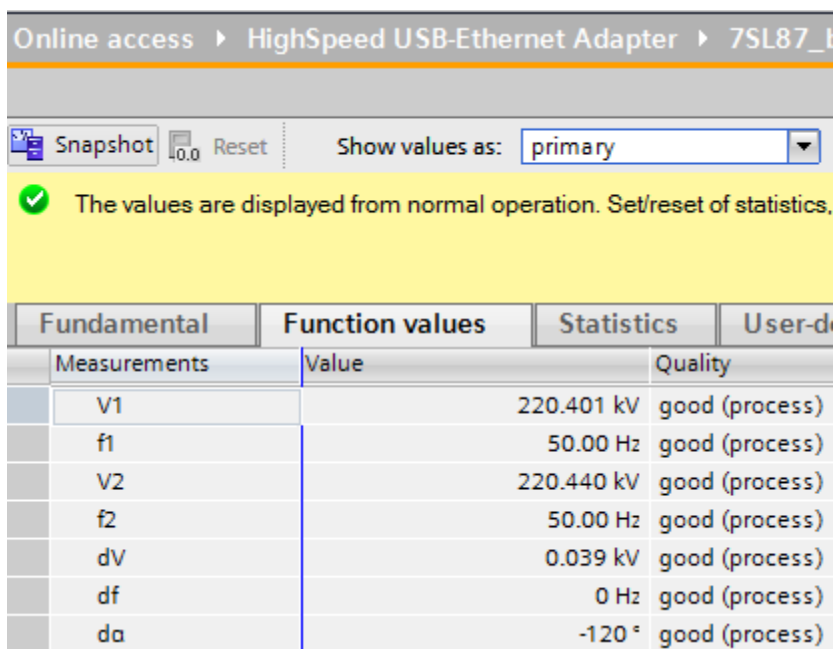

Fundamental	Function values	Statistics	User-d
Measurements	Value	Quality	
V1	220.401 kV	good (process)	
f1	50.00 Hz	good (process)	
V2	220.440 kV	good (process)	
f2	50.00 Hz	good (process)	
dV	0.039 kV	good (process)	
df	0 Hz	good (process)	
da	-120 °	good (process)	

Figure 3: Screen shot primary measured values (da= 120° is due to test condition, normally 0°)

As shown, the primary voltage is 220 kV at Vsyn1 (V1) and Vsyn2 (V2). This must be checked for all VTs by changing the selection with "V sync select."

The secondary voltage should also be checked to be sure that all settings are correct:

Fundamental		Function values	Statistics	User-d
Measurements	Value		Quality	
V1		105.409 V	good (process)	
f1		50.00 Hz	good (process)	
V2		110.227 V	good (process)	
f2		50.00 Hz	good (process)	
dV		0.026 V	good (process)	
df		0 Hz	good (process)	
da		-120 °	good (process)	

Figure 4: Screen shot secondary measured values (V1 measured with VT2) (da= 120° is due to test condition, normally 0°)

In the screen shot above, the VT connected to Vsyn1 (V1) is VT2. The measured secondary voltage is 105 V due to the magnitude correction. This can be calculated as follows:

$$\text{Measured secondary voltage (Ph - Ph)} = \text{Injected Voltage (Ph - G)} \cdot \sqrt{3} \cdot \text{Mag. Corr}$$

$$\text{Measured secondary voltage (Ph - Ph)} = 63.51 \cdot \sqrt{3} \cdot 0.956$$

$$\text{Measured secondary voltage (Ph - Ph)} = 102.5$$

Note that the delta voltage (dV) is always zero (with primary and secondary measured values) when the primary voltage is the same on both sides.

Published by
Siemens AG 2016
Energy Management Division
Digital Grid
Automation Products
Humboldtstr. 59
90459 Nuremberg, Germany

www.siemens.com/siprotec

For more information,
please contact our
Customer Support Center.

Tel.: +49 180 524 70 00

Fax: +49 180 524 24 71

(Charges depending on provider)

Email: support.energy@siemens.com

© 2016 Siemens. Subject to changes and errors.
The information given in this document only contains
general descriptions and/or performance features which
may not always specifically reflect those described, or
which may undergo modification in the course of further
development of the products. The requested performance
features are binding only when they are expressly agreed
upon in the concluded contract.

For all products using security features of OpenSSL, the
following shall apply:
This product includes software developed by the OpenSSL
Project for use in the OpenSSL Toolkit.
(<http://www.openssl.org/>)
This product includes cryptographic software written by
Eric Young (eay@cryptsoft.com)
This product includes software written by Tim Hudson
(tjh@cryptsoft.com)
This product includes software developed by Bodo Moeller.