


**IF IN DOUBT ASK  
DO NOT SCALE**

Relay Earthing

Terminal B28 of the PSU should be earthed by a direct connection to the device case earth stud.

The device case earth stud should be solidly earthed by a direct connection to the panel earth.


Terminal contacts internal to case assembly close when device is withdrawn from case.

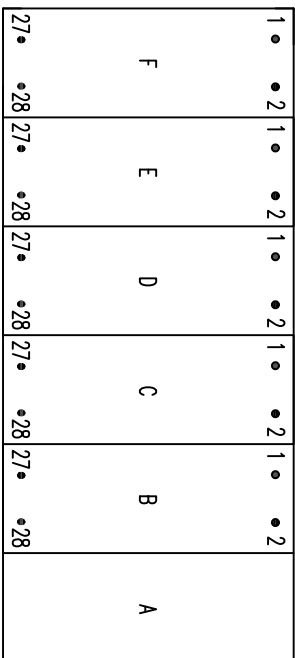

VIEWED FROM REAR

Notes – Ethernet Options

Device will be fitted with either 2 x electrical (RJ45) or 2 x optical (LC) ethernet ports.

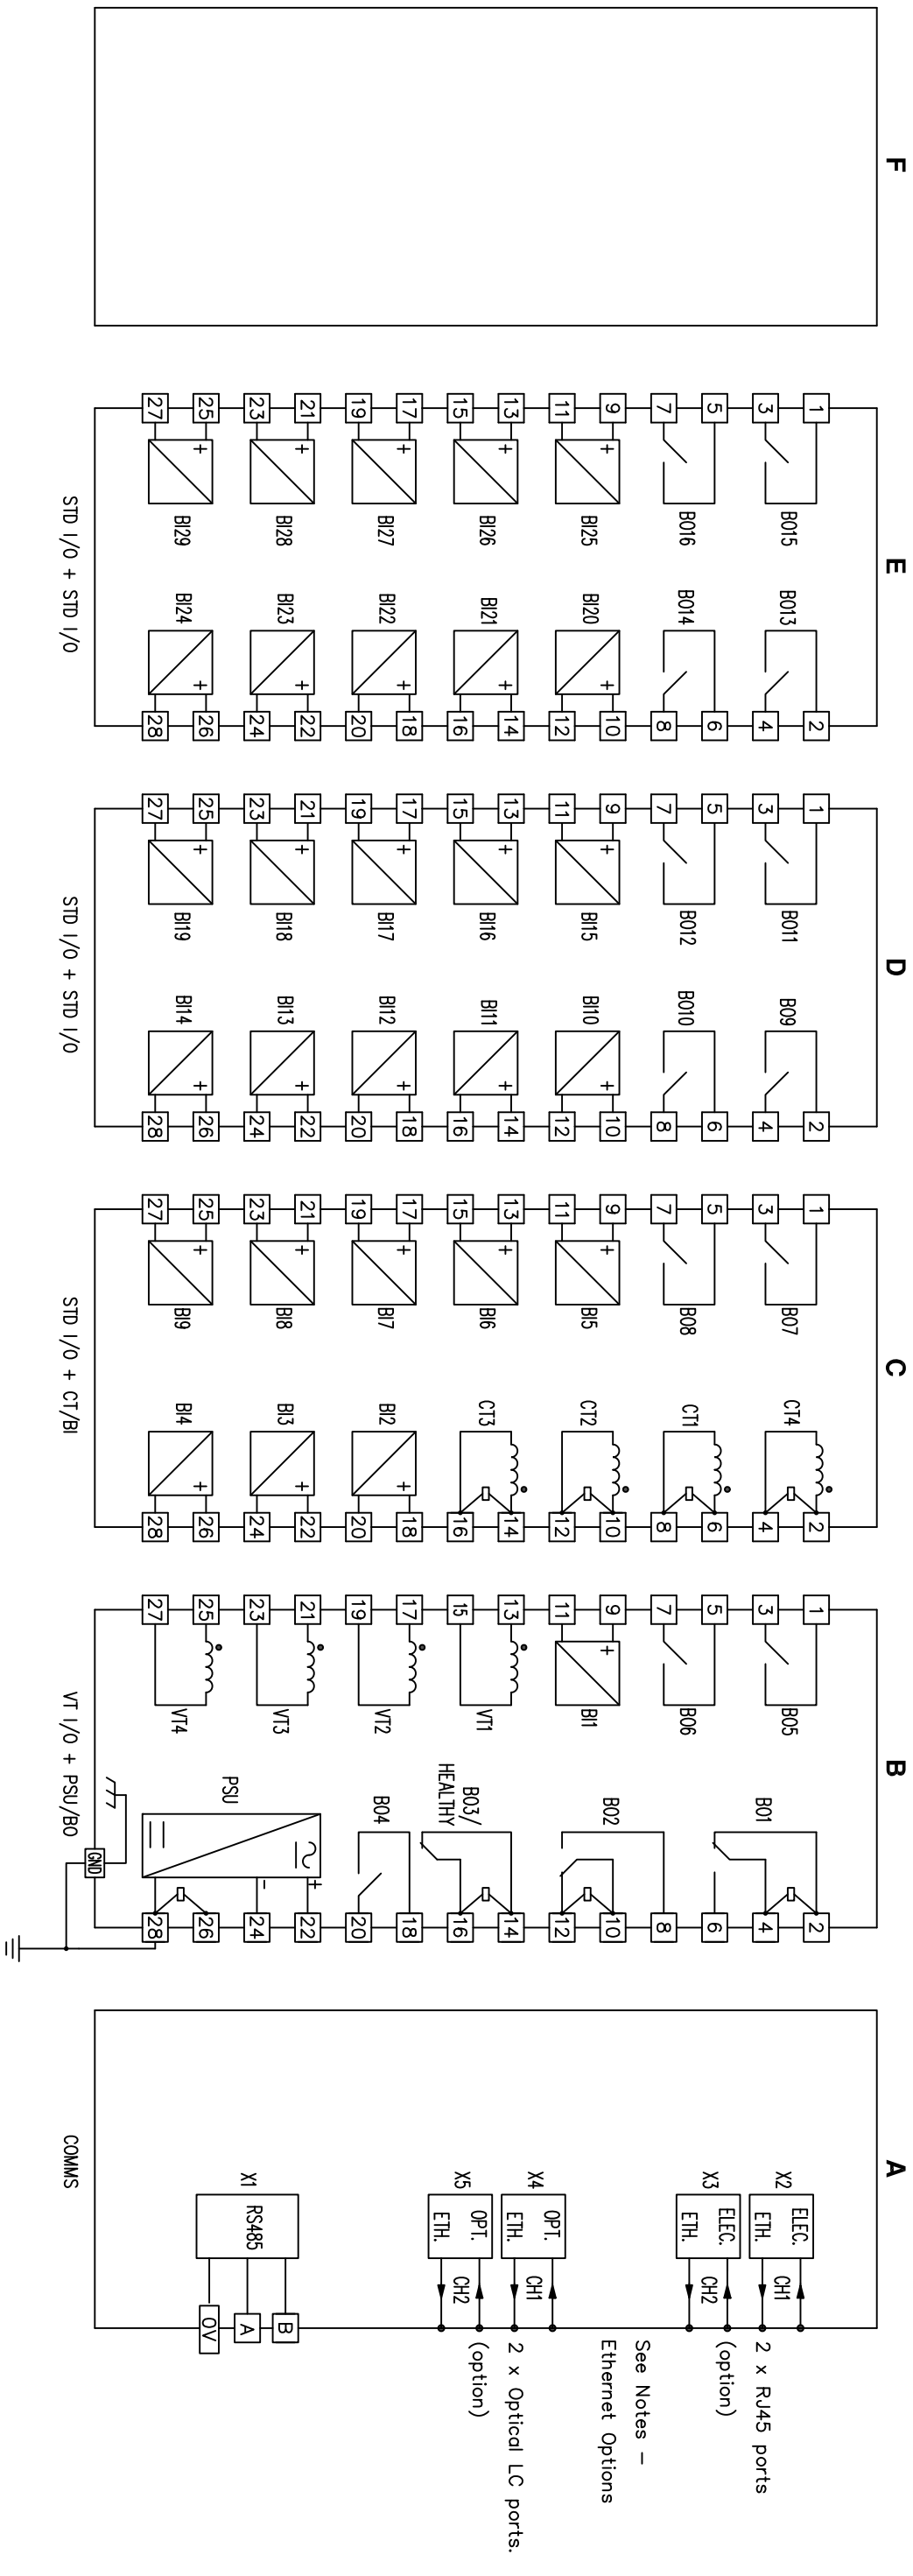

ABBREVIATIONS

CT	CURRENT TRANSFORMER
VT	VOLTAGE TRANSFORMER
BI	BINARY INPUT
BO	BINARY OUTPUT
GND	GROUND
ELEC	ELECTRICAL
OPT	OPTICAL
ETH	ETHERNET
STD I/O	STANDARD INPUT/OUTPUT
PSU	POWER SUPPLY UNIT (AUXILIARY)

**FOR INTERNAL USE ONLY  
UNCONTROLLED COPY  
NOT SUBJECT TO UPDATE**

**EU EXPORT CONTROLS**

**ECCN: N**

**AL: N**

This document is not Export Controlled unless sending to Critical Countries.

Finish:	–	Title:	REAR TERMINAL CONNECTIONS – 7SR5111–5AAx6–0AA0	Original Scale:	NTS	Dwg No.:	2518W50015
Treatment:	–		4CT, 4VT, 29BI, 16B0			Supersedes: –	
Drawn:	J SPOWART	Checked:	K.H	Approved:	N.CAMPBELL	Date:	27/08/19
SIEMENS PLC		Date:		27/08/19		Copyright © 2019	
A3		SIEMENS PLC, Hebburn		A3		SIEMENS PLC, Hebburn	

ISSUE	DATE	CHANGE
1	27/08/19	NOTED