THIRD ANGLE PROJ

DWG. NO. 11-B-2000-00 SHT 1 REV 3

AUTOCAD FILENAME:

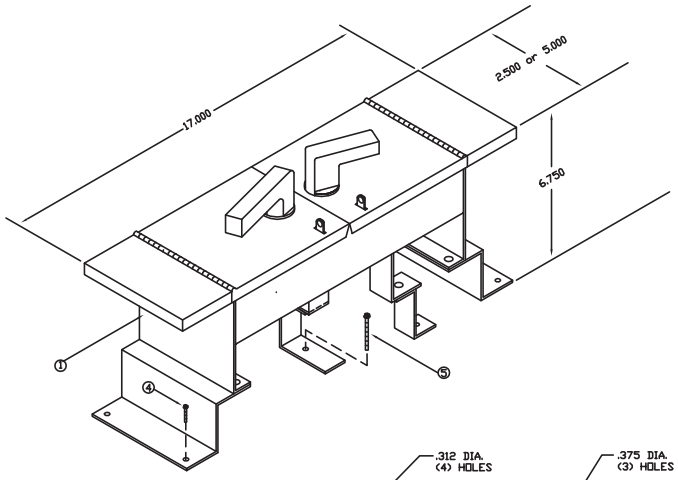

TORQUE VALUES:
50 IN. LBS. AL.
72 IN. LBS. CU.

FOR FUSIBLE CAT. NOS.	
2 1/2" UNITS	5" UNITS
V7A2211 V7A3211	V7B2211 V7B2212 V7B2222 V7B3211 V7B3212 V7B3222

⚠ DANGER
Hazardous voltage. Will cause death or serious injury.
Keep out.
Qualified personnel only.
Disconnect and lock off all power before working on this equipment.



2.5" UNIT

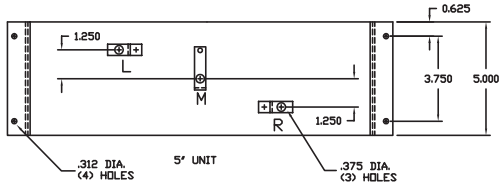

5" UNIT

REV	C.N.	DATE
1	1A-0642	2-10-89
0	1A-036	8-26-88

Revisions		
2	1A-280	11-30-90
3	1B-908	4-20-95

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES
TOLERANCES ARE NON-CUMULATIVE AND ARE AS FOLLOWS UNLESS SPECIFIED OTHERWISE.
.XX ± .030
.XXX ± .015
ANGULAR ± 2°
DO NOT SCALE DRAWING

DWN LP	DATE 3-18-88	
CHK JC	DATE 9-19-88	
APVD SH	DATE 9-19-88	

CONFIDENTIAL – PROPERTY OF
Siemens Industry, Inc.
Building Technologies Division

VACU-BREAK MOUNTING
▲F1 – BRANCH KIT
2.500" & 5.000" TWIN UNIT

DWG NO. 11-B-2000-00 REV. 3
SCALE NONE SHEET 1 OF 1

FOR USE WITH 2.5" & 5" HIGH TWIN UNITS MOUNTED IN SPP/FPP/S4/F1/P4 PANELBOARDS (SHALLOW BOX).

11-B-1001-01 Rev. 3

Apvd PM 11-30-90

Revisions:
1:1A-064 2-10-89
2:1A-280 11-30-90
3:1B-908 4-17-95
4:1C-831A 4-12-04
5:1C-831B 7-24-06
6:1E-053A 1-10-07

Chk SH 11-30-90

By MC 11-20-90

ITEM	DESCRIPTION	PC. NO.	QTY.
1	FUSIBLE SWITCH	SEE CAT. NO.	1
2			
3			
4	1/4-20 X 3/8 SHWHSW	11-1553-02	4
5	STRAP-BUS HARDWARE KIT	11-B-2022-05	1
6			
7	NEUTRAL LUG ASSEMBLY	12-B-2105-01	1
8	INSTRUCTION SHEET	11-B-1001-01	1
9	CARTON LABEL	15-A-1027-01	1
10	CARTON	48000989 ▲	1
11			
12			
	FOR (SHALLOW) PANELBOARDS		

VACU-BREAK CAT. NO.: 2.5" UNITS: V7A2211, V7A3211
5" UNITS: V7B2211, V7B2212, V7B2222, V7B3211, V7B3212, V7B3222

Confidential – property of
Siemens Industry, Inc.
Building Technologies Division

VACU-BREAK MOUNTING KIT
F1 TWIN MOUNT 2.5" & 5" UNITS, CAT. NO. F602
Title

11-B-2000-02
Dwg No.

Sht. 1 Of 1

6
Rev.

Siemens Industry, Inc.
Building Technologies Division
Norcross, GA

CAT. NO. F602