

SIEMENS

Item: TA1E6125 LUG KIT

Siemens Energy & Automation, Inc.
Bellefontaine, Ohio 43311 U.S.A.



For Use with: E, ED, EF & EM
FRAME CIRCUIT BREAKERS &
MOLDED CASE SWITCHES
(See Types Below)

© Siemens Energy & Automation, Inc. 2000

Pc. No. 64900A02

Installation Instructions



⚠ DANGER

Hazardous Voltage
Will cause death or serious injury.

Turn power off supplying device
before installing lug kit.



SAFETY INSTRUCTIONS

Breaker Types:	Usage
(H)E4-A, (H)E6-A(ETI), (H)ED4, HHED6	Line Side &
(H)ED6(ETI), CED6(ETI), EFC, EFF, EM6, EMK	Load Side

Note: The terminals have been tested per UL-486 B with standard stranded cable.

1. Turn power off supplying device before installing kit.
2. Adjust binding screw to 1/2 in. min. opening as shown Fig. 1.
3. Mount terminal assembly to load side of circuit breaker as shown in Fig. 2.
4. Adjust gap between load terminal and binding screw to accommodate size of wire used.
5. Tighten screw to clamp wire securely. See Chart Fig. 3.


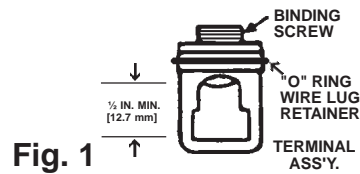


Fig. 2

WIRE SIZE	TORQUE
3/0-3 CU or AL	80 In.-Lbs. [9.04 N/m]
2/0-2 CU or AL	80 In.-Lbs. [9.04 N/m]

Fig. 3