

# SIEMENS

*Ingenuity for life*

Datasheet

## SICOP

### Low Voltage Control Components


[www.siemens.co.in](http://www.siemens.co.in)



# SIEMENS

Ingenuity for life

SIEMENS



## Technical Product Data for CAx Applications – SICOP

Industrial Controls / Low-Voltage




Edition 2014

Answers for industry.

Information is a continuous process.  
Hence, data in this DVD is subject to change  
without prior notice. For the latest information,  
please get in touch with our Sales Offices.

SIEMENS



## Technical Product Data for CAx Applications – SICOP

Industrial Controls / Low-Voltage

Edition 2014



# Planning Efficiency - CA-x Applications

Save Time. Save Money.

Available for:

- 3TF contactors
- 3UA/3UC thermal overload relays
- 3VU MPCB



2D dimension drawing



3D model



Device circuit diagram



Data sheet



Manuals / operating...



Certificate



Product image

[www.siemens.co.in](http://www.siemens.co.in)

# Index

Contents	Page No.
3TH30 – Contactor Relays	4
3TF – Power Contactors	7
3TF – Contactors for Hoisting Duty	24
3UA and 3UC – Bimetal Overload Relays	28
3VU13 and 3VU16 – Motor Protection Circuit Breakers	38
3TW and 3TE – Starters	46

# Contactor Relays 3TH30

Reliability and safety are pre-requisites in the choice of the control contactor. Siemens 3TH30 contactor relays satisfy these criteria and thus offer the right choice to the customer.

## Applications

3TH30 are used in control circuits for switching and signaling purpose. Also they are used for interfacing with the electronic circuits.

## Standards

Contactor relay conforms to IS /IEC 60947-5-1.

They also carry CE mark.

## Range

Air break contactor relays are suitable for 10A, (AC15/AC14 rating) at 240V AC and 10A, (DC13 rating) at 24V DC.

## Benefits and features

### Flexibility

- **Choice of auxiliary contacts**

3TH30 contactor relays comes with 4 contacts as a basic unit (4NO, 3NO+1NC, 2NO+2NC). However the contacts can be extended upto 8 contacts by adding maximum 4 auxiliary contact blocks to this basic unit. This offers flexibility in selection and configuration.

- **Choice of mounting**

3TH30 can be mounted on 35mm DIN rail and they are also suitable for screw mounting.


### Long Life

Superior design of current carrying parts, contact system and the magnet system increases the reliability which also results into higher **electrical and mechanical endurance**.

### High reliability

- **Double Break Parallel Bridge contact mechanism**

This mechanism is available with 3TH30. Such contact mechanism ensures reliable contact at low voltage and low currents (5mA at 17V DC). It also offers unmatched reliability as well as capability to integrate directly into PLC or instrumentation circuits.

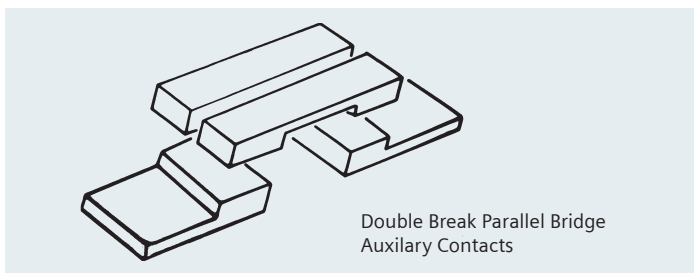

### User friendliness and safety

- **Positively driven contacts**

3TH30 auxiliary contactors satisfy the conditions **for positively driven operation** between NO and NC contacts. NO and NC contact do not close at the same time. This is extremely important when they are used in safety circuits of critical applications. This ensures operator safety even during abnormal condition.

- **SIGUT Termination**

- **Finger touch proof terminals**

It protects against accidental contact with live parts which ensures operator safety.

- **Funnel shaped cable entries**

Reduce wiring time by facilitating quick location of the connecting wire.

- **Cable end-stop**

It decides the insertion depth of the connecting wires. Since the insertion depth is predetermined, insulation of the cable can be cut accordingly and the possibility of insulation getting inadvertently caught under the terminal is avoided.

- **Captive Screws**

This feature prevents the screws from falling down thereby facilitates the wiring. Hence, the auxiliary contactors are delivered with untightened terminals. This eliminates the operation of untightening terminals before wiring.

- **Lug less termination**

This feature helps in reducing the termination time.



## Selection and ordering data

Contacts in basic unit	MLFB - With AC coil	MLFB - With DC coil	Std. pkg. (nos.)
4NO	3TH30 40-0A..	3TH30 40-0B..	1
3NO+1NC	3TH30 31-0A..	3TH30 31-0B..	
2NO+2NC	3TH30 22-0A..	3TH30 22-0B..	

.. Please add coil voltage code

### AC Coil voltages

Coil voltage	24	42	110	230	415
Code	B0	D0	F0	P0	R0

### DC Coil voltages

Coil voltage	24	42	48	110	220	250
Code	B4	D4	W4	F4	M4	N4

(Other coil voltages are also available.)

## Technical data

Type	3TH30			3TX40..			
Standards	IS/IEC 60947-5-1						
Rated Operational Voltage	690V						
Rated Impulse withstand voltage	8kV						
Permissible ambient temp.	Storage	-50 to +80°C					
	Service	-25 to +55°C					
Mechanical endurance cycles	30 mill			10 mill			
Rated operating current Ie/AC12	16A			10A			
Rated operating current Ie/AC15/AC14 at operating voltage	230V	10A			5.6A		
	415V	4A			3.6A		
	690V	2A			1.8A		
Rated operating current Ie/DC13 at operating voltage	Current paths in series			Current paths in series			
		1	2	3	1	2	3
	24V	10 A	10A	10A	10 A	10A	10A
	110V	0.9 A	2.5A	10A	0.8 A	3.8A	10A
	220V	0.45A	0.75A	2A	0.2 A	0.85A	2A
440V	0.2 A	0.5A	0.9A	0.11A	0.2A	0.5A	
Coil Voltage tolerance	0.8 to 1.1 x Ue						
Rated coil input	Closing VA/p.f. When closed VA/P.f. W	68 / 0.82					
AC operated, 50Hz		10 / 0.29					
DC operated Closing=when closed		6.2					
Frequency of operation at AC15/DC13 duty	cycles/hr	3600					
Short circuit protection	16A 16A			16A 10A			
HRC fuse-links							
Miniature circuit breakers, (C-char.)							
Degree of protection	IP 20						

### Conductor cross-sections

Conductor		Aux Contact
Solid	mm <sup>2</sup>	2 x (0.5 to 1, 1 to 2.5), 1 x 4
Finely stranded with end sleeve	mm <sup>2</sup>	2 x (0.75 to 2.5)
Pin end connector	mm <sup>2</sup>	1 x (1 to 2.5)
Solid or stranded	AWG	2 x (18 to 12)
Tightening torque	Nm	0.8 to 1.4
Length of insulation removal	mm	10


### For 3TH30

Operating time at 1.0*Us		AC	DC
Closing	Closing Delay NO	10-25ms	30-70ms
	Opening Delay NC	7-20ms	28-56ms
Opening	Opening Delay NO	5-18ms	10-20ms
	Closing Delay NC	7-20ms	15-25ms

Accessories and ordering data

1. Surge suppressor

It is used to reduce the effect of switching overvoltages created during the opening of inductive circuits. Typically they are mounted outside the body of the contactor relay, and are connected in parallel with the coil terminals. Various techniques for the suppression of switching overvoltages can be employed. For example: RC element, Varistor etc




Surge Suppressor (Varistor)			
Coil voltage		MLFB	Std. pkg. (nos.)
AC	DC		
24 - 48 V	24 - 70 V	3TX7 402-3GY1	10
48 - 127 V	70 - 150 V	3TX7 402-3HY1	
127 - 240 V	150 - 250 V	3TX7 402-3JY1	
240 - 400 V	–	3TX7 402-3KY1	
400 - 460 V	–	3TX7 402-3LY1	

2. Add on blocks


Auxiliary Contact Block	Type Reference	Std. pkg. (nos.)
1NO	3TX40 10 2A	10
1NC	3TX40 01 2A	
1NO extended	3TX40 10 4A	
1NC extended	3TX40 01 4A	

Extended contacts (NO/NC) is early make NO and late break NC combination.




Surge Suppressor (RC Element)			
Coil voltage		MLFB	Std. pkg. (nos.)
AC	DC		
24 - 48 V	24 - 70 V	3TX7 402-3RY2	10
48 - 127 V	70 - 150 V	3TX7 402-3SY2	
127 - 240 V	150 - 250 V	3TX7 402-3TY2	
240 - 400 V	–	3TX7 402-3UY2	
400 - 460 V	–	3TX7 402-3VY2	

Dimensional drawings

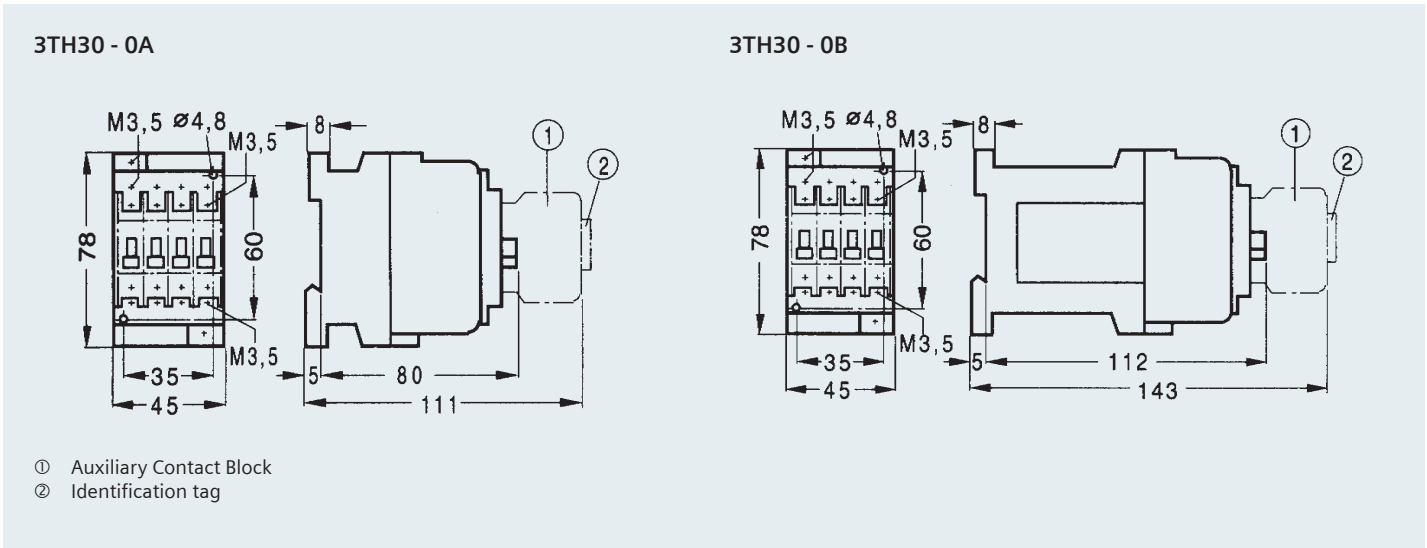

Useful technical information  
Variety of connections for DC applications

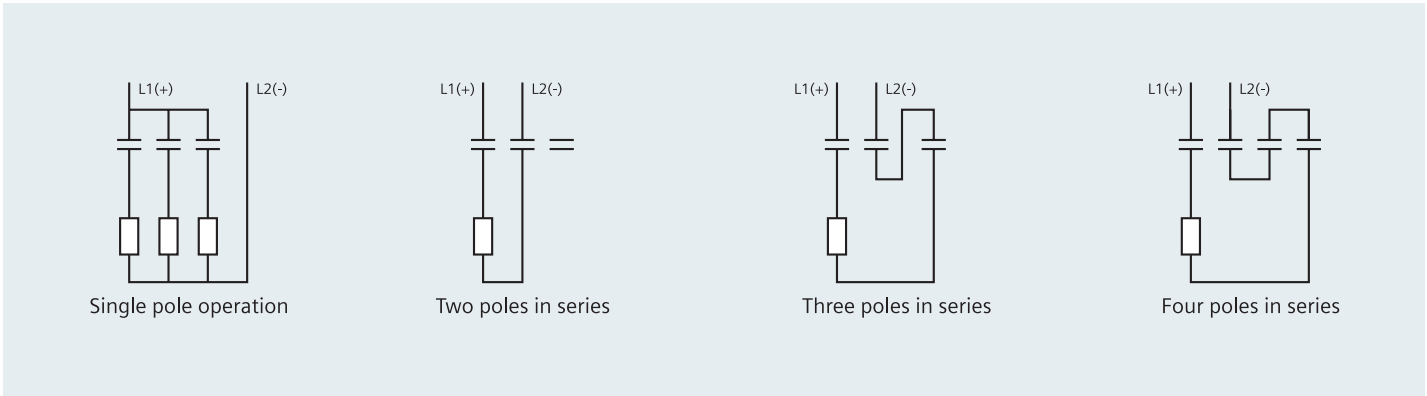

# Power Contactors 3TF

For more than 110 years, Siemens has been developing and manufacturing industrial control products. We offer a wide product range which fulfills the demands of our customers regarding performance and reliability. Our aim is to make industrial operation easier ensuring flexible mounting, modular construction and high functionality. With 3TF contactors Siemens has been offering a tried tested trusted solution to control, switch and protect your motors upto 250kW.

## Applications

3TF power contactors are suitable for switching and controlling squirrel cage and slip-ring motors as well as other AC loads, such as solenoids, capacitors, lighting loads, heating loads and transformer loads.

## Standards

Contactors conform to IS/IEC 60947-4-1. They also carry the CE mark.

## Coordinated feeder

Contactors and bi-relays have been tested for type-2 coordination at I<sub>q</sub> = 50kA, 415V AC, 50Hz as per IS/IEC 60947-4-1, for both fuse protected as well as fuseless motor feeders.

## Range

Air break contactors are available from 9 A to 475A in 3 pole version.

Also available in 2 pole AC version from 45A to 400A.

## Benefits and features

### Flexibility

- Choice of Auxiliary contacts

Contactors	Aux. contacts on basic unit	Permissible add-on contact blocks
9A / 12A	1 NO	Upto 4NO or 4NC
9A / 12A	1 NC	Upto 4NO or 2NC
16A/22A	-	Upto 4NO or 4NC
32A/38A	-	Upto 4NO or 4NC
45A to 475A	2NO+2NC	2 x (1NO+1NC)

The customer can order desired number of contacts thereby reducing the cost.

- Choice of mounting

Contactors can be mounted on 35mm DIN and they are also suitable for screw mounting (9-38A – DIN / Screw mounting and 45-475A – Screw mounting).



- Choice of coil voltages

AC 50Hz coil code: 3TF30 to 3TF56

Coil voltage (V)	24	42	110	230	415
Code	B0	D0	F0	P0	R0

Wide band AC 50 Hz coil code: 3TF30 to 3TF35

Coil voltage (V)	70-140	150-280	260-460
Code	W110	W220	W415

AC 50/60 Hz coil code: 3TF57

Coil voltage (V)	110-132	220-240	380-460
Code	F7	M7	Q7

DC coil code: 3TF30 to 3TF57

Coil voltage (V)	24	42	48	110	220	250+
Code	B4	D4	W4	F4	M4	N4

+ For 3TF3 only

(Other coil voltages are also available.)



## High performance

- **No deration upto 55°C**

Contactors are suitable for operation in service temperature upto 55°C without derating. This avoids selection of higher rated contactor, thereby reducing cost.

- **Long Life**

Superior design of current carrying parts, contact system and the magnet system increases the reliability results into **higher electrical and mechanical endurance**.

- **High short-time rating**


Contactors have a high short-time rating, which makes them suitable for applications having high starting currents and long run-up times.

## High reliability

- High insulation voltage and impulse withstand voltage capacity ensures reliable performance during occasional abnormal increase in supply voltage.

- **Double break parallel bridge contact mechanism**

This mechanism is available for auxiliary contacts. Such contact mechanism ensures reliable contact at low voltage and low currents (5mA at 17VDC). It also offers unmatched reliability. (Chances of 2 mal-operations in 100 mill. operations as against 4460 for single bridge contacts)

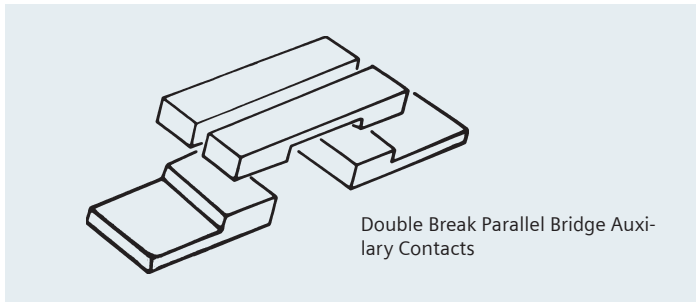

## User friendliness and safety

- **Arc Chamber Interlock (45A and above)**


It prevents the contactor from switching ON, if the arc chamber is not fitted properly. Thus avoids accidents to plant and personnel.



- **Positively driven contacts**

3TF contactors satisfy the conditions for **positively driven operation** between the main power contacts and the NC contacts. NC contacts positively open before the main contact closes. This is extremely important when power contactors are used in safety circuits of critical applications.

- **SIGUT Termination**



- **Finger touch proof terminals\***

It protects against accidental contact with live parts which ensures operator safety.

- **Funnel shaped cable entries**

Reduce wiring time by facilitating quick location of the connecting wire.

- **Cable end-stop**

It decides the insertion depth of the connecting wires. Since the insertion depth is predetermined, insulation of the cable can be cut accordingly and the possibility of insulation getting inadvertently caught under the terminal, is avoided.

- **Captive Screws**

This feature prevents the screws from falling down thereby facilitates the wiring. Hence, the contactors are delivered with untightened terminals. This eliminates the operation of untightening terminals before wiring.

- **Lug less termination**

This feature helps in reducing the termination time.

\* Finger touch proof terminals are available upto 85 A

## Selection and ordering data

Contactor size	Rated current (A) I <sub>e</sub> AC3 at 415V, 50Hz, 3ph	Motor kW at 415V 50Hz, 3ph	Auxiliary contacts	AC 50 Hz coil Type Pl. fill in coil voltage code	DC coil Type Pl. fill in coil voltage code	Std. pkg. (nos.)
0	9	4	1NO <sup>§</sup> 1NC <sup>§</sup>	3TF30 10-0A.. 3TF30 01-0A..	3TF30 10-0B.. 3TF30 01-0B..	1
	12	5.5	1NO <sup>§</sup> 1NC <sup>§</sup>	3TF31 10-0A.. 3TF31 01-0A..	3TF31 10-0B.. 3TF31 01-0B..	
1	16	7.5	— <sup>§</sup>	3TF32 00-0A..	3TF32 00-0B..	
	22	11	— <sup>§</sup>	3TF33 00-0A..	3TF33 00-0B..	
2	32	15	— <sup>§</sup>	3TF34 00-0A..	3TF34 00-0B..	
	38	18.5	— <sup>§</sup>	3TF35 00-0A..	3TF35 00-0B..	
3	45	22	2NO + 2NC <sup>§</sup>	3TF46 02-0A..ZA01 <sup>®</sup>	3TF46 02-0D..ZA01 <sup>®</sup>	
	63	30	2NO + 2NC <sup>§</sup>	3TF47 02-0A..ZA01 <sup>®</sup>	3TF47 02-0D..ZA01 <sup>®</sup>	
	70	37	2NO + 2NC <sup>§</sup>	3TF47 72-0A..	3TF47 72-0D..	
4	75	42	2NO + 2NC <sup>§</sup>	3TF48 22-0A..ZA01 <sup>®</sup>	3TF48 22-0D..ZA01 <sup>®</sup>	
	85	45	2NO + 2NC <sup>§</sup>	3TF49 22-0A..ZA01 <sup>®</sup>	3TF49 22-0D..ZA01 <sup>®</sup>	
6	110	55	2NO + 2NC <sup>§</sup>	3TF50 02-0A..	3TF50 02-0D..	
	140	75	2NO + 2NC <sup>§</sup>	3TF51 02-0A..	3TF51 02-0D..	
8	170	90	2NO + 2NC <sup>§</sup>	3TF52 02-0A..	3TF52 02-0D..	
	205	110	2NO + 2NC <sup>§</sup>	3TF53 02-0A..	3TF53 02-0D..	
10	250	132	2NO + 2NC <sup>§</sup>	3TF54 02-0A..	3TF54 02-0D.. <sup>1)</sup>	
	300	160	2NO + 2NC <sup>§</sup>	3TF55 02-0A..	3TF55 02-0D.. <sup>1)</sup>	
12	400	200	2NO + 2NC <sup>§</sup>	3TF56 02-0A..	3TF56 02-0D.. <sup>1)</sup>	
	475	250	2NO + 2NC <sup>§</sup>	3TF57 02-0C..	3TF57 02-0D.. <sup>1)</sup>	

<sup>1)</sup> Please connect DC coil circuit as recommended on page 16

<sup>§</sup> For more auxiliary contacts please refer table below - "auxiliary contact blocks"

<sup>®</sup> For box type (SIGUT) terminal, order 2 nos. 3TX7 460-0E

### Coil voltage code AC 50Hz: 3TF30 to 3TF56

Coil voltage	24	42	110	230	415
Code	B0	D0	F0	P0	R0

### Coil voltage code AC 50/60 Hz: 3TF57

Coil voltage (V)	110-132	220-240	380-460
Code	F7	M7	Q7

### Coil voltage code DC: 3TF30 to 3TF57

Coil voltage (V)	24	42	48	110	220	250*
Code	B4	D4	W4	F4	M4	N4

+ For 3TF3 only

### <sup>2)</sup> Coil voltage code AC 50Hz: 3TF (2 Pole AC Contactor)

Coil voltage	110	230	415
Code	F0	P0	R0

(Other coil voltages are also available)

### Auxiliary contact blocks

For Contactor	Description	Type	Std. pkg. (nos.)
3TF30 to 35 & 3TH30	1NO	3TX4010-2A	10
	1NC	3TX4001-2A	10
	1NO (Extd)	3TX4010-4A	10
	1NC (Extd)	3TX4001-4A	10
3TF46 to 3TF57, 3TK5	Second 1NO+1NC Left	3TY7561-1KA008K	1
	Second 1NO+1NC Right		

## 2 Pole AC contactors - 3TF

For single phase and 2 phase applications with AC coils

Contactor Size	Rated current I <sub>e</sub> (A) AC3, 415V	Type <sup>2)</sup>	Std. pkg. (nos.)
3	45	3TF46 02-0A..ZB01	1
3	63	3TF47 02-0A..ZB01	
3	70	3TF47 72-0A..ZB01	
6	110	3TF50 02-0A..ZB01	
6	140	3TF51 02-0A..ZB01	
8	170	3TF52 02-0A..ZB01	
8	205	3TF53 02-0A..ZB01	
10	250	3TF54 02-0A..ZB01	
10	300	3TF55 02-0A..ZB01	
12	400	3TF56 02-0A..ZB01	

## Technical data

Contactor		Size	0		1		2				
		Type	3TF30	3TF31	3TF32	3TF33	3TF34	3TF35			
Permissible ambient temperature	Storage Service	°C °C	-55 to +80 -25 to +55								
Maximum operating voltage		V	690								
Rated insulation voltage <i>Ui</i> (At Pollution Degree 3) <sup>1)</sup>		V	690								
Rated impulse strength <i>Uimp</i>		kV	8								
Mechanical endurance (make/break operations)	AC DC	Cycles Cycles	15 x 10 <sup>6</sup> 15 x 10 <sup>6</sup>					10 x 10 <sup>6</sup> 10 x 10 <sup>6</sup>			
Rating of contactors for AC loads											
AC-1 duty, switching resistive load											
Rated operational current <i>Ie</i>	at 40°C upto 690V at 55°C upto 690V	A A	21 20		32 30		65 55				
Ratings of three-phase loads											
p.f.=1 at 55°C	at 415V 500V 690V	kW kW kW	13 17 22		19.7 26 34		36 47.5 62.7				
AC-2 and AC-3 duty											
Rated operational current <i>Ie</i> <sup>2)</sup>	upto 415V 500V 690V	A A A	9 9 6.6	12 12 8.8	16 16 12.2	22 17 12.2	32 32 27	38 38 27			
Nominal rating of slipring or squirrel-cage motors at 50/60 Hz.	at 415V 500V 690V	kW kW kW	4 5.5 5.5	5.5 7.5 7.5	7.5 10 11	11 11 11	15 21 23	18.5 25 23			
AC-4 duty (contact endurance approx. 2x10 <sup>5</sup> make-break operations at Ia=6Ie)											
Rated operational current <i>Ie</i>	upto 690V	A	3.3	4.3	7.7	8.5	15.6	18.5			
Rating of squirrel-cage motors at 50/60Hz.	at 415V 500V	kW kW	1.54 1.7	2.1 2.5	3.5 4.6	4 5.2	8.2 9.8	9.8 11.8			
Max. permitted rated operational current Ie/AC-4 = Ie/AC-3 upto 500V. Ref. life curve for the life.	690V	kW	2.54	3.45	6	6.6	13	15.5			
Used as stator contactor (upto 690V) (AC-2 duty)											
Stator currents <i>Ies</i>	20%	A	20	20	25(46*)		85				
On-load factor (ED) <sup>3)</sup> with intermittent duty	40%	A	20	20	25(37*)		67				
	60%	A	20	20	25(33*)		60				
* Applicable up to 500V	80%	A	20	20	25(30*)		55				
Used as rotor contactor (upto 690V) (AC-2 duty)											
Rotor current <i>Ier</i>	20%	A	31		73		125				
On-load factor (ED) <sup>3)</sup>	40%	A	31		58		106				
with intermittent duty	60%	A	31		52		95				
	80%	A	31		47		87				
Locked rotor voltage Uer	Starting	V	1320		1320		1320				
Plugging / Control		V	660		660		660				
AC-6b duty, switching low-inductance individual three-phase capacitors at 50/60Hz <sup>4)</sup> (we also offer special capacitor duty contactors)	415V 500V 690V	kVAR kVAR kVAR	4 4 4		7.5 7.5 7.5		16.7 16.7 16.7				
Thermal loading	10 s current	A	90	96	130	176	400	400			
Power loss per current path at Ie/AC-3		W	0.6	1.1	1	1.6	2	2.5			
Rating of contactors for DC loads											
DC-1 duty, switching resistive load (L/R < 1mS)											
Rated operational current <i>Ie</i> (at 55°C)											
Number of current paths in series connection			1	2	3	1	2	3	1	2	3
	at 24V	A	20	20	20	30	30	30	55	55	55
	110V	A	2.1	12	20	4.5	30	30	6	55	55
	220V	A	0.8	1.6	20	1	5	30	1	6	45
	440V	A	0.6	0.8	1.3	0.4	1	2.9	0.4	1.1	2.9
DC-3 and DC-5 duty, shunt & series motors (L/R < 15mS)											
Rated operational current <i>Ie</i> (at 55°C)											
Number of current paths in series connection			1	2	3	1	2	3	1	2	3
	at 24V	A	20	20	20	20	30	30	20	55	55
	110V	A	0.15	0.35	20	0.75	7	30	0.75	7	55
	220V	A	-	-	1.75	0.2	1	3.5	0.2	1	3.5
	440V	A	-	-	0.2	0.09	0.27	0.6	0.1	0.27	0.6

1) As per IS/IEC 60947-1

2) Ratings at 1000V AC - upon enquiry.

3) On-load factor (ED) in % =  $\frac{\text{ontime} \times 100}{\text{cycle time}}$   
Max. switching freq.  $z = 50$  per hour. Ratings at higher frequency upon enquiry.



3			4		6		8		10		12				
3TF46	3TF47	3TF47 7	3TF48	3TF49	3TF50	3TF51	3TF52	3TF53	3TF54	3TF55	3TF56	3TF57			
			-55 to +80 -25 to +55												
1000			1000												
1000			1000												
8			8												
10 x 10 <sup>6</sup> 3 x 10 <sup>6</sup>			10 x 10 <sup>6</sup> 3 x 10 <sup>6</sup>												
	90 80	100 90	100 90	120 100	120 100	170 160		230 210	240 220	325 300	325 300	425 400	600 550		
	52 67 91	52 67 91	52 67 91	66 86 114	66 86 114	105 138 183		132 173 228	138 181 240	195 260 340	195 260 340	262 345 457	381 476 657		
	45 45 45	63 63 63	70 70 70	75 75 75	85 85 75	110 110 110	140 140 110	170 170 170	205 205 170	250 250 250	300 300 250	400 400 400	475 475 400		
	22 30 40	30 41.4 57.2	37 46 60.1	42 50.7 70	45 59 70	55 76.3 105	75 98 105	90 118 163	110 145 163	132 178 245	160 210 245	200 284 392	250 329 392		
	24 13.1 15.8	28 15.3 18.4	31 16.9 20.4	34 18.6 22.4	42 23 27	54 29.5 35.5	68 38 46	75 42 50	96 54 65	110 63 76	125 72 86	150 88 107	150 88 107		
	21.8	25.4	28.2	30.9	38	49	63	69	90	105	119	147	147		
	123 98 87 80	138 110 98 90	138 110 98 90	154 122 109 100	246 195 174 160		323 256 229 210	339 268 240 220	462 367 327 300	617 490 436 400		800 670 600 550			
	150 150 138 126 1500 750	219 174 155 142 1500 750	219 174 155 142 1500 750	243 193 172 158 2000 1000	389 309 275 253 2000 1000		510 405 361 332 2000 1000	535 425 378 348 2000 1000	729 579 516 474 2000 1000	972 772 688 632 2000 1000		1336 1061 946 869 2000 1000			
	30 35 30	50 62.5 50		60 80 60		100 130 100		150 190 150		200 265 200					
	360 3.5	500 6	500 6	800 7.5	800 10	880 10	1140 14	1360 14	1640 20	2500 16	2500 23	3400 40	4200 40		
	1 80 6 1.2 0.48	2 80 80 7 1.2	3 80 80 80 3	1 100 12 2.5 0.8	2 100 100 13 2.4	3 100 100 100 6	1 160 18 3.4 0.8	2 160 160 20 3.2	3 160 160 160 11.5	1 200 18 3.4 0.8	2 200 200 200 3.2	3 200 200 200 11.5	1 300 33 3.8 0.9	2 300 300 300 4	3 300 300 300 11
	1 5 0.75 0.2 0.1	2 80 12.5 1.1 0.27	3 80 80 3.5 0.6	1 6 1.25 0.35 0.15	2 100 100 1.75 0.42	3 100 100 4 0.8	1 160 2.5 0.6 0.17	2 160 160 2.5 0.65	3 160 160 160 1.4	1 200 2.5 0.6 0.17	2 200 200 2.5 0.65	3 200 200 200 1.4	1 300 3 0.6 0.18	2 300 300 2.5 0.65	3 300 300 300 1.4

4) Ratings for capacitor - banks in parallel - upon enquiry. Minimum inductance of 6μH required between parallel connected capacitors.

## Power Contactors Technical Data

Contactor			Size	0		1		2		3			
			Type	3TF30	3TF31	3TF32	3TF33	3TF34	3TF35	3TF46	3TF47	3TF47 7	
<b>Switching frequency z</b> (Contactors without overload relay)			Operation										
	No load	AC		Cycles/hr	10,000	10,000	5000	5000	5000	5000	5000	5000	5000
		DC		Cycles/hr	1,500	1,500	1,500	1,500	1,500	1,500	1,000	1,000	1,000
	at AC-1			Cycles/hr	2,000	2,000	1,500	1,500	1,200	1,200	1,000	1,000	1,000
	at AC-2			Cycles/hr	1,000	1,000	750	750	750	600	600	400	400
	at AC-3			Cycles/hr	1,000	1,000	750	750	750	600	1200 <sup>5)</sup>	1000	1000
	at AC-4		Cycles/hr	250	250	250	250	250	200	400	300	300	
<b>Coil ratings</b>			Supply frequency	Hz	50		50		50		50		
AC operation 50Hz			Closing p.f.	VA	68		68		101		183		
			Closed p.f.	VA	10		10		12.1		17		
					0.29		0.29		0.28		0.29		
DC operation			Closing	W	6.2		6.2		11.7		400		
			Closed	W	6.2		6.2		11.7		2.1		
Coil voltage tolerance			Operation AC/DC at 24V DC		0.8 to 1.1 x Us 0.8 to 1.2 x Us		0.8 to 1.1 x Us						
<b>Operating times at 1 x Us <sup>8)</sup></b>													
AC operation			Closing	ms	10 - 25		10 - 25		13 - 32		17 - 30		
			Opening	ms	4 - 18		5 - 20		5 - 10		5 - 25		
DC operation			Closing	ms	30 - 70		40 - 80		58 - 107		22 - 40		
			Opening	ms	12 - 20		10 - 20		13 - 17		105 - 115		
<b>Auxiliary contacts</b>													
<b>Rated thermal current <math>I_{th}</math> = rated operational current <math>I_e</math> / AC-12</b>			A	Inbuilt Aux Contact 10		Contact Block 3TX4 10				Contact Block 3TY7 10			
Rated operational current $I_e$ / AC-15/AC-14													
at rated operational voltage $U_e$			upto 125V	A	10		6				10		
			220V	A	10		6				6		
			415V	A	5.5		3.6				3.6		
			500V	A	4		2.5				2.5		
Rated operational current $I_e$ / DC12													
at rated operational voltage $U_e$			upto 48V	A	10		10				10		
			110V	A	2.1		5.5				3.2		
			220V	A	0.8		1.2				0.9		
			440V	A	0.6		0.28				0.33		
Rated operational current $I_e$ / DC13													
at rated operational voltage $U_e$			upto 24V	A	10		10				10		
			48V	A	5		4.6				5		
			110V	A	0.9		0.80				1.14		
			220V	A	0.45		0.30				0.48		
			440V	A	0.25		0.11				0.13		
<b>Conductor cross-sections</b>													
<b>Main conductor</b>													
Solid			mm <sup>2</sup>	2 x (0.5 to 1, 1 to 2.5), 1x4		2 x (2.5 to 6)		1 to 16		2 x (6 to 16)			
Finely stranded with end sleeve			mm <sup>2</sup>	2 x (0.75 to 2.5)		2 x (1.5 to 4)		1 x (5 to 16, 2.5 to 10)		1 x (10 to 35), 2 x (10 to 25)			
Pin end connector			mm <sup>2</sup>	1 x (1 to 2.5)		1 x (1 to 6)		2 x (1 to 6)		–			
Solid or stranded			AWG	2 x (18 to 12)		2 x (14 to 10)		2 x (14 to 6)		2 x (10 to 1/10)			
Tightening torque			Nm	0.8 to 1.4		1 to 1.5		2.5 to 3.0		4 to 6			
Finely stranded with cable lug			mm <sup>2</sup>							10 to 35			
Terminal bar (max. width)			mm							12			
Solid or stranded			AWG							7 to 1/0			
Tightening torque			Nm							4 to 6			
<b>Auxiliary conductor</b>													
Solid			mm <sup>2</sup>	2 x (0.5 to 1, 1 to 2.5), 1 x 4		2 x (0.5 to 1, 1 to 2.5),				2 x (0.5 to 1, 1 to 2.5), 1 x 4			
Finely stranded with end sleeve			mm <sup>2</sup>	2 x (0.75 to 2.5)		2 x (0.75 to 2.5)				2 x (0.75 to 2.5)			
Pin end connector			mm <sup>2</sup>	1 x (1 to 2.5)		2 x (1 to 1.5)				2 x (1 to 1.5)			
Solid or stranded			AWG	2 x (18 to 12)		2 x (18 to 12)				2 x (18 to 12)			
Tightening torque			Nm	0.8 to 1.4		0.8 to 1.4				0.8 to 1.4			
Length of insulation removal			mm	10		10				10			
<b>Short-circuit protection</b>													
<b>Main circuit (Fuse type 3NA3)</b>			Co-ordination										
Type - 1			A	35	35	63	63	80	80	160	160	160	
Type - 2			A	25	25	32	32	80	80	125	125	160	
<b>Auxiliary circuits</b>			A	16									
			A	6, if overload relay auxiliary contacts are in the contactor coil circuit									

5) With AC coil. With DC coil: 1000 oprs/hr.

7) Rated value of the control voltage.

6) Including switching contactor.


4		6		8		10		12		
3TF48	3TF49	3TF50	3TF51	3TF52	3TF53	3TF54	3TF55	3TF56	3TF57	
5000 1,000 900 400 1000 300	5000 1,000 900 350 850 300	5000 1000 800 400 1000 300	5000 1000 800 300 750 200	5000 1000 800 300 700 200	5000 1000 750 250 500 130	3000 1000 800 300 700 200	3000 1000 750 250 500 130	3000 1000 700 200 500 150	2000 1000 500 170 420 150	
50  330 0.5 32 0.23 420 2.7		50  550 0.45 39 0.24 500 2.7		50  910 0.38 58 0.26 876 <sup>6)</sup> 11 <sup>6)</sup>		50  1430 0.34 84 0.24 1216 <sup>6)</sup> 13.3 <sup>6)</sup>		50  2450 0.21 115 0.33 1306 <sup>6)</sup> 14 <sup>6)</sup>	50/60 Lower <sup>7)</sup> 1136 1 16 0.34 1110 <sup>6)</sup> 24 <sup>6)</sup>	Upper <sup>7)</sup> 1900 1 45 0.16
0.8 to 1.1 x Us										
22 - 35 5 - 30 32 - 40 95-105		22 - 37 8 - 30 28 - 32 185 - 195		25 - 50 10 - 30 32 - 45 10 - 20		25 - 40 10 - 30 36 - 45 10 - 20		25 - 40 8 - 30 40 - 55 10 - 20	48 - 70 80 - 100 44 - 60 12 - 15	
10  10 6 3.6 2.5  10 3.2 0.9 0.33  10 5 1.14 0.48 0.13				10  10 6 3.6 2.5  10 3.2 0.9 0.33  10 5 1.14 0.48 0.13				10  10 6 3.6 2.5  10 3.2 0.9 0.33  10 5 1.14 0.48 0.13		
		16 to 70 15 3 to 2/0 6 to 8	35 to 95 20 10 to 14	35 to 95 20 10 to 14	50 to 240 25 14 to 24	50 to 240 25 14 to 24	50 to 240 25 14 to 24	50 to 240 25 14 to 24	50 to 240 30 14 to 24	
2 x (0.5 to 1, 1 to 2.5), 1 x 4 2 x (0.75 to 2.5) 1 x (1 to 2.5) 2 x (18 to 12) 0.8 to 1.4 10				2 x (0.5 to 1, 1 to 2.5) 2 x (0.75 to 2.5) 1 x (1 to 2.5) 2 x (18 to 12) 0.8 to 1.4 10				2 x (0.5 to 1, 1 to 2.5) 2 x (0.75 to 2.5) 1 x (1 to 2.5) 2 x (18 to 12) 0.8 to 1.4 10		
250 160	250 160	400 200	400 250	400 250	400 250	500 400	500 400	630 500	800 500	

8) The opening time delay increases when the contactor coil is protected against voltage peaks. (e.g. Varistor: +2 to +5ms)




Electrical Life Curves

3TF30 to 3TF49 contactors

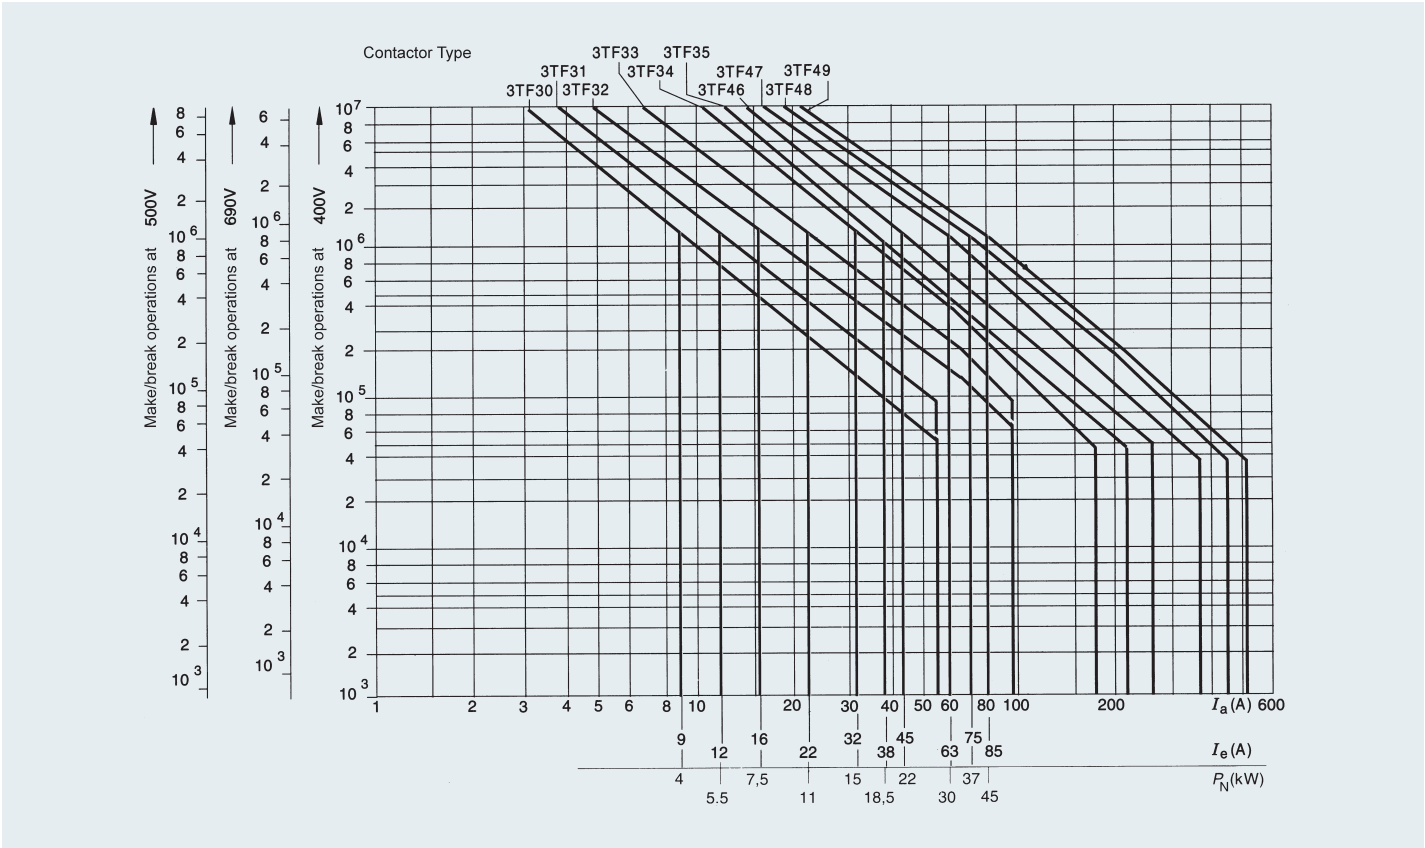


3TF50 to 3TF57 contactors

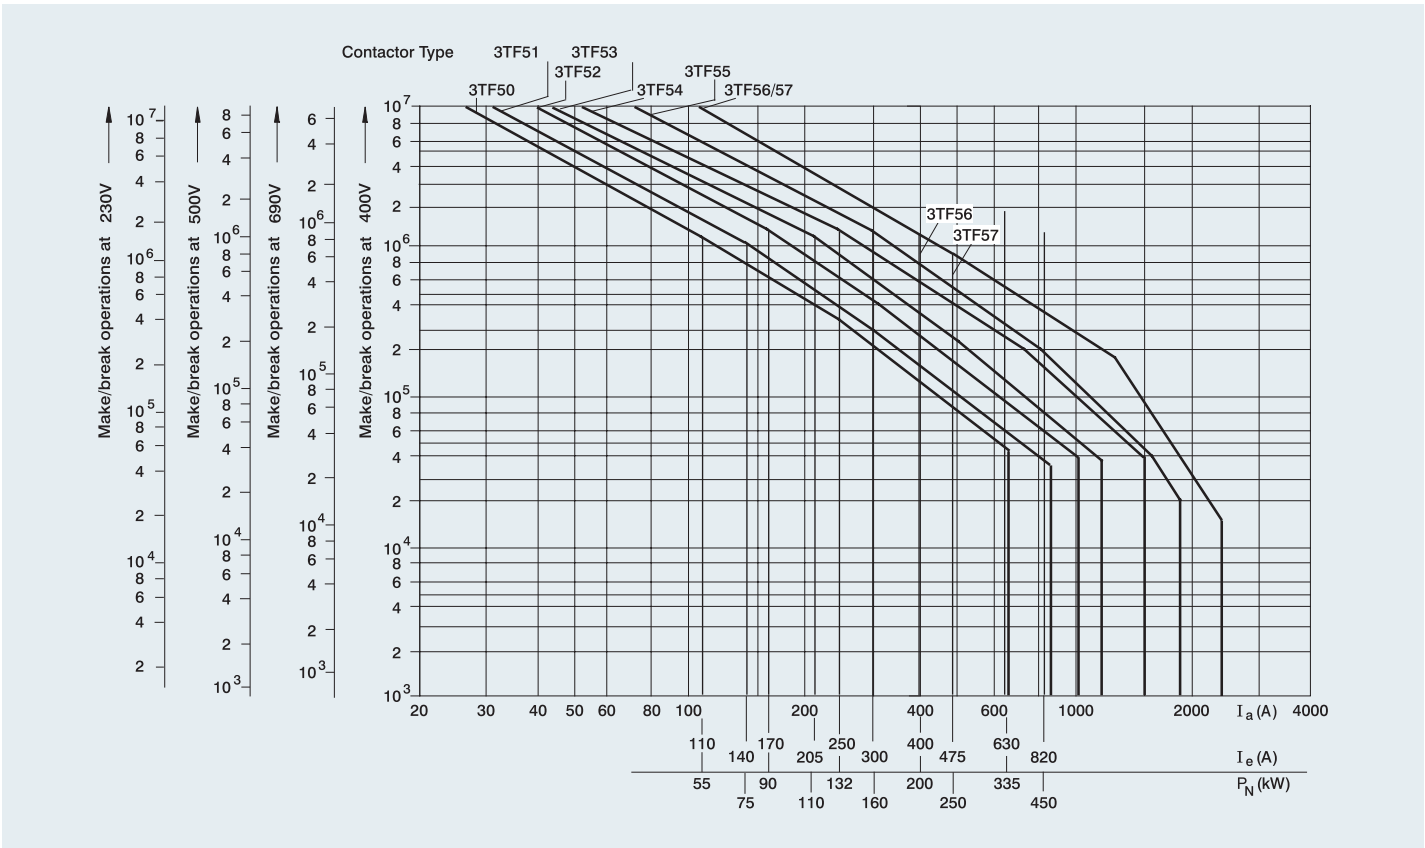


## Typical Circuit Diagrams


### Direct On Line starter

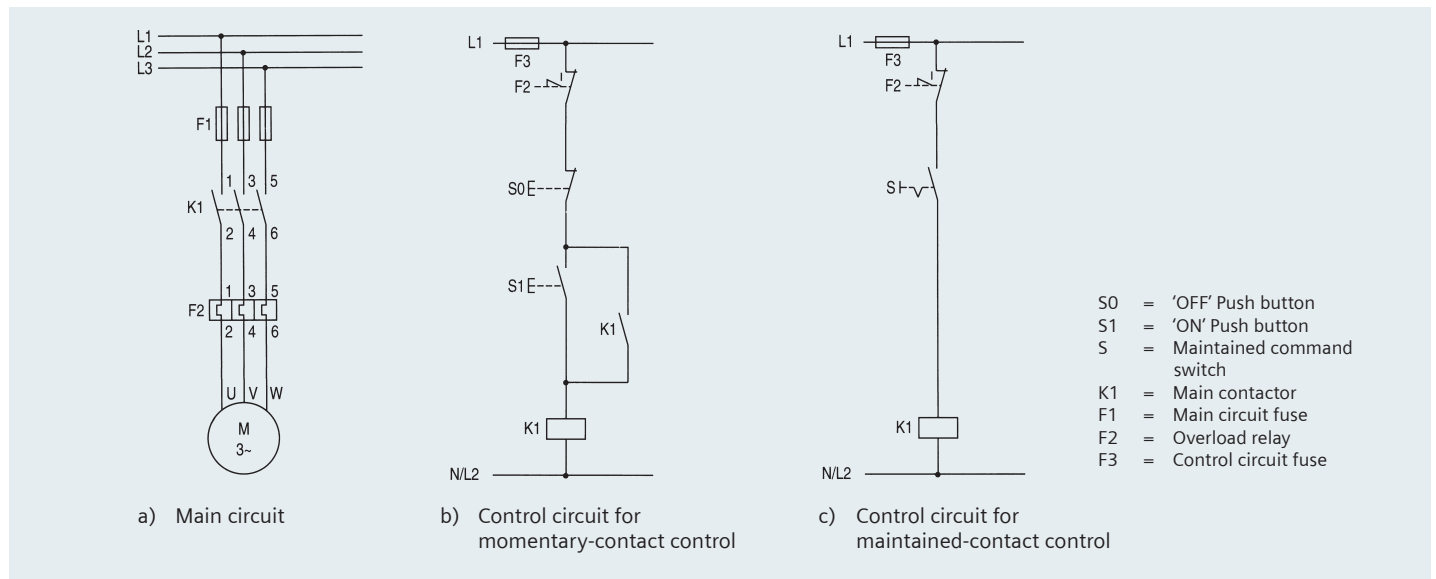


### Forward / Reverse starter (Electrical Interlocking)

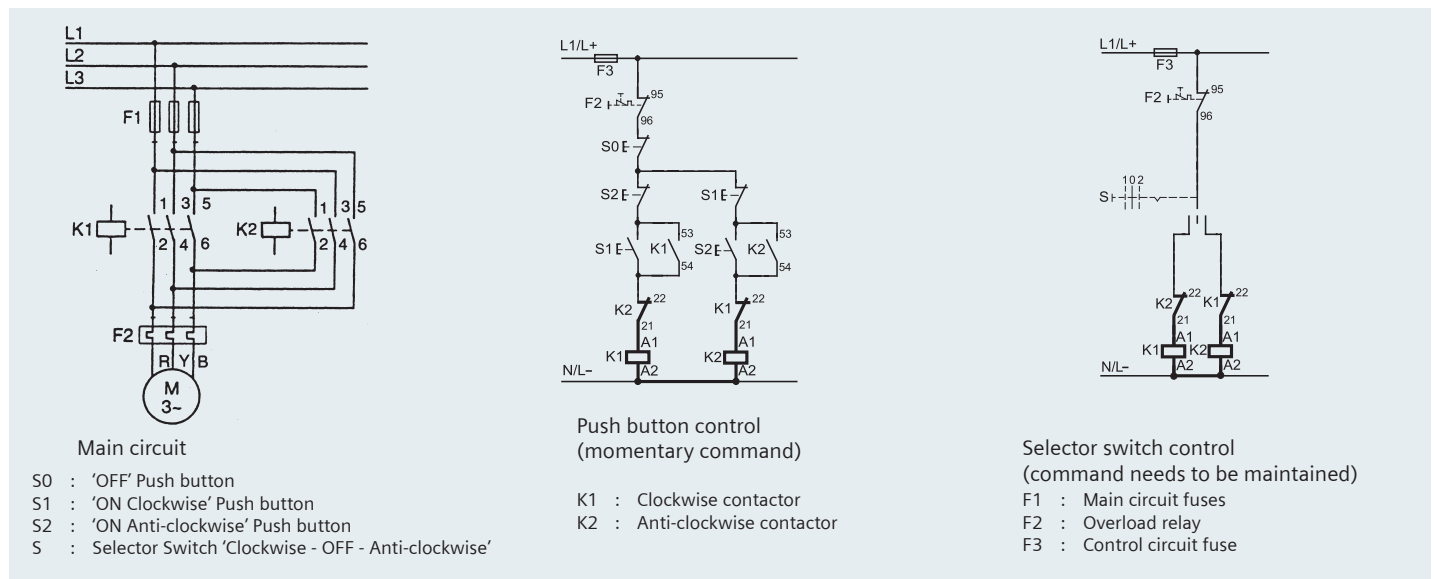

### Star Delta starter

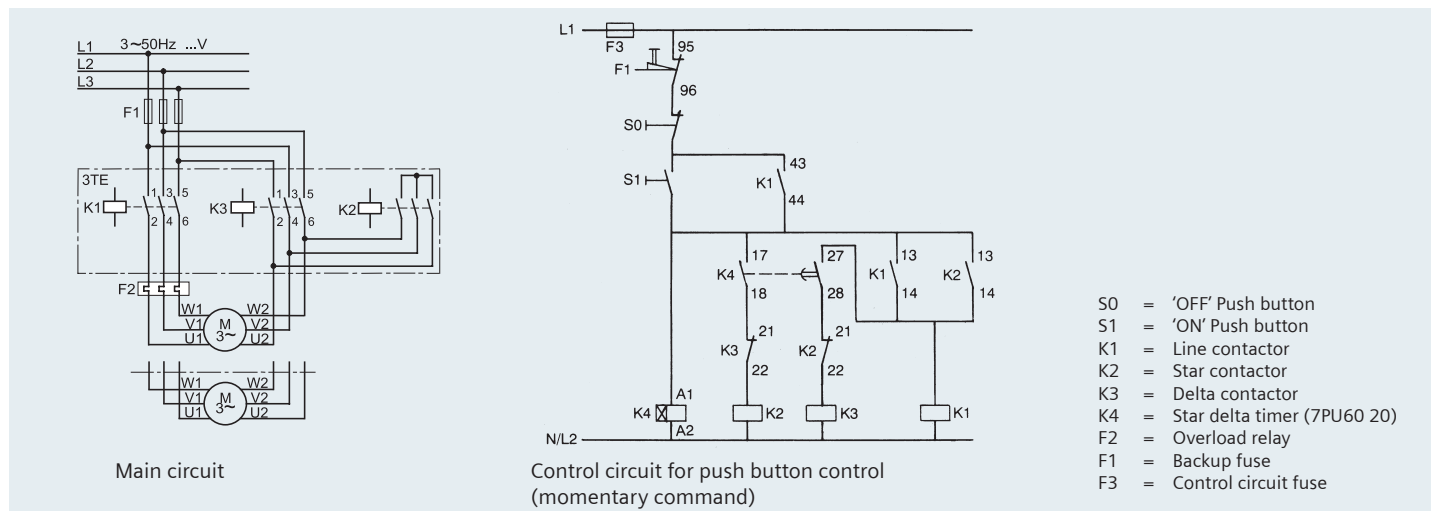


## Auto Transformer starter

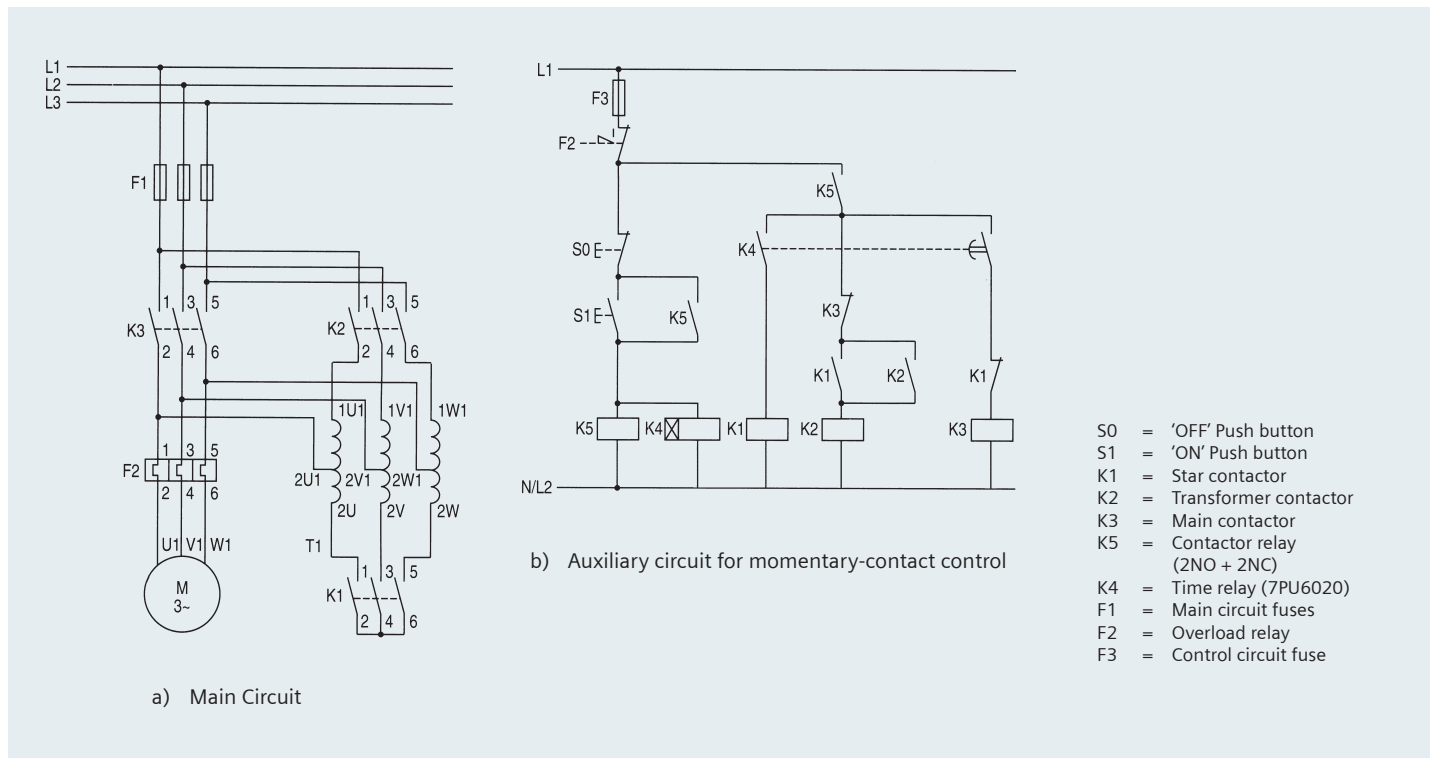


Please refer page no. 70 for selection of switchgear for autotransformer starting method

## Internal connection diagram for DC coil circuits

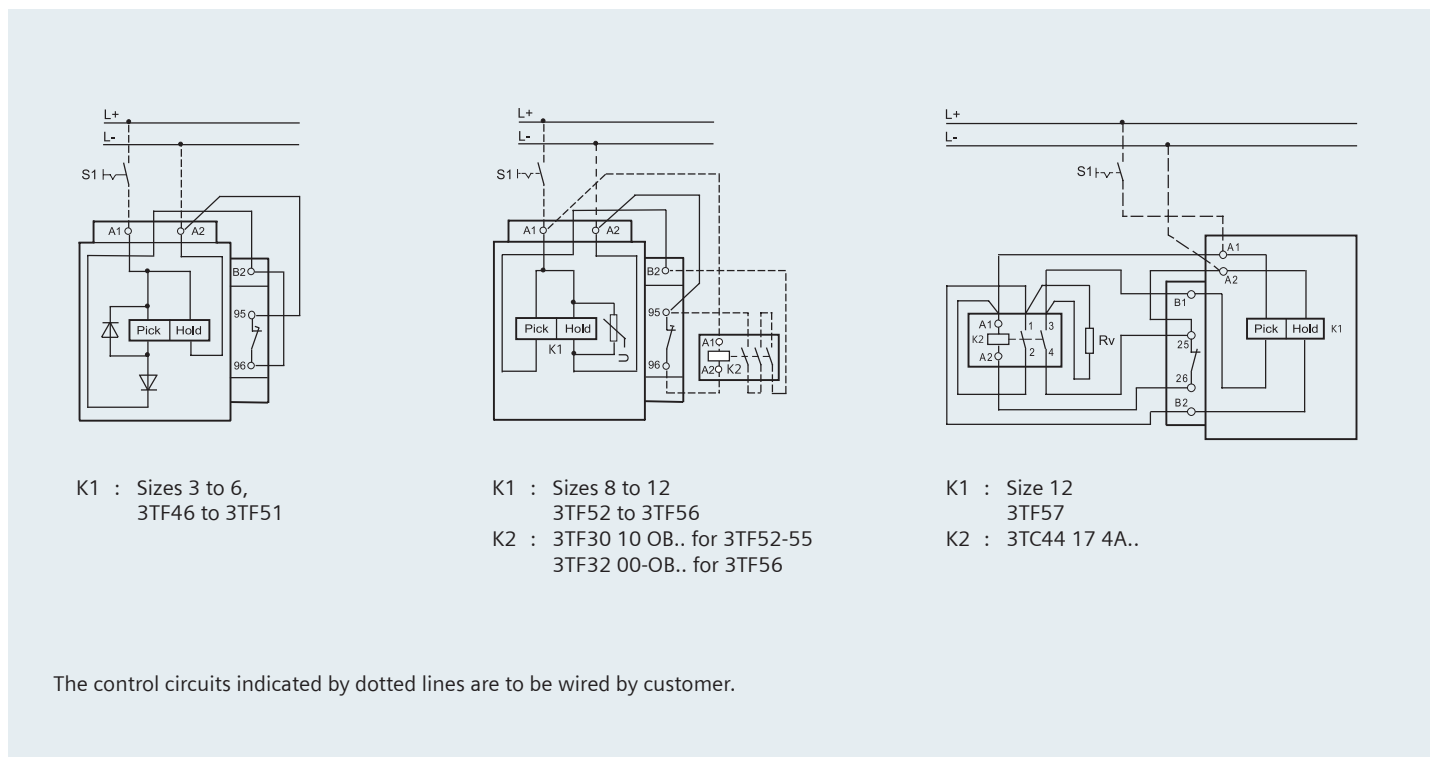

Terminal Designation

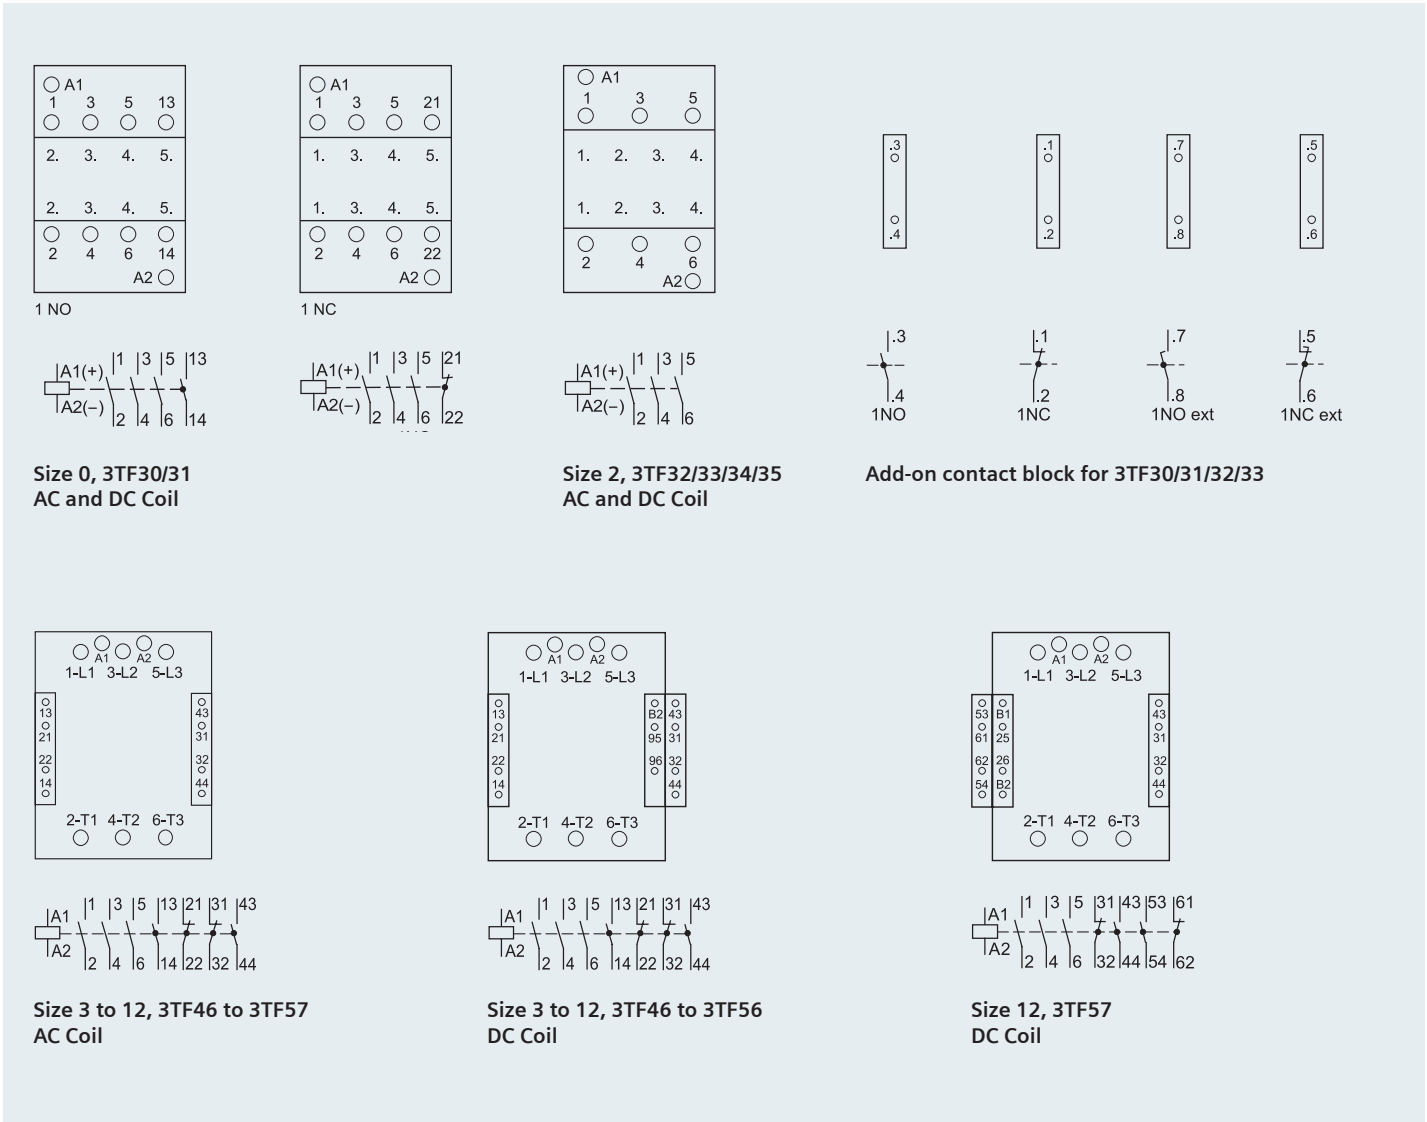



## Accessories and ordering data

### 1. Mechanical interlocking kit

Mechanical interlock is required when the supply from two different sources is available. Also the same is required for the application involving reversing of motor. Here two contactors are mechanically interlocked with the help of mechanical interlock kit. This ensures closing of only one contactor at a time. Thus prevents a short circuit upon load changeover from one contactor to another.


For Contactor		MLFB	Std. pkg. (nos.)
AC3 Rating	Contactor		
9 to 38A	3TF30 to 35	3TX4 091-1A #	10
45/63/70A	3TF46/47/47-7	3TX7 466-1YA0	2
75/85A	3TF48/49	3TX7 486-1YA0	2
110/140A	3TF50/51	3TX7 506-1YA0	2
170/205A	3TF52/53	3TX7 526-1YA0	2
250/300A	3TF54/55	3TX7 546-1YA0	2
400 A	3TF56	3TX7 566-1YA0	2
110/170 A	3TF50/52	3TX7 526-1YA09	1
170/250 A	3TF52/54	3TX7 546-1YA09	1

#: W/O base plate (not required)

### 2. Surge suppressor


It is used to reduce the effect of switching overvoltages created during the opening of inductive circuits. Typically they are mounted outside the body of the contactor, and are connected in parallel with the coil terminals. Various techniques for the suppression of switching overvoltages can be employed. For example: RC element, Varistor etc.

#### RC Element:



The effective increase in the capacitance of the coil circuit reduces the amplitude and rate of rise of switch off overvoltage spikes to such an extent that no rapid restriking occurs.

#### Varistor:



Varistor limits the maximum value of the overvoltage because they become highly conductive above a threshold value. Until this threshold value is reached, no discharge occurs for small duration.

## Selection table:

### Surge suppressor (Varistor) for 3TF30-3TF35

Coil Voltage		Type	Std. pkg. (nos.)
AC	DC		
24 - 48 V	24 - 70V	3TX7 402-3GY1	10
48 - 127V	70 - 150V	3TX7 402-3HY1	
127 - 240V	150 - 250V	3TX7 402-3JY1	
240 - 400V	–	3TX7 402-3KY1	
400 - 600V	–	3TX7 402-3LY1	

### Surge suppressor (Varistor) for 3TF46-56

Coil Voltage		Type	Std. pkg. (nos.)
AC	DC		
Less than 48V	24 - 70V	3TX7 462-3GY1	10
48 - 127V	70 - 150V	3TX7 462-3HY1	
127 - 240V	150 - 250V	3TX7 462-3JY1	
240 - 400V	–	3TX7 462-3KY1	
400 - 600V	–	3TX7 462-3LY1	

### Surge suppressor (RC Element) for 3TF30-3TF35

Coil Voltage		Type	Std. pkg. (nos.)
AC	DC		
24 - 48V	24 - 70V	3TX7 402-3RY2	10
48 - 127V	70 - 150V	3TX7 402-3SY2	
127 - 240V	150 - 250 V	3TX7 402-3TY2	
240 - 400V	–	3TX7 402-3UY2	
400 - 460V	–	3TX7 402-3VY2	

### 3. Connector

The 3TS90 connector is used to mount the motor protection circuit breaker 3VU on the contactor 3TF with screw terminals. It enables mechanical and electrical connection between contactor and motor protection circuit breaker.



#### Range:

Size of connector	MPCB		Contactor		MLFB of Connector	Std. pkg. (nos.)
	MLFB	Current Rating	MLFB	AC3 Current Rating		
I	3VU13	0.16 to 20A	3TF30 / 31	9 / 12 A	3TS90 01-8K	1
II	3VU13	6 to 25A	3TF32 / 33	16 / 22A	3TS90 02-8K	1


#### Benefits:

Direct mounting of 3VU MPCB on 3TF contactor eliminates the need of power wiring and ensures secure connection. In addition, the assembly time and size of the feeder is reduced which results in cost saving. The overall assembly also looks contemporary.

## Spares and ordering data

### 1. Auxiliary Contact Blocks

#### In-built contact configuration

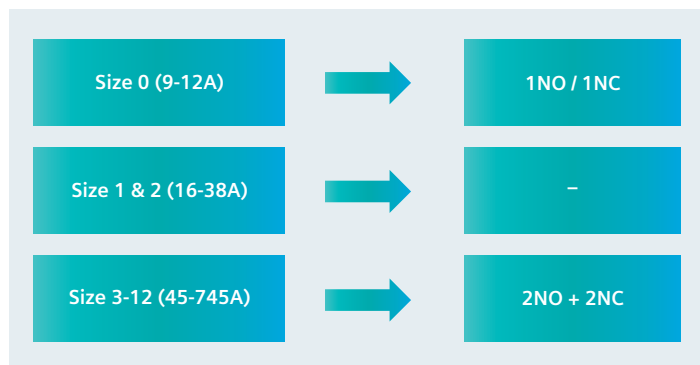

#### Add – on Contact Blocks:

For contactor	Description	Type	Std. pkg. (nos.)
3TF30-35	1NO 1NC 1NO ext 1NC ext	3TX40 10-2A 3TX40 01-2A 3TX40 10-4A 3TX40 01-4A	10
3TF46-57	1NO+1NC Left 1NO+1NC Right 1NO + 1NC (Extd) Right	3TY7 561-1A 3TY7 561-1B 3TY7 561-1E	1
3TF46/47/477	Special block for DC Coil Circuit	3TY7 461-1F	1
3TF48 to 57	Special block for DC Coil Circuit	3TY7 481-1F	1

### 2. Main contact kits / arc chambers / AC-DC coils

For contactor type (AC3 rating)	Main contact kits (6 fixed & 3 moving contacts)	Arc chambers	AC coils <sup>1)</sup>	DC coils <sup>1)</sup>	Std. pkg. (nos.)
3TF30 (9A)	–	–	3TY7 403-0A..	3TY4 803-0B..	1
3TF31 (12A)	–	–			
3TF32 (16A)	3TY7 420-0A	–			
3TF33 (22A)	3TY7 430-0A	–			
3TF34 (32A)	3TY7 340-0C	3TY7 342-0C	3TY7 443-0A..	3TY7 443-0B..	
3TF35 (38A)	3TY7 350-0C	3TY7 352-0C			
3TF46 (45A)	3TY7 460-0YA	3TY7 462-0YA	3TY7 463-0A..	3TY7 463-0D..	
3TF47 (63A)	3TY7 470-0YA	3TY7 472-0YA			
3TF477 (70A)	3TY7 477-0YA	3TY7 477-0YD			
3TF48 (75A)	3TY7 480-0A	3TY7 482-0A	3TY7 483-0A..	3TY7 483-0D..	
3TF49 (85A)	3TY7 490-0A	3TY7 492-0A			
3TF50 (110A)	3TY7 500-0YA	3TY7 502-0YA	3TY7 503-0A..	3TY7 503-0D..	
3TF51 (140A)	3TY7 510-0YA	3TY7 512-0YA			
3TF52 (170A)	3TY7 520-0YA	3TY7 522-0YA	3TY7 523-0A..	3TY7 523-0D..	
3TF53 (205A)	3TY7 530-0YA	3TY7 532-0YA			
3TF54 (250A)	3TY7 540-0YA	3TY7 542-0YA	3TY7 543-0A..	3TY7 543-0D..	
3TF55 (300A)	3TY7 550-0YA	3TY7 552-0YA			
3TF56 (400A)	3TY7 560-0YA	3TY7 562-0YA	3TY7 563-0A..	3TY7 563-0D..	
3TF57 (475A)	3TY7 570-0YA	3TY7 572-0YA	3TY7 573-0C	3TY7 573-0D..	

<sup>1)</sup> Please fill in coil voltage code from table below

#### Coil voltage code AC 50Hz: 3TF30 to 3TF56

Coil voltage	24	42	110	230	415
Code	B0	D0	F0	P0	R0

#### Coil voltage code AC 50/60 Hz: 3TF57

Coil voltage (V)	110-132	220-240	380-460
Code	F7	M7	Q7

#### Coil voltage code DC: 3TF30 to 3TF57


Coil voltage (V)	24	42	48	110	220	250*
Code	B4	D4	W4	F4	M4	N4

\* For 3TF3 only


(Other coil voltages are also available)

Dimensional drawing


3TF30/31 AC Coil

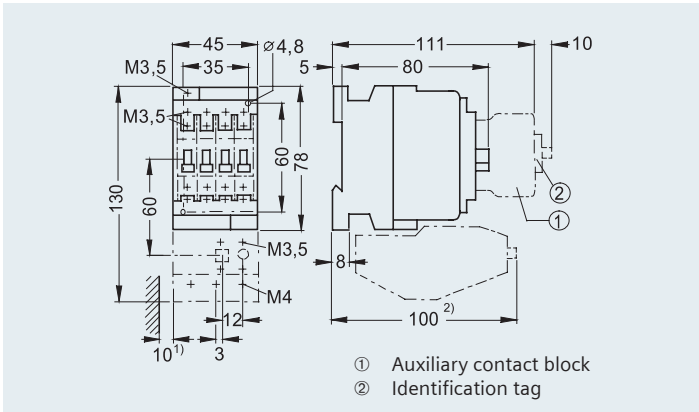


3TF30/31 DC Coil

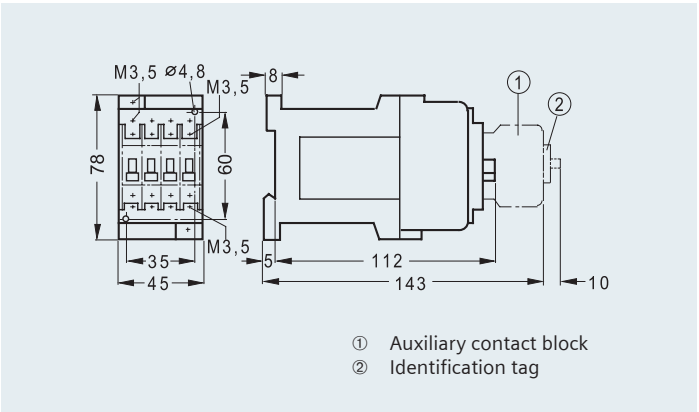


3TF32/33 AC Coil

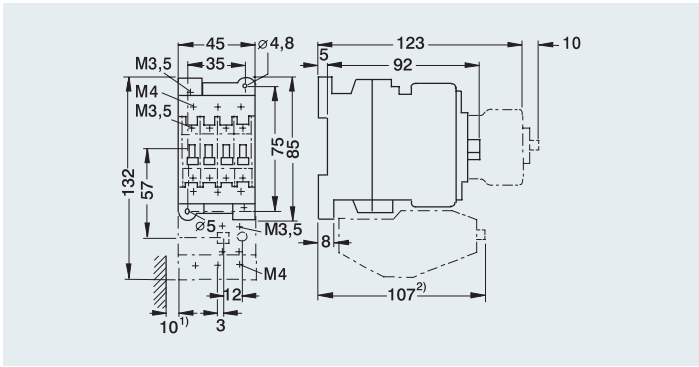


3TF32/33 DC Coil

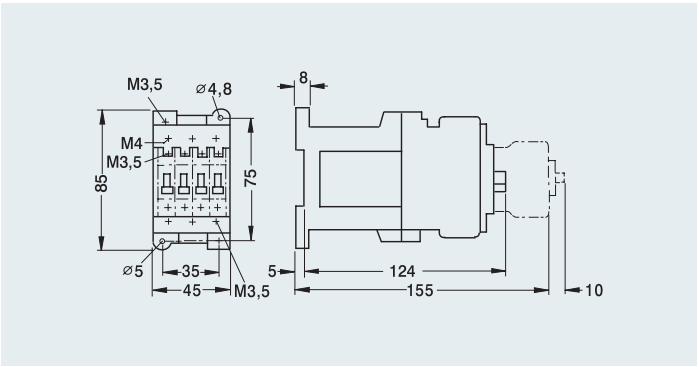


3TF34/35 AC Coil

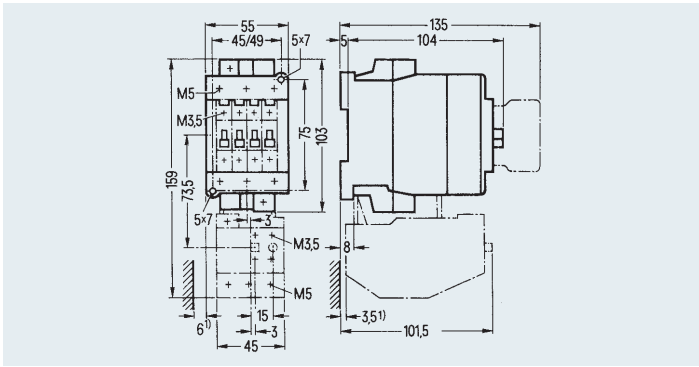

3TF34/35 DC Coil

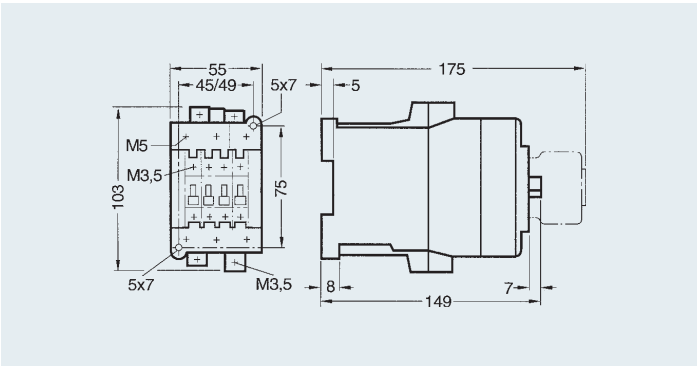


3TF30 to 3TF32, with mechanical interlock kit

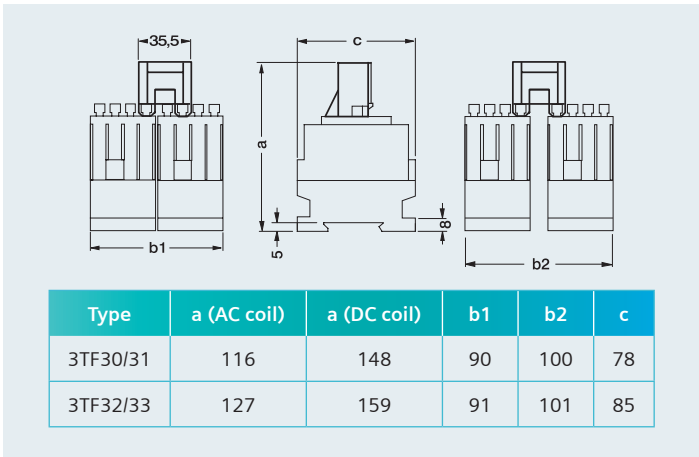


Notes

- 1) Dimensions for coil terminals
- 2) Dimensions for mounting terminals  
Minimum clearance from insulated components = 5mm  
Minimum clearance from earthed components = 10mm
- 3) size of power terminals
- 4) Size of auxiliary terminals


3TF46 and 3TF47

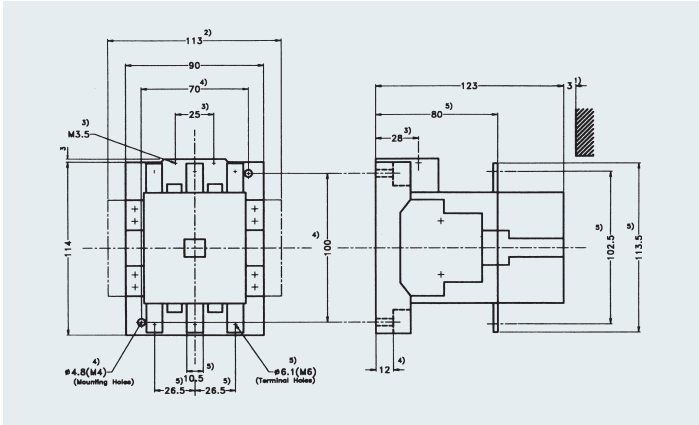


3TF47 7

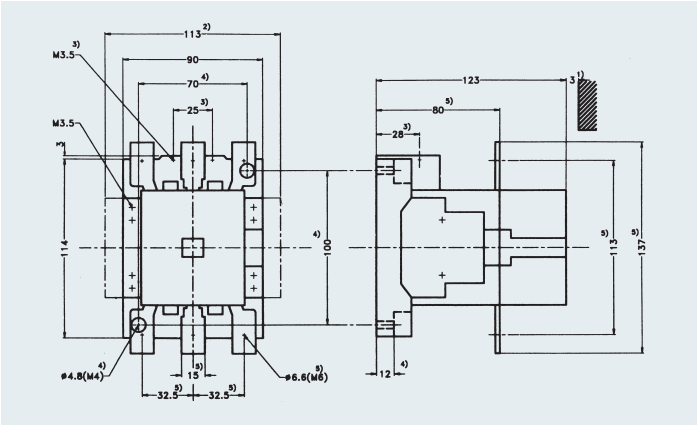


3TF48 and 3TF49

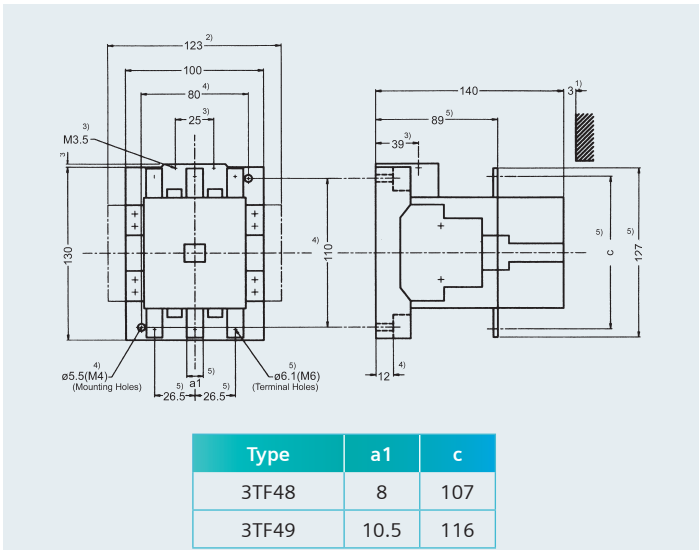


3TF50 and 3TF51

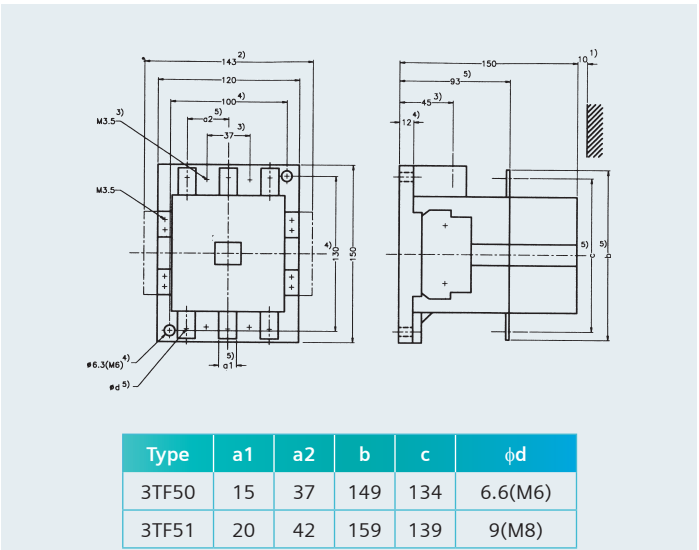

3TF52 and 3TF53

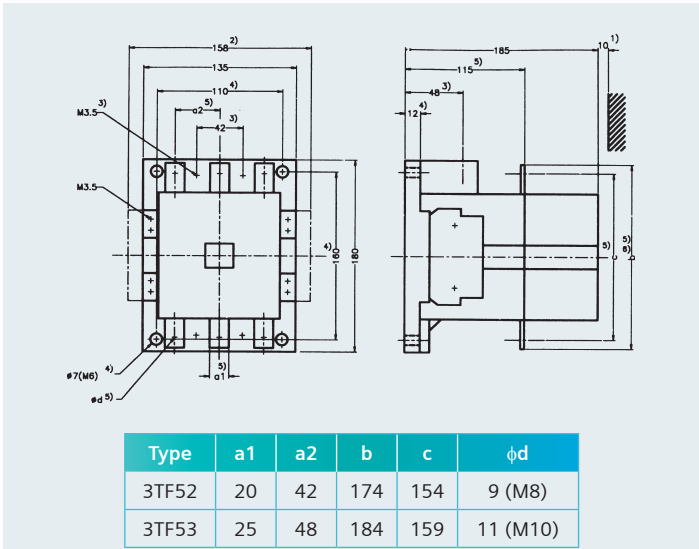


3TF54/55

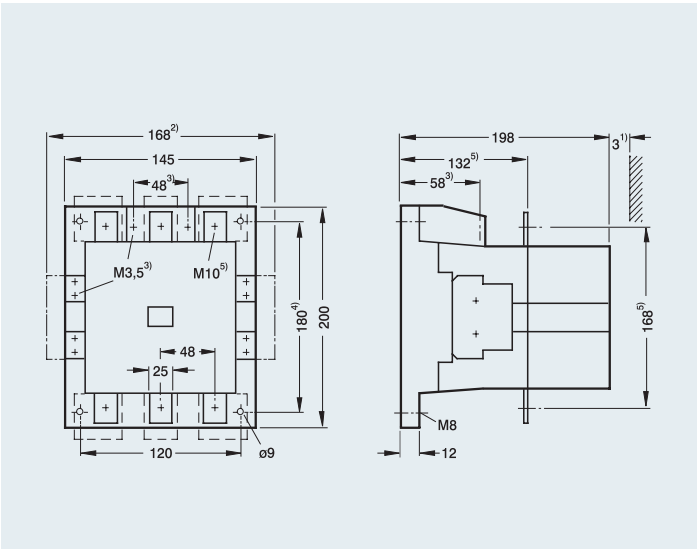

Notes


- 1) Minimum clearance from insulated components = 3mm  
Minimum clearance from earthed components = 10mm
- 2) Dimension with second auxiliary contact block on both sides
- 3) Dimension for coil terminal.
- 4) Dimension for mounting.
- 5) Dimension for power terminal.
- 6) 3TF53 The conductor bars protrude over the contactor edges on top and bottom by 2mm each.

3TF56/57

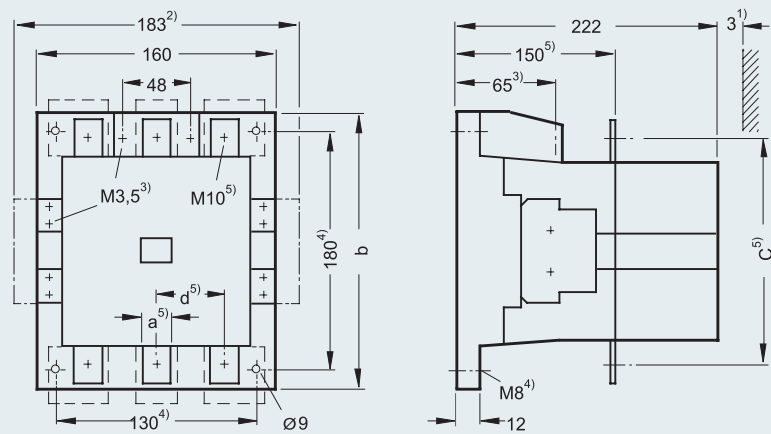


Type	a	b	c	d
3TF56	25	200	178	48
3TF57	30	209.5	182	52

3TF46/47/477/48/49  
with Mechanical Interlock Kit

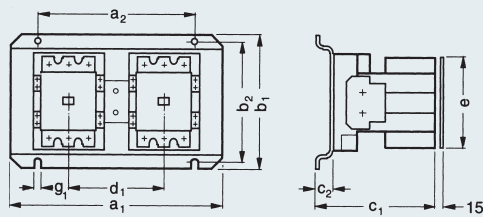


For Contactor	a <sub>1</sub>	a <sub>2</sub>	b <sub>1</sub>	b <sub>2</sub>	c <sub>1</sub>	c <sub>2</sub>	d <sub>1</sub>	e	g <sub>1</sub>
3TF46/47/477	240	180	165	145	141	18	117	150	7 (M6)
3TF48/49	260	200	175	155	158	18	127	160	7 (M6)

3TF50 to 3TF57  
with Mechanical Interlock Kit

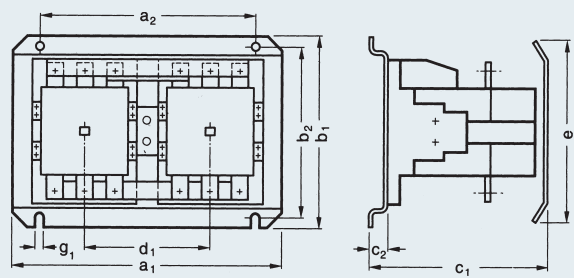

For Contactor	a <sub>1</sub>	a <sub>2</sub>	b <sub>1</sub>	b <sub>2</sub>	c <sub>1</sub>	c <sub>2</sub>	d <sub>1</sub>	e	g <sub>1</sub>
3TF50/51	300	240	210	185	160	18	147	260	9 (M8)
3TF52/53	330	270	240	215	203	18	162	315	9 (M8)
3TF54/55	350	290	265	240	219	21	172	375	11 (M10)
3TF56/57	380	310	265	240	243	21	187	385	11 (M10)

3TF50 and 3TF52 with Mechanical Interlock Kit  
3TF52 and 3TF54 with Mechanical Interlock Kit

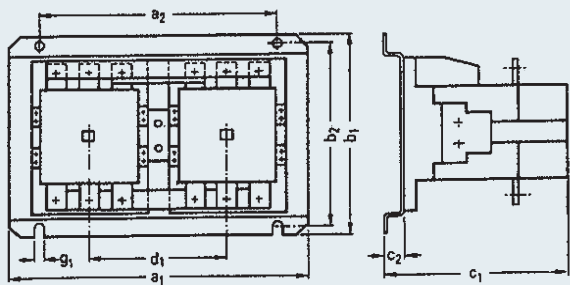

Type	a <sub>1</sub>	a <sub>2</sub>	b <sub>1</sub>	b <sub>2</sub>	c <sub>1</sub>	c <sub>2</sub>	d <sub>1</sub>	g <sub>1</sub>
3TF52 & 50	330	270	240	215	203	18	154.5	11
3TF54 & 52	350	290	265	240	219	21	167	11

Notes

- 1) Minimum clearance from insulated components = 3mm  
Minimum clearance from earthed components = 10mm
- 2) Dimension with second auxiliary contact block on both sides
- 3) Dimension for coil terminal.
- 4) Dimension for mounting.
- 5) Dimension for power terminal.



## Useful information

### Categories of duty - as per IEC 947 / IS 13947

Current	Utilisation Categories	Typical Application
AC	AC1	Non-inductive or slightly inductive loads, resistance furnaces
	AC2	Slipping motors; starting, switching off
	AC3	Squirrel-cage motors; starting, switching off motors during running <sup>(1)</sup>
	AC4	Squirrel-cage motors; starting, plugging, inching
	AC5a	Switching of electric discharge lamp controls
	AC5b	Switching of incandescent lamps
	AC6a	Switching of transformers
	AC6b	Switching of capacitor banks
	AC7a	Slightly inductive loads in household appliances and similar applications
	AC7b	Motorloads for household applications
	AC8a	Hermetic refrigerant compressor motor <sup>(2)</sup> control with manual resetting of overload releases
	AC8b	Hermetic refrigerant compressor motor <sup>(2)</sup> control with automatic resetting of overload releases
DC	DC1	Non-inductive or slightly inductive loads, resistance furnaces
	DC3	Shunt-motors: starting, plugging, inching, dynamic braking of d.c motors
	DC5	Series-motors: starting, plugging, inching, dynamic braking of d.c motors
	DC6	Switching of incandescent lamps

(1) AC3 category may be used for occasional inching (jogging) or plugging for limited time periods such as machine set-up; during such limited time periods the number of such operations should not exceed five per minute or more than ten in a 10-min period.

(2) Hermetic refrigerant compressor motor is a combination consisting of a compressor and a motor, both of which are enclosed in the same housing, with no external shaft or shaft seals, the motor operating in the refrigerant

(3) Selection of contactors for utilisation categories from AC-5a to AC-8b and DC6 upon enquiry.

## Contact life calculation:

Contactors have bounce free operation. Electrical life is influenced by the breaking currents. For normal AC3 duty the breaking current is the rated operational current and for AC4 duty, the typical breaking current is 6 times the rated operational current. In case of mixed duty, the expected life is determined as under

$$X = \frac{A}{1 + \frac{C}{100} \left( \frac{A}{B} - 1 \right)}$$

Where

X = expected life for mixed duty

A = expected life for normal AC3 duty

B = expected life for 100% AC4 duty

C = proportion of inching operations as a percentage of total operations.

## Recommended selection of contactors for hoisting duty (upto 85A)

In hoisting operation, slipping motors are generally used. For this typical hoisting duty, we recommend the contactors listed in the following table.

Contactor Type	Stator Protection Maximum load current with hoisting motor. For intermittent duty S3				Rotor Protection Maximum load current with hoisting motor (Delta circuit). For intermittent duty S3				Max rotor standstill voltage
	25%	40%	60%	100%	25%	40%	60%	100%	
	A	A	A	A	A	A	A	A	
3TF31	10	10	9	8	15	14	13	12	660
3TF33	17	16	15	13	25	24	22	20	660
3TF45	28	25	23	20	42	38	35	30	660
3TF47	49	45	40	30	73	68	60	45	750
3TF49	68	62	54	45	100	95	80	68	1000

# Contactors for Hoisting Duty

AC slipring motors are most commonly used for the hoisting applications. AC2 duty pertains to starting and switching off the slipring motors. In case of hoisting duty breaking current is the starting current and frequency of switching is high.

The table shows the making and breaking capacity at normal and at hoisting application where  $I_e$  indicates the rated full load current.

	Making	Breaking
During Normal operation at full load	$2.5 * I_e$	$I_e$
<b>Hoisting application at full load</b>	$2.5 * I_e$	$2.5 * I_e$
During Normal operation at partial load	less than $2.5 * I_e$	Less than $I_e$

## Application

AC-2 operation is the typical duty for starting and switching off fully-loaded slipring motors in the starting phase. The rating of the contactor, to switch the motors, is selected primarily on the basis of rated make & break capacity and desired electrical endurance.

## Standard

The contactors comply with the "Regulations to low voltage switchgear" of DIN VDE 0660 and IS/IEC 60947-4-1.

## Range

Hoisting duty contactors are available from 110A to 400A (AC2/AC3 rating).

## Benefits and features

### Long life

- "Hoisting Duty" Contactors are provided with new design of contacts ( $AgSnO_2$  instead of  $AgCdO$ ) resulting in **high electrical and mechanical life**.
- They are electrically superior in taking care of excessive stresses coming on contactors during their operations in crane applications.

### Reliability

- The "Hoisting Duty" Contactors have vacuum impregnated coils which are suitable for high frequency switching and high vibrations. This helps in reducing coil failures.
- Side mounted auxiliary contact blocks are screw mounted and not snap fitted to withstand vibrations and high frequency operation.



### Operator safety

- Arc Chamber Interlock**  
It prevents the contactor from switching ON, if the arc chamber is not fitted properly. Thus avoids accidents to plant and personnel.
- Finger touch proof terminals**  
It protects against accidental contact with live parts which ensures operator safety.

### High performance

- No deration upto 55°C**  
Contactors are suitable for operation in service temperature upto 55°C without derating. This avoids selection of higher rated contactor, thereby reducing cost.

## Selection and ordering data

**Hoisting duty contactors –**  
**For high switching frequency / inching applications with AC coils, 2NO+2NC aux. contacts**

Contactor size	Rated current $I_e$ (A) AC2/AC3 at 415V	Type	Std. pkg. (nos.)
6	110	3TF50 00-0A..	1
8	170	3TF52 00-0A..	
10	250	3TF54 00-0A..	
12	400	3TF56 00-0A..	

### Coil voltages:

Coil voltage - 50Hz	110V	230V	415V
Code	F0	P0	R0

(Other coil voltages are also available)

## Technical Information

### A. Recommended selection of contactors for hoisting duty

In hoisting operation, slipring motors are generally used. For this typical hoisting duty, we recommend the contactors listed in the following table.

Contactor Type	Stator Protection Maximum load current with hoisting motor. For intermittent duty S3				Rotor Protection Maximum load current with hoisting motor (Delta circuit). For intermittent duty S3				Max rotor standstill voltage
	25%	40%	60%	100%	25%	40%	60%	100%	
3TF50 00 0A	100	88	78	65	150	130	115	95	1000
3TF52 00 0A	145	130	115	95	220	195	170	150	1000
3TF54 00 0A	225	200	180	160	340	300	270	240	1000
3TF56 00 0A	355	325	290	250	530	490	435	375	1000

When 3 conducting paths are connected in parallel, the maximum load current rises to 2.5 times the value given in this table. When 2 conducting paths are connected in parallel, it rises to 1.8 times the value given in this table.

### B. Selection of contactors for contact endurance: with normal and inching operation

Contactors suffer more erosion during inching operation than when stopping motors from a steady speed, i.e. normal operation. With slipring motors the starting current can be up to 2.5 times the rated current of the motor which means that this current has to be broken when inching is taking place. During normal operation, on the other hand, only the rated current has to be broken under full-load; under part-load it is even less. Determining contact endurance from AC-2 duty ( $I_c = 2.5 \times I_e$ ) will only give correct results when 100% inching operation is involved.

Max. permissible current and attainable contact endurance when braking starting current given below $PF \geq 0.4$ ( $2.5 \times I_e$ )		Contact life when breaking the stator contactor load currents for S3-100% duty, $I_c = I_e$ , no inching		Contactor Type
A	Operating cycles Approx.	A	Approx. Operating cycles	
275	280,000	65	3,500,000	3TF5000
425	250,000	95	3,100,000	3TF5200
625	250,000	160	2,700,000	3TF5400
1000	150,000	250	2,500,000	3TF5600

The maximum permitted current (e.g. locked-rotor current of motor) must not exceed the values given in the "Max. starting current and attainable contact endurance" column. The values cannot be increased by paralleling pole assemblies.

### C. Selection of contactors for contact endurance: with mixed operation

When mixed operation is involved, i.e. primarily breaking of the motor rated current but with some breaking of higher currents due to inching, the endurance of the contacts can be calculated approximately from the following equation:

$$X = \frac{A}{1 + \frac{C}{100} \left( \frac{A}{B} - 1 \right)}$$

Where

X = Contact endurance with mixed operation cycles.

A = Contact endurance with normal operation ( $I_a = I_e$ ) in operating cycles, from Fig. 1.

B = Contact endurance with inching operation ( $I_a = \text{Multiple of } I_e$ ) in operating cycles, from Fig. 2, Breaking current  $I_a/AC-2 = 2.5 \times I_e$ .

C = Proportion of inching in total operating Cycles in %.

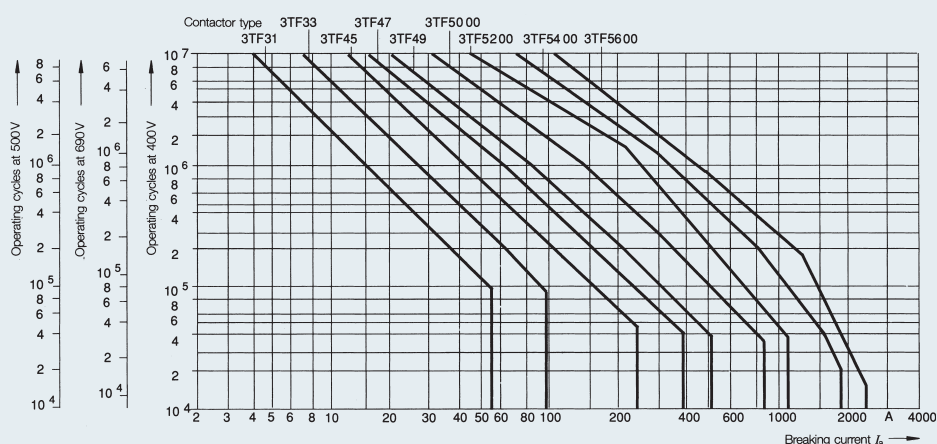


Fig. 1 Contact endurance of 3TF contactors as a function of breaking current when switching resistive and inductive AC loads.

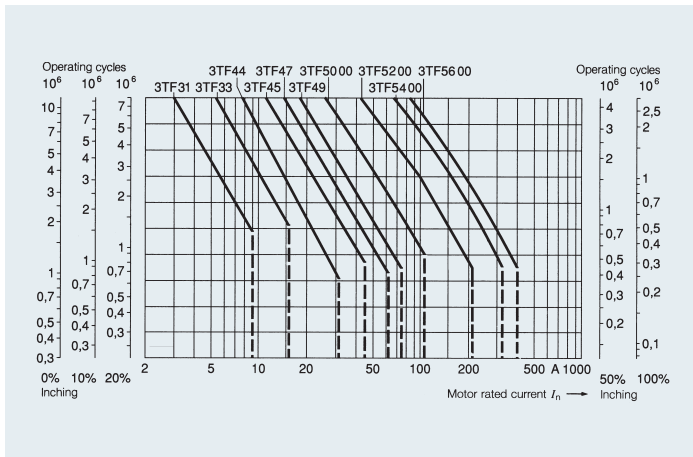


Fig. 2 Contact endurance for mixed operation as a function of motor rated current. Motor on rated load, inching at 2.5 times motor rated current (slipping motor).

The contact endurance as a function of the motor rated current with mixed operation can be determined from Fig. 2 for proportions of inching of 0, 10, 20, 50 and 100%. The values obtained are only applicable if rated motor load is used continuously. In practice therefore, the contact endurance should be greater.

#### D. NOMOGRAM

Apart from knowing the figure for **contact endurance in operating cycles**, users are also interested to know what **period of time** this amounts to before the contacts have to be changed. The value can be ascertained from the nomogram in Fig. 3. **using the Nomogram**

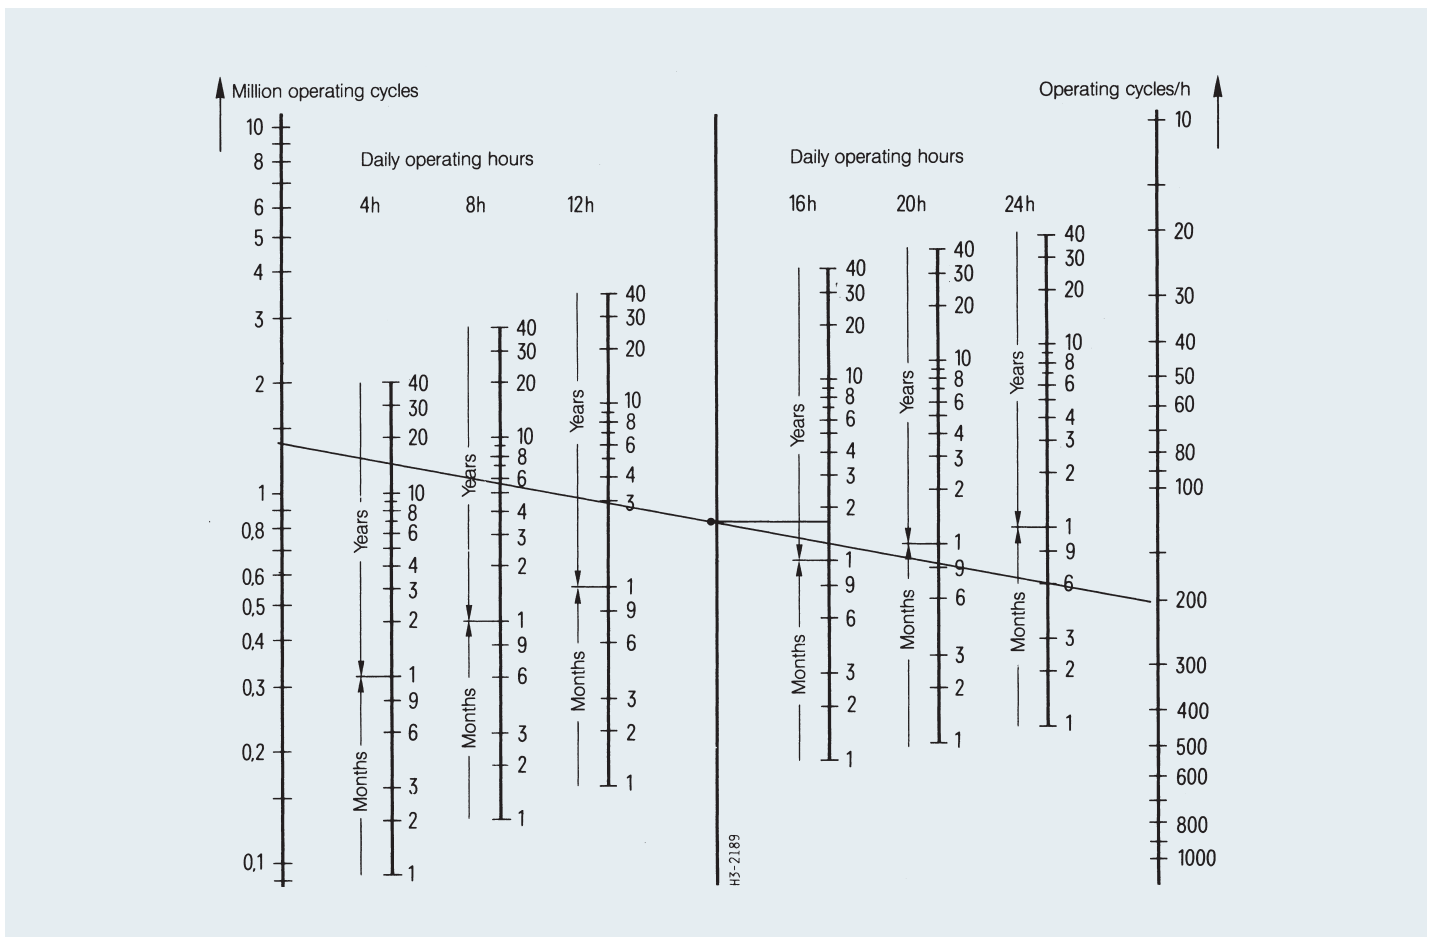


Fig. 3 Nomogram for determining contact endurance in year (250 working days) and months with daily operating hours of 4, 8, 12, 16, 20 and 24 h.

#### Example 1

Motor rated current 150A. Selected contactor: **3TF5600**

Contact endurance in operating cycles at 400V with inching of				
0%	10%	20%	50%	100%
5.4 x 10 <sup>6</sup>	4.6 x 10 <sup>6</sup>	3.9 x 10 <sup>6</sup>	2.3 x 10 <sup>6</sup>	1.4 x 10 <sup>6</sup>

#### Example 2

Maximum permitted motor rated current for a contact endurance of 2,000,000 operating cycles at 400V.

Stator contactor	Permitted rated current of slipping motor with inching			
Type	10% approx. A	20% approx. A	50% approx. A	100% approx. A
3TF50 00	75	68	48	33
3TF52 00	110	95	66	48
3TF54 00	175	160	125	80
3TF56 00	240	230	160	120

Draw a line from the point on the left-hand scale indicating the required number of operating cycles to the point on the right hand scale indicating the required number of operating cycles per hour. Then, from the point where this line intersects with the centre axis, draw a horizontal line to the left or right scale for the actual number of daily operating hours.

Note: If a figure of 365 days per annum is being employed instead of 250, the total operating time obtained from the nomogram must be multiplied by 0.68.

**Example:**

Service requirements: 1.4 million operating cycles endurance, 200 operating cycles per hour, 16 hours service per day.

**Result:**

Total operating time approx =18 months.

**Accessories and ordering data:**

**AC Coils:**

Spare coils for	Type <sup>1)</sup>	Std. pkg. (nos.)
3TF50 00 0A..	3TY7 503-0A ..0-0H	1
3TF52 00 0A..	3TY7 523-0A ..0-0H	
3TF54 00 0A..	3TY7 543-0A ..0-0H	
3TF56 00 0A..	3TY7 563-0A ..0-0H	

<sup>1)</sup> **Coil voltage code AC 50Hz:**


Coil voltage	110	230	415
Code	F0	P0	R0

(Other coil voltages are also available)

**Spares and ordering data**

**Contact kits:**

Spare contact kit for	Type	Std. pkg. (nos.)
3TF50 00 0A..	3TY7 500-0ZA	1
3TF52 00 0A..	3TY7 520-0ZA	
3TF54 00 0A..	3TY7 540-0ZA	
3TF56 00 0A..	3TY7 560-0ZA	

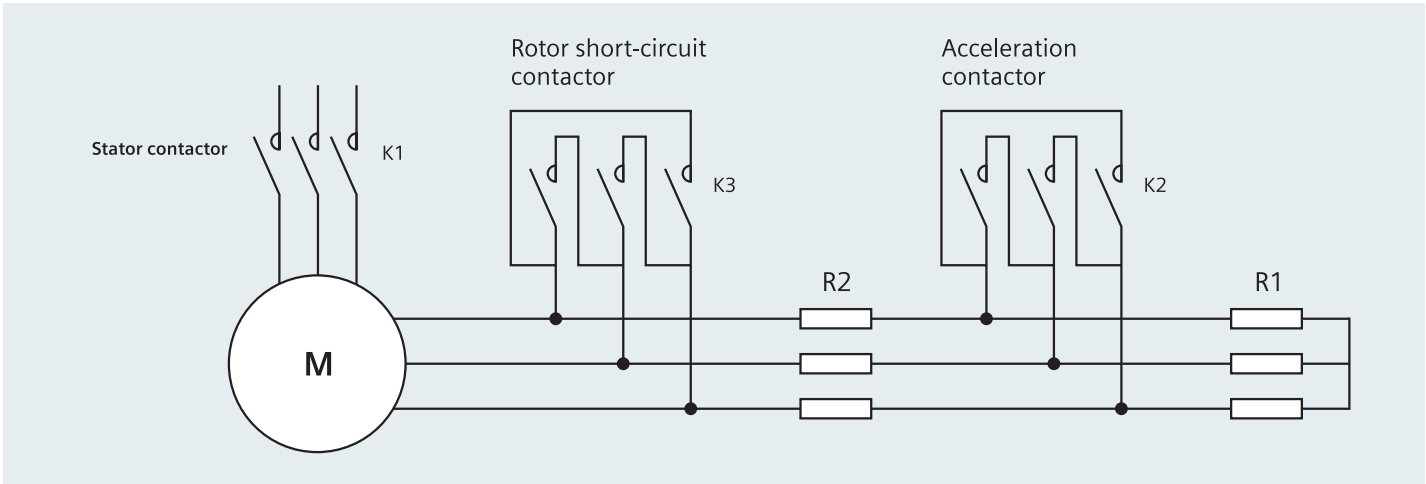

**Dimensional drawing**

The “Hoisting Duty” Contactors are mechanically similar to our existing 3TF power contactors. Therefore they have exactly same dimensions as the corresponding 3TF power contactors.

Please refer page nos. 21 and 22.

**Useful technical information**

**Starting method of Slip ring motor (AC2 duty):**

**Three types of the contactors are used to control the three phase slip-ring motors: the stator contactor, the acceleration contactor and the rotor short circuit contactor.**

**Stator contactor**

Initially the stator contactor (K1) is closed to energize the motor. None of the rotor contactor (K2 or K3) is closed yet. Hence all the resistances are present in the rotor circuit. The starting current can reach to 1.5 to 4 times of the rated operational current. The AC2 rating of the stator contactor is selected as per the load factor of the motor.

**Load factor =  $\frac{\text{on time} \times 100}{\text{Cycle time (on time + rest time)}}$**

**Acceleration contactor**

Now acceleration contactor (K2) is closed which short circuits the resistances (R1). The sizing of this contactor (K2) is as per AC1 rated operational current. The current flow time per cycle and the number of cycles per hour has to be considered for the selection.

**Rotor short circuit contactor**

At the end, the rotor short circuit contactor (K3) closes, short circuiting the last resistance bank (R2) thus remove all the resistances from the rotor circuit. The starting period is hence completed. The duty of this contactors is characterized by the small closing stress. the decisive factor is the thermal stress. The duty factor is considered while finding out the permissible values of the rated operational rotor current for rotor contactors.

Picture below shows the acceleration (K2) and the rotor short circuiting contactor (K3) in the delta connection. If they are connected in star then the ratings are reduced by 35%.



# Bimetal Overload Relays 3UA and 3UC

The 3UA / 3UC thermal overload relays are suitable for customers from all industries, who want guaranteed optimum inverse time delayed protection of their electrical loads. The relays meet the requirements of IS/IEC 60947-4-1.

## Application

**3UA overload relay:** 3UA5/6 are 3 pole adjustable bi-metal overload relays mainly suitable for normal starting applications. They provide accurate and reliable protection to motors against overload as per CLASS 10A. They also offer protection against single phasing and unbalanced voltages.

**3UC overload relay:** 3UC5/6 are 3 pole adjustable, saturable CT operated bi-metal overload relays mainly suitable for heavy starting applications (i.e. when heavy masses are to be put in motion resulting in larger starting period). They provide accurate and reliable protection to motors against overload as per CLASS 30. They also offer protection against single phasing and unbalanced voltages.

If single-phase AC or DC loads are to be protected by the 3UA / 3UC thermal overload relays, all three bimetal strips must be heated. For this purpose, all main current paths of the relay must be connected in series.

## Standards

Bimetal relays conform to IS/IEC 60947-4-1. They also carry the CE mark.

## Range


**3UA5:** 0.1 to 120A, (Class 10A, without CT)

**3UA6:** 85 to 630A, (Class 10A, CT operated)

**3UC5/6:** 2.4 to 400A (Class 30, CT operated)

## Relay overview

Overload relay operates on the bi-metallic principle. The heater winding wound on the bimetal strips carry the current flowing through the motor. In case of overload, the current carried through the heater winding is more than the rated current. This heats up the bimetals. Due to this bi-metal strips bend and open the NC contact of the relay, which is connected in the control circuit of the contactor, thus disconnects the motor from the supply. The tripping time is inversely proportional to the current flowing through the bi-metal strips. Bi-relays are therefore, referred to as "current dependent" and inverse-time delayed relays.

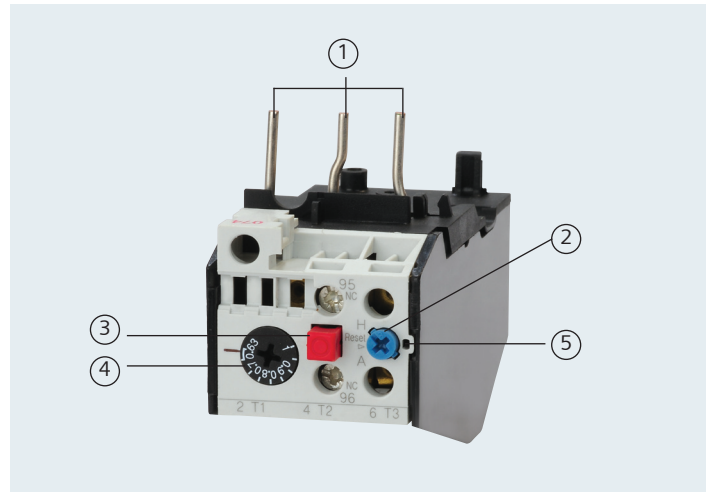

### 1. Connection for mounting onto contactors:

Optimally adapted in electrical, mechanical and design terms to the contactors, these connecting pins can be used for direct mounting of the overload relays. Stand-alone installation is possible as an alternative (in some cases in conjunction with a stand-alone installation module).

### 2. Selector switch for manual/automatic RESET (blue):

With this switch you can choose between manual and automatic RESET. A device set to manual RESET can be reset locally by pressing the RESET button. A remote RESET is possible using the RESET modules (accessories), which are independent of size.

### 3. TEST button (red):

Trip circuit can be manually checked by using this button. During this simulation the NC contact (95-96) is opened and the NO contact (97-98) is closed. This tests whether the auxiliary circuit has been correctly connected to the overload relay. The relay must be reset with the RESET button if it has been set to manual RESET. If the thermal overload relay has been set to automatic RESET, then the overload relay is automatically reset when the TEST button is released.

### 4. Motor current setting dial:

Setting the device to the rated motor current is easy with the large rotary knob. (Recessed dial, hence no possibility of accidentally change in current setting.)

### 5. Trip indicator (Green):

A separate mechanical Green Trip Indicator is provided on the front cover of the relay to indicate the tripped state of the 'manual reset' relay.


## Recovery time

After tripping due to overload, the thermal overload relays require some time until the bimetal strips have cooled down. The device can only be reset after the bimetal strips have cooled down. This time (recovery time) depends on the tripping characteristics and strength of the tripping current. The recovery time allows the load to cool down after tripping due to overload.

## Benefits and features

### High performance


- **In-built single phasing protection**

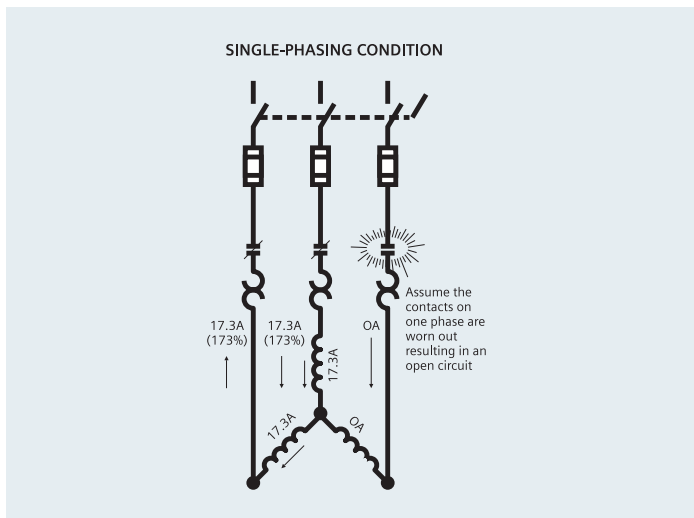

In case of phase loss the current through the other two windings increases by 1.732 times the rated current of the motor. The current now flows only through the 2 bimetallic strips which should produce the required force on the tripping mechanism. This needs higher currents for longer time. As current is not too high so the relay might take higher time to trip. This can cause damage to the motor. Similar condition happens in case of phase unbalance. To take care of these conditions our relays are constructed such that they offer a built-in single phasing protection using differential slider principle.

- **Temperature compensation**

The temperature compensation feature reduces the effect of the ambient temperature on the tripping behavior. This ensures the minimum tripping current lies within the

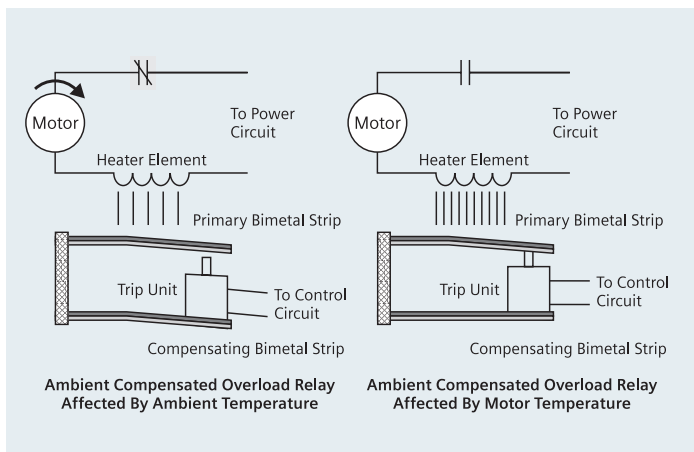

specified range for -25 to 55° C. For this purpose the relays are temperature compensated between service temperatures of -25° C to +55° C.

### User friendliness and safety

- **SIGUT termination Technique**

- **Shrouded auxiliary terminals**

Increases safety, as they protect against accidental contact with live parts.

- **Funnel shaped cable entries**

Reduce wiring time by facilitating quick location of the connecting wire.

- **Cable end-stop**

They decide the insertion depth of the connective wire. As the wire cannot now protrude into the relay housing, it does not hamper the movement of the auxiliary contacts. Since the insertion depth is predetermined, insulation of the cable can be cut accordingly and the possibility of insulation getting inadvertently caught under the terminal, is avoided.

- **Captive Screws**

This feature prevents the screws from falling down thereby facilitates the wiring. Hence, the relays are delivered with untightened terminals. This eliminates the operation of untightening terminals before wiring.

- **Lug less termination**

This feature helps in reducing the termination time.

- **Screw-driver guides** reduce wiring time as they allow the use of power screw-drivers.

### Flexibility

- **Potential free Auxiliary Contacts**

Potential free 1NO + 1NC contact arrangement is provided as a standard feature. The 1NC contact is used in the control circuit of the contactor for disconnecting the motor in case of overload, whereas the 1NO contact can be used for various applications such as indication.

- **Mounting**


**3UA5:** suitable for direct mounting or independent mounting (with the help of independent mounting accessory)

**3UA6 and 3UC5/6:** suitable for Independent mounting.

## Selection and ordering data:

Setting range (A)	Type reference	Backup HRC fuse 3NA A (max)	Mounting	Std. pkg. (nos.)						
Normal Motor Starting time										
3UA50										
0.1 - 0.16 0.16 - 0.25 0.25 - 0.4	3UA50 00-0A 3UA50 00-0C 3UA50 00-0E	2 2 2	With Contactor 3TF30/31	1						
0.4 - 0.63 0.63 - 1 0.8 - 1.25	3UA50 00-0G 3UA50 00-0J 3UA50 00-0K	2 2 4								
1 - 1.60 1.25 - 2 1.6 - 2.5 2 - 3.2	3UA50 00-1A 3UA50 00-1B 3UA50 00-1C 3UA50 00-1D	6 6 6 10								
2.5 - 4 3.2 - 5 4 - 6.3	3UA50 00-1E 3UA50 00-1F 3UA50 00-1G	10 16 16								
5 - 8 6.3 - 10 8 - 12.5 10 - 14.5	3UA50 00-1H 3UA50 00-1J 3UA50 00-1K 3UA50 00-2S	20 25 25 25								
3UA52										
1 - 1.6 1.25 - 2 1.6 - 2.5	3UA52 00-1A 3UA52 00-1B 3UA52 00-1C	6 6 6			With Contactor 3TF32/33	1				
2 - 3.2 2.5 - 4 3.2 - 5	3UA52 00-1D 3UA52 00-1E 3UA52 00-1F	10 10 16								
4 - 6.3 5 - 8 6.3 - 10	3UA52 00-1G 3UA52 00-1H 3UA52 00-1J	16 20 25								
8 - 12.5 10 - 16 12.5 - 20 16 - 25	3UA52 00-1K 3UA52 00-2A 3UA52 00-2B 3UA52 00-2C	25 32 50 50								
3UA55										
10 - 16 12.5 - 20 16 - 25	3UA55 00-2A 3UA55 00-2B 3UA55 00-2C	32 50 50					With Contactor 3TF34/35	1		
20 - 32 25 - 36 32 - 40 36 - 45	3UA55 00-2D 3UA55 00-2Q 3UA55 00-2R 3UA55 00-8M	80 80 80 80								
3UA58										
16 - 25 20 - 32 25 - 40 32 - 50 40 - 57 50 - 63 57 - 70 63 - 80 70 - 95	3UA58 00-2CZ1 3UA58 00-2DZ1 3UA58 00-2EZ1 3UA58 00-2FZ1 3UA58 00-2TZ1 3UA58 00-2PZ1 3UA58 00-2VZ1 3UA58 00-2UZ1 3UA58 00-8YZ1	50 63 80 100 100 125 125 160 160							With Contactor 3TF46 3TF47 3TF48 3TF49	1
16 - 25 20 - 32 25 - 40 32 - 50 40 - 57 50 - 63 57 - 70 63 - 80	3UA58 00-2CZ2 3UA58 00-2DZ2 3UA58 00-2EZ2 3UA58 00-2FZ2 3UA58 00-2TZ2 3UA58 00-2PZ2 3UA58 00-2VZ2 3UA58 00-2UZ2	50 63 80 100 100 125 125 160							With Contactor 3TF47 7	

Setting range (A)	Type reference	Backup HRC fuse 3NA A (max)	Mounting	Std. pkg. (nos.)
3UA58 30				
70 - 95 85 - 105 95 - 120	3UA58 30-5B 3UA58 30-5C 3UA58 30-5D	160 160 200	With Contactor 3TF50	1
3UA62 30				
85 - 135 115 - 180 160 - 250 200 - 320 250 - 400	3UA62 30-5A 3UA62 30-5B 3UA62 30-5C 3UA62 30-5D 3UA62 30-5E	224 250 400 400 500	Independent	1
3UA68 30				
320 - 500 400 - 630	3UA68 30-5F 3UA68 30-5G	500 630	Independent	1
Long Motor Starting time (Heavy duty)				
3UC50 30				
2.5 - 4 4 - 6.3 6.3 - 10 8 - 12.5	3UC50 30-5E 3UC50 30-5G 3UC50 30-5J 3UC50 30-5K	16 25 25 32	Independent	1
3UC58 30				
10 - 16 16 - 25 25 - 40 40 - 63	3UC58 30-5A 3UC58 30-5C 3UC58 30-5E 3UC58 30-5G	32 63 100 125	Independent	1
3UC62 30				
63 - 100 100 - 160	3UC62 30-5J 3UC62 30-5A	250 315	Independent	1
3UC66 30				
125 - 200 160 - 250 250 - 400	3UC66 30-5B 3UC66 30-5C 3UC66 30-5E	500 630 630	Independent	1

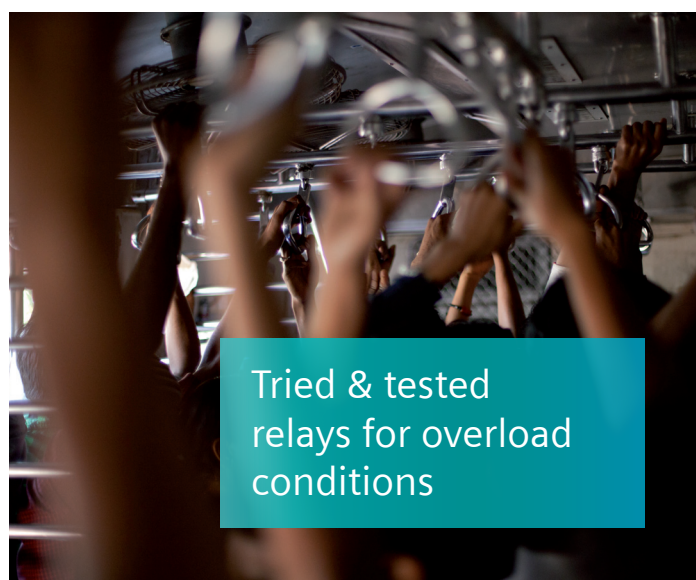

## Technical Data





Type		3UA50	3UA52	3UA55	3UA58	3UA5830	3UA6230	3UA6830	3UC5030	3UC5830	3UC6230	3UC6630
Trip class		10A							30			
Phase failure protection		✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
Changeover to auto-reset at site		✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
RESET button (trip-free) <b>Blue</b>		✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
Ambient temperature compensation		✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
Trip indicator <b>Green</b>		✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
TEST button <b>Red</b>		✓	✓	✓	✓	✓	✓	✓	✓	✓	✓	✓
Terminal for contactor coil		✓	✓	✓	X	X	X	X	X	X	X	X
Permissible service temperature		-25°C to +55°C										
Mounting		Contactor/ 3TF30/31	Contactor/ 3TF32/33	Contactor/ 3TF34/35	Contactor/ 3TF46 to 49	Contactor/ 3TF50	Independent					
Main Circuit												
Rated current (Max)	A	14.5	25	45	95	120	400	630	12.5	63	160	400
Rated insulation voltage <i>Ui</i> (Pollution degree 3)	V	690	690	690	1000	1000	1000	1000	1000	1000	1000	1000
Rated impulse withstand <i>Uimp</i>	kV	6	6	6	8	8	8	8	8	8	8	8
Heating		Direct	Direct	Direct	Direct	Direct	Indirect	Indirect	Indirect	Indirect	Indirect	Indirect
Conductor cross-section												
Solid or stranded	sqmm	2.5 to 6	2.5 to 6	1.5 to 25	2.5 to 35	35 to 70	50 to 120/ 240*	2 x 240	1 to 4	–	–	–
Finely stranded with end sleeve	sqmm	1.5 to 4	1.5 to 4	1 to 16	1.5 to 25	–	–	–	1 to 2.5	35	120	240
Multi-conductors with cable lugs	sqmm	–	–	–	–	–	50 to 120/ 240*	2 x 240	–	–	–	–
Flats	sqmm	–	–	–	–	–	1 x 20 x 3	2 x 30 x 5	–	1 x 15 x 3	1 x 20 x 5	2 x 30 x 5 2 x 3- x 5*
Terminal screw		M4	M4	M5	M5	M8	M10	M10	M4	M6	M8	M10
Power loss per pole (max)												
Minimum setting	W(VA)	0.9	0.9	1.2	2.6	2.8	5	6(9)	2.5	2.5	3.5	5.5
Maximum setting	W(VA)	2.25	2.25	3	4	4	7	15(22)	6.5	6.5	9	14
Auxiliary Circuit (application for all types)												
Auxiliary contacts		1NO + 1NC (Potential free)										
Rated thermal current Ith	A	6										
Short circuit protection (max)	A	6 (HRC Fuse type 3NA7)										
Switching capacity	AC15	V	24	60	125	230	415	500				
	A	2	1.5	1.25	1.15	1	1					
	DC13	V	24	60	110	220						
	A	1	0.4	0.22	0.1							
Conductor cross-section												
Solid or stranded	sqmm	2 x (1 to 2.5)										
Finely started with end sleeve	sqmm	2 x (0.75 to 1.5)										
Terminal screw		M3.5										
Length of insulation removal	mm	10										

\* For relay above 180 A

Characteristic Curves

Tripping characteristics

The current/time curves show the relationship between the tripping time from cold state and multiples of the set current  $I_e$ . When the relay is at operating temperature and carrying 100 %  $I_e$ , the tripping times are reduced to approximately 25 %. Tripping curve is applicable to 3-pole loads and 2-pole loads. For single-pole loads, the tripping curves lie between curves of 3-pole loads and 2-pole loads.

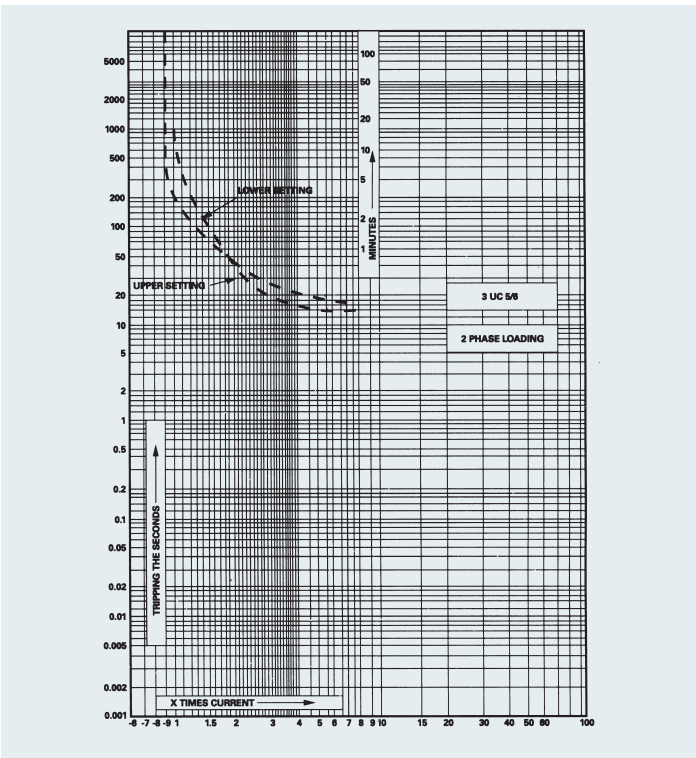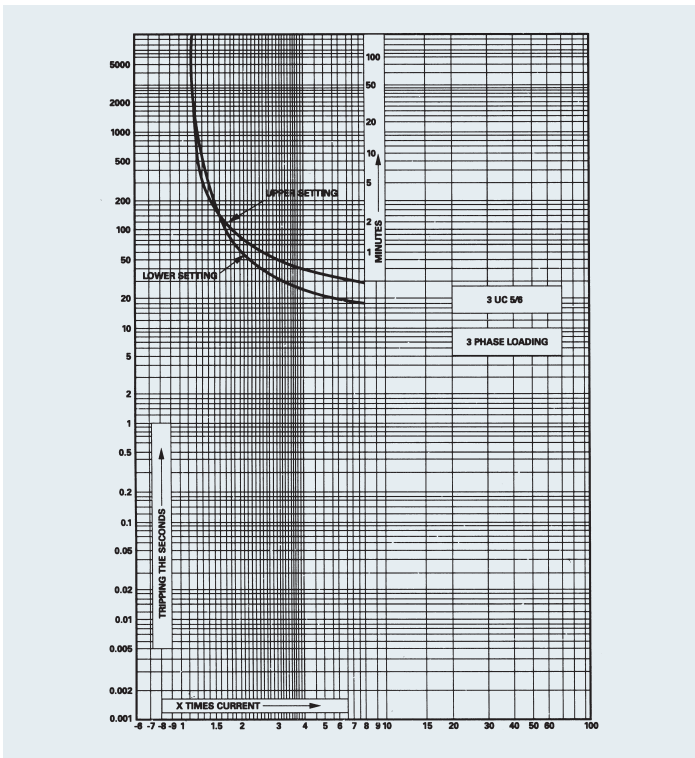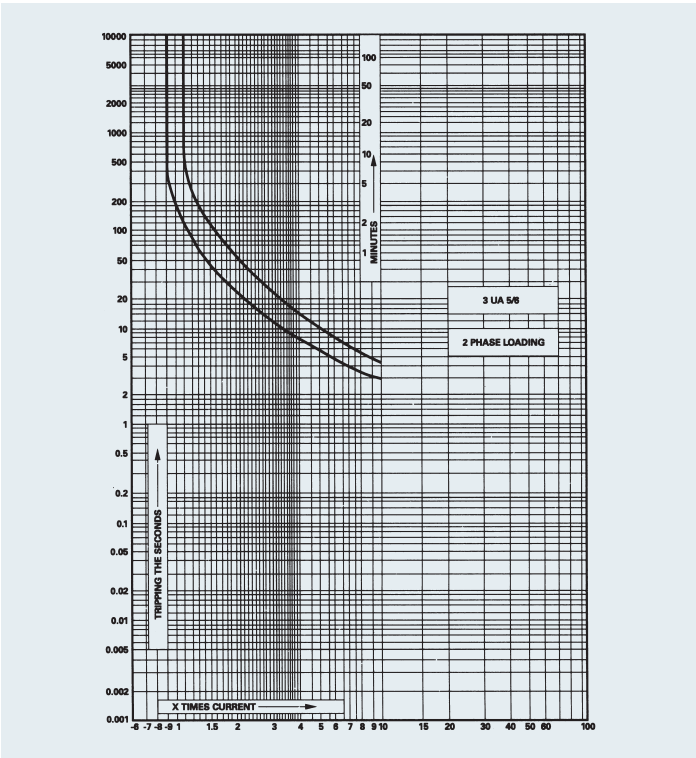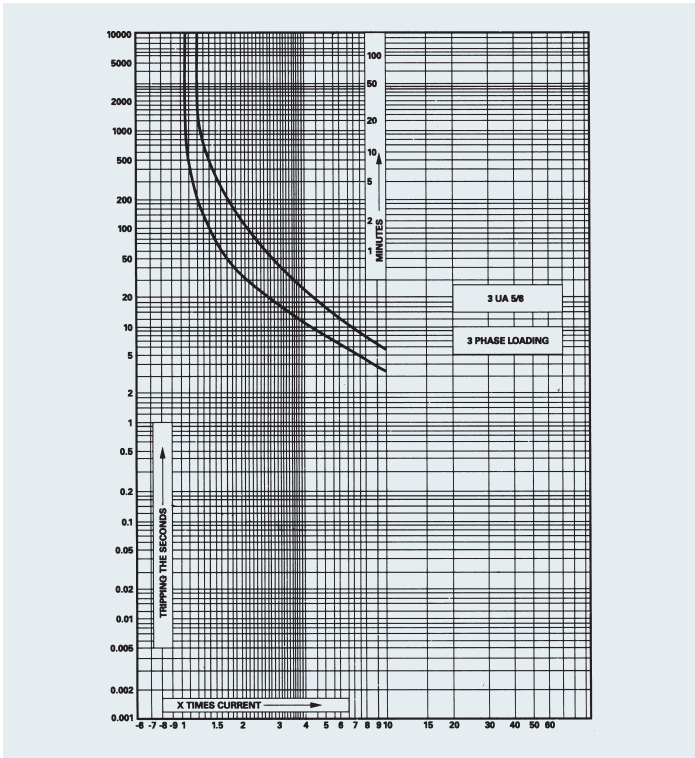

The above curves are the general characteristics curves; for individual characteristics curves of each rating, please contact our nearest sales office.



Accessories and ordering data

- 1. **Adaptor:** To convert contactor mounting relay to independent mounting, (Fig. 1) suitable for screw type mounting and 35 mm DIN rail mounting.
- 2. **Protective cover\*:** To avoid tampering of the setting, auto manual mode or test button. (Fig. 2)
- 3. **Reset cord\*:** To reset the relay in switchboard with door closed. (Length: 600 mm) (Fig. 3)
- 4. **Reset plunger with funnel\*:** Instead of reset cord for resetting the relay in switchboard with door closed. (Fig. 4)



Fig. 1: Adaptor

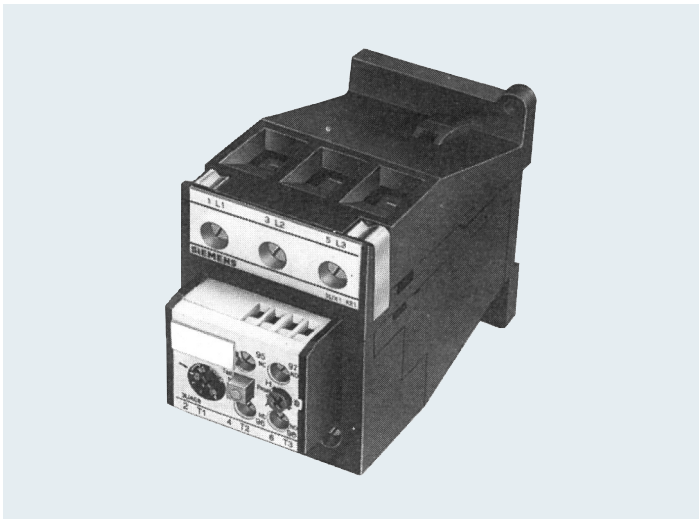


Fig. 1: Relay with adaptor for independent mounting

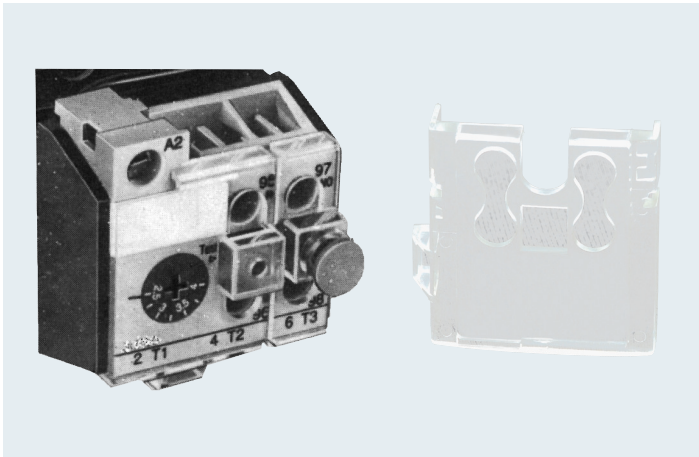


Fig. 2: Protective cover



Fig. 3: Reset cord with holder

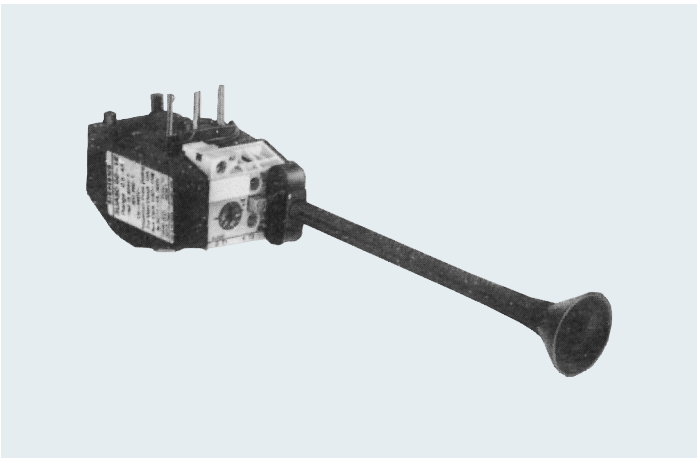



Fig. 4: Reset plunger + Funnel

Description	Type reference	Relay type	Std. pkg. (nos.)
Reset Plunger	3UX1 011	3UA5/6, 3UC5/6	10
Funnel	3UX1 013		
Reset cord with Holder (600mm)	3UX1 016	3UA5/6, 3UC5/6	5
Protection Cover	3UX1 111 - 1YA 3UX1 110 - 1YA	3UA5/6 3UA58/5830	10
Adaptor to convert to independent mounting	3UX1 418 3UX1 420 3UX1 425 3UX1 421 3UX1 421 - OXA	3UA50 3UA52 3UA55 3UA58 3UA5830	1
Set of terminals to convert relay type	3UX58 11	3UA5800-2 or to 3UA5800-2 Z2 to 3UA5800-2 Z1	10
	3UX58 12	3UA5800-2 Z1 or 3UA5800-2 Z2 to 3UA5800-2	
	3UX58 13	3UA5800-2 or 3UA5800-2 Z1 to 3UA5800-2 Z2	


\* Only one accessory at the time

Dimensional Drawing


3UA50 with independent Mounting Adapter Type 3UX1 418

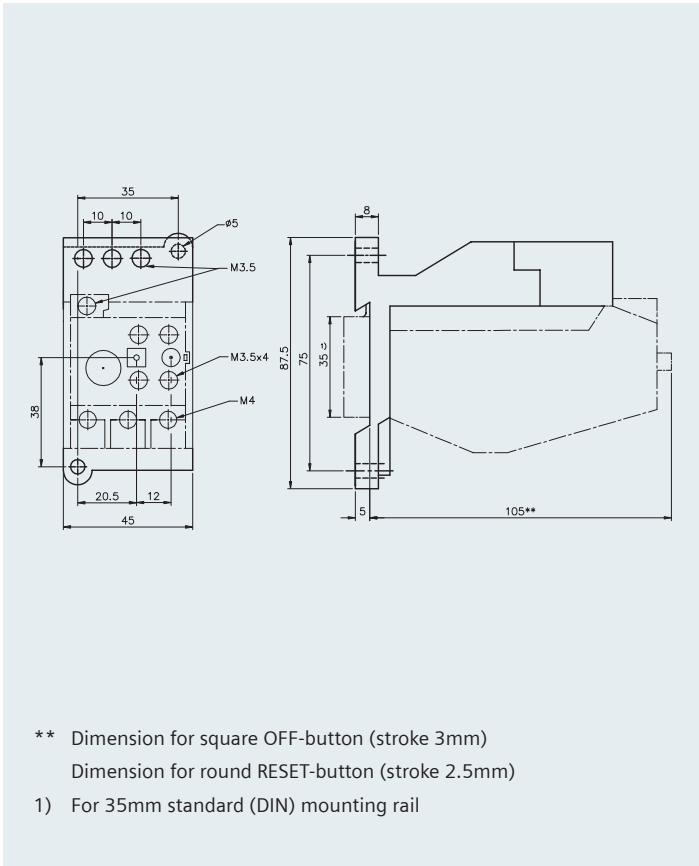


3UA52/55 with independent mounting

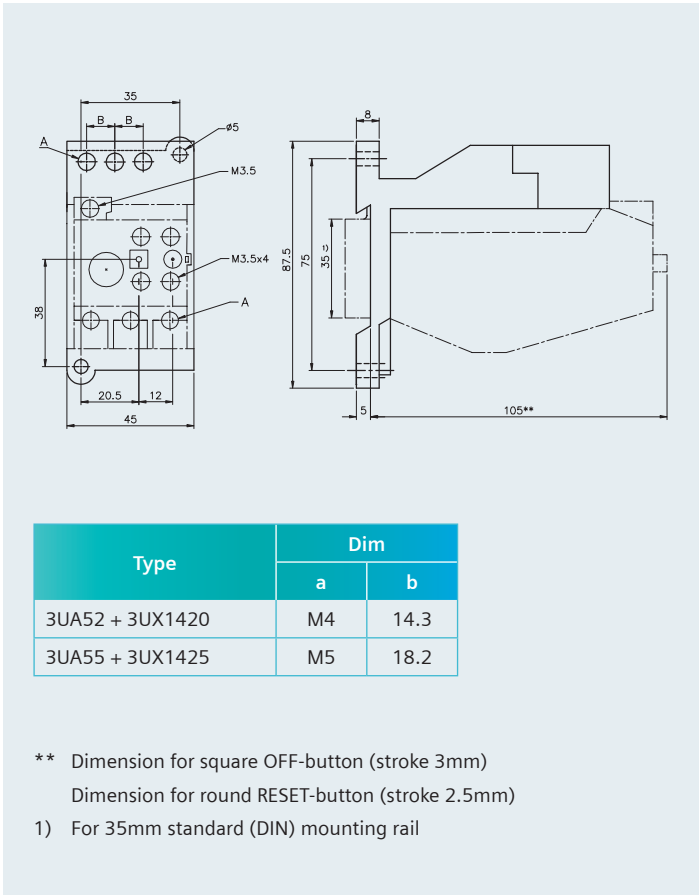



3UA50 mounted on 3TF30/31

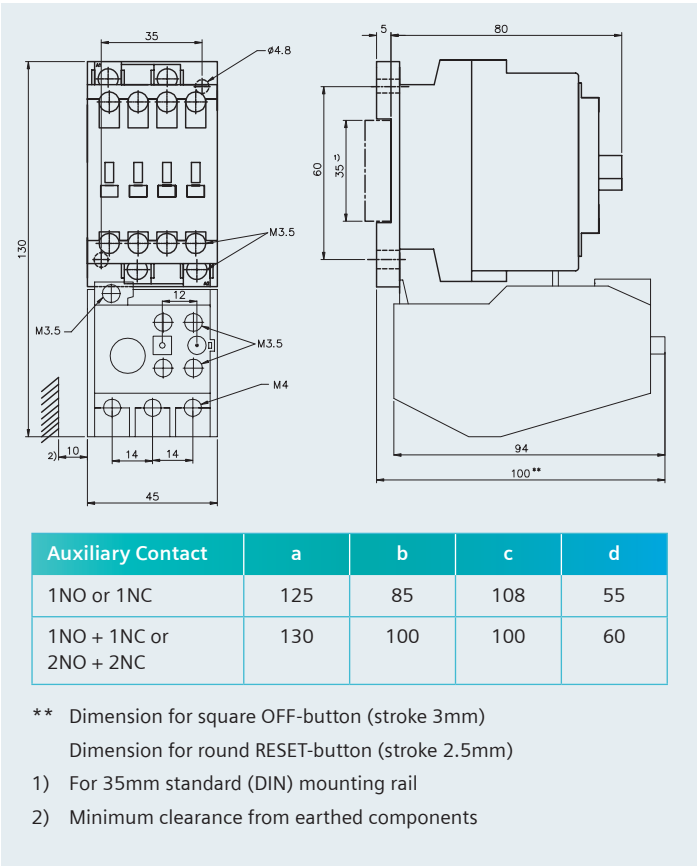

3UA52 mounted on 3TF 32/33

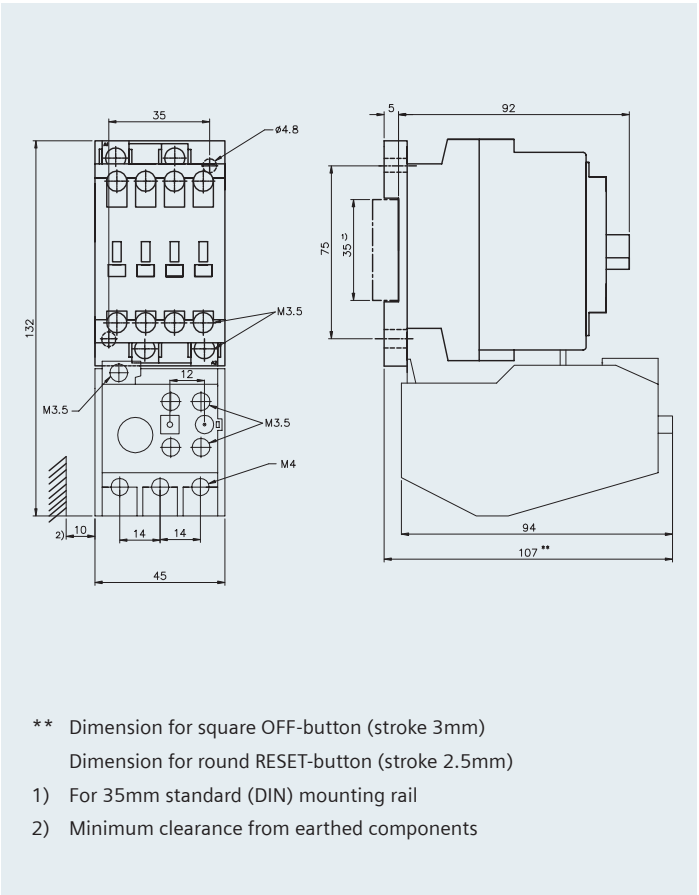


3UA55 mounted on 3TF 34/35

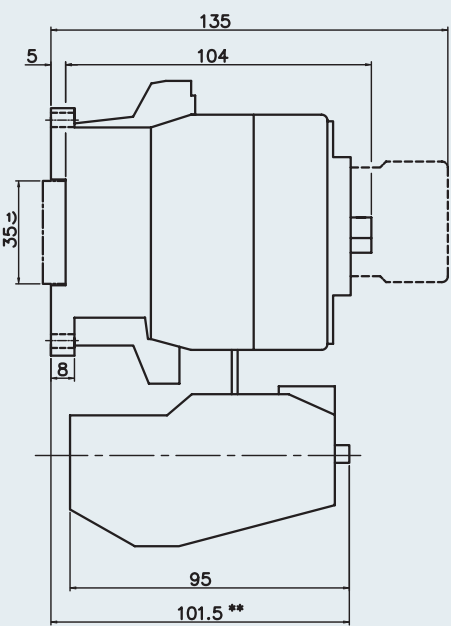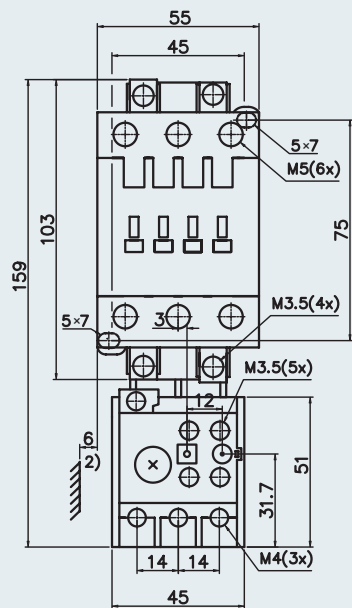


- Notes:
- 1) For 35 mm standard (DIN) mounting rail
  - 2) Minimum clearance from Earthed components
  - \*\* Dimension for Square OFF-button (Stroke 3 mm)  
Dimension for round RESET-button (Stroke 2.5 )

3UA58 with independent mounting adaptor type 3UX1 421

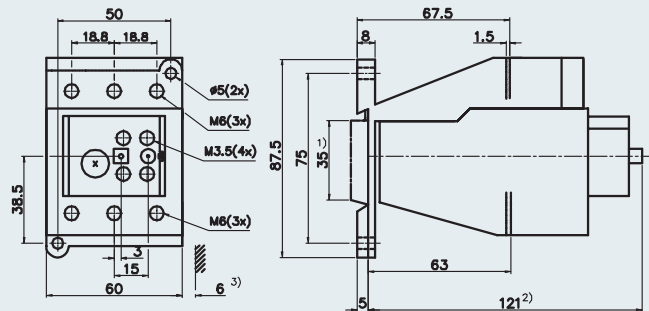

3UA5800 mounted on 3TF46/47  
3UA5800\_.. Z1 mounted on 3TF48/49

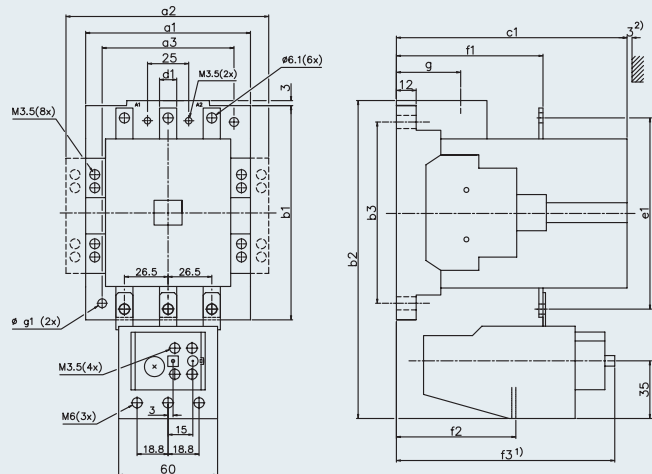

- Notes:
- 1) For 35 mm standard (DIN) mounting rail
  - 2) Dimension for Square OFF-button (Stroke 3 mm)  
Dimension for round RESET-button (Stroke 2.5 )
  - 3) Minimum clearance from the Earthed componenets

- 1) \* Dimension – For square OFF button (Stroke 3mm)  
– For round RESET button (Stroke = 2.5mm) less 2.5mm
- 2) Minimum clearance from insulated components : 3mm  
Minimum clearance from earthed components: 10mm

3UA58+	a1	a2	a3	b1	b2	b3	c1	d1	e1	f1	f2	f3	g	g1
3TF46/47	90	113	70	114	178	100	123	10.5	102	80	63	123	28	4.8
3TF48/49	100	123	80	130	193	110	140	10.5	116	89	72	132	39	5.4

The technical drawing shows the 1235 terminal block from two perspectives:

- Front View (Left):** Shows the top and bottom of the block. Key dimensions include a total width of 113mm, a central width of 90mm, and a bottom width of 45mm. It features 8 M3.5 screws on the top and 4 M3.5 screws on the bottom. There are 6 M6 screws on the sides and 2 M6 screws on the bottom. The block has a central slot for a button, with a width of 25mm and a depth of 15mm. The bottom of the block has a height of 56mm and a width of 45mm. The bottom of the block has a width of 45mm and a height of 56mm. The bottom of the block has a width of 45mm and a height of 56mm.
- Side View (Right):** Shows the side of the block. Key dimensions include a total height of 198.4mm, a top height of 113mm, and a bottom height of 113mm. The block has a width of 123mm and a depth of 123.5mm. The side view shows the internal components and the mounting holes.

**Callouts:**

- M3.5(8x)
- M3.5(2x)
- ø6.6(6X) M6
- ø4.8(2x)
- M3.5(4x)
- M6(3x)
- 113
- 90
- 70
- 25
- 15
- 113
- 123
- 80
- 28
- 12
- 114
- 100
- 113
- 137.4
- 198.4
- 38
- 63.5
- 123.5 \*
- 52.5
- 56
- 15
- 18.8
- 18.8
- 45

**Legend:**

- \* Dimension – For square OFF button (Stroke 3mm)
- For round RESET button (Stroke = 2.5mm) less 2.5mm

**Notes:**

- 1) Minimum clearance from insulated components : 3mm
- Minimum clearance from earthed components: 10mm

[illegible]

The technical drawing shows the E2000 terminal block from two perspectives: a front view (left) and a side view (right).

**Front View Dimensions and Specifications:**

- Overall width: 94
- Top mounting holes:  $\phi 8.5(6x)$
- Internal width segments: 37, 37, 50, 18.8, 18.8
- Central screw:  $\phi 5(2x)$
- Terminal screws: M6(3x)
- Terminal width: M3.5(4x)
- Bottom mounting holes: M6(3x)
- Overall height: 126
- Mounting hole offset: 108
- Terminal height: 38.5
- Terminal width: 60
- Terminal offset: 5, 15

**Side View Dimensions and Specifications:**

- Overall length: 121\*
- Top flange width: 68
- Top flange thickness: 8
- Terminal height: 75
- Terminal offset: 35
- Terminal width: 5
- Terminal offset: 63
- Terminal width: 2


**Legend:**

- \* Dimension — For square OFF button (Stroke 3mm)
- For round RESET button (Stroke 2.5mm) less 2.5mm


**Notes:**

- 1) Minimum clearance from insulated components : 3mm
- Minimum clearance from earthed components: 10mm

3UA6230 / 3UA6830 CT operated Birelay

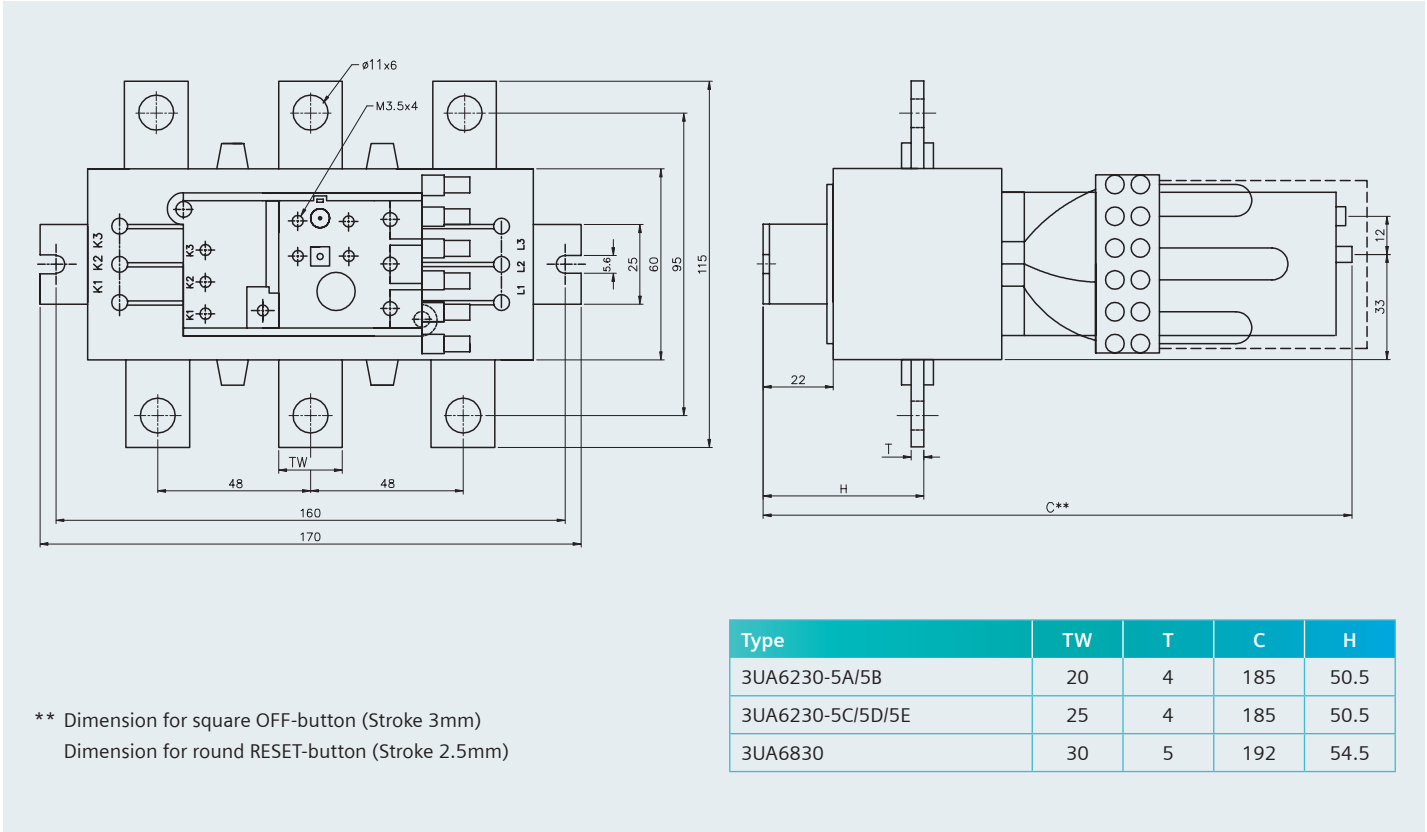

3UC5030/ 3UC5830/ 3UC6230 / 3UC6630 CT operated Birelay

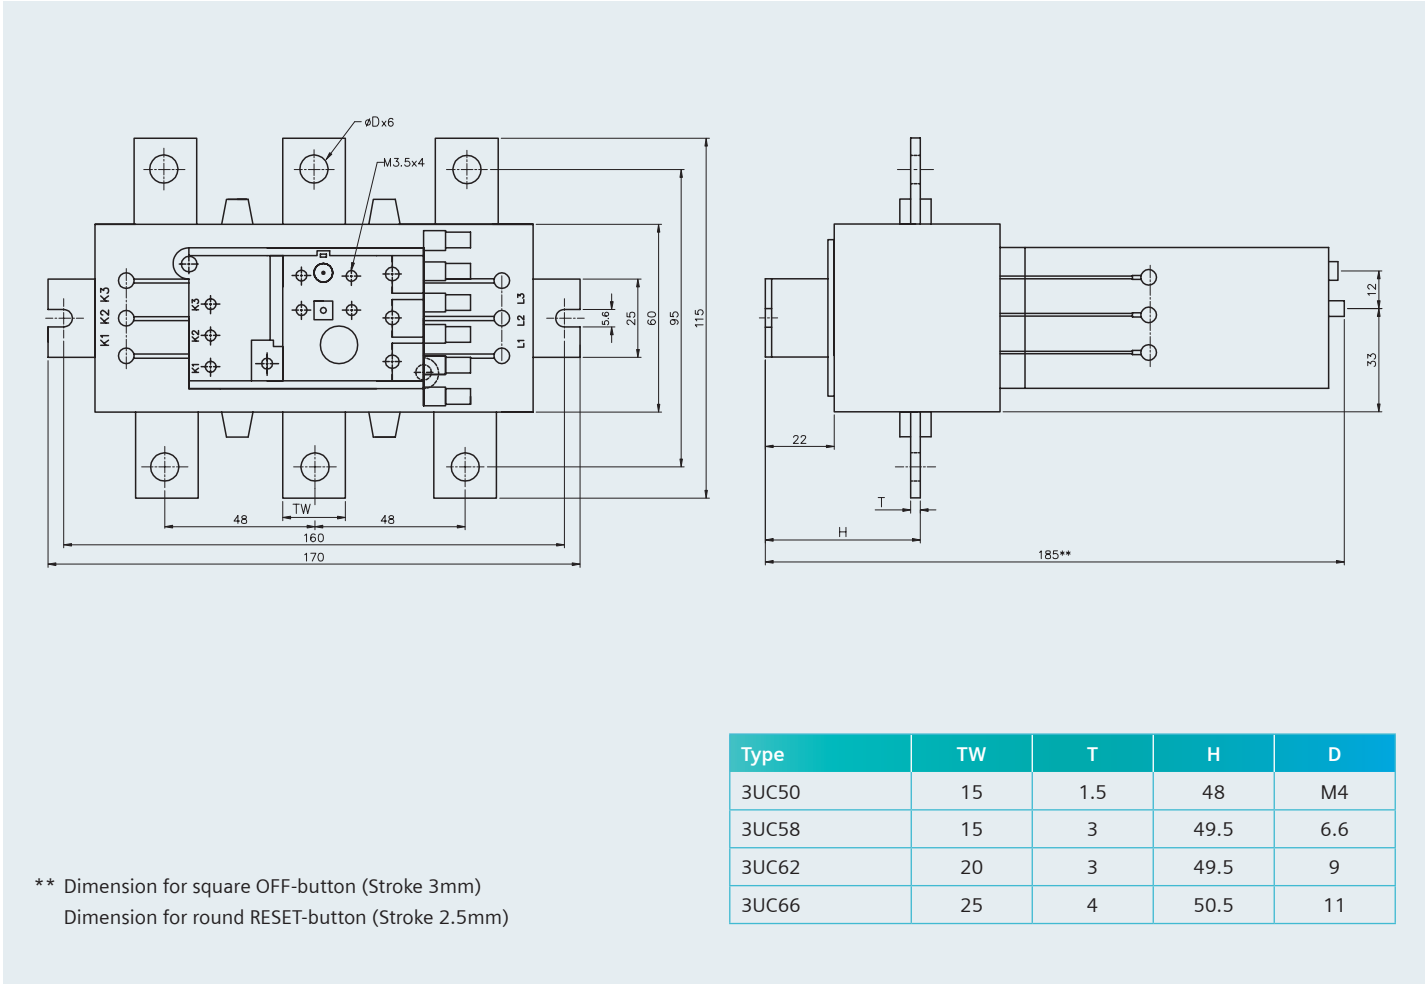

# Motor Protection Circuit Breakers

## 3VU13 and 3VU16

3VU13/3VU16 is suitable for use in fuseless motor feeders upto 11KW/22KW (25A/63A) respectively. 3VU motor protection circuit breakers are used for protection of motor against overload, single phasing and short-circuit faults.

### Applications

- Motor Protection**

Circuit breakers type 3VU13 & 3VU16 offer overload, short circuit and phase loss protection for 3 phase motors upto 11kW and 22 kW respectively. The breaker has a toggle switch for ease of operation and can be offered with auxiliary contacts, trip indicating contacts, U/V or Shunt release. High breaking capacity of 100kA is available in 3VU13 upto 6A and in 3VU16 upto 25A.

- Distribution Feeder Protection**

Standard version of 3VU13 and 3VU16 has adjustable O/L and fixed S/C release. Main application is for disconnection and protection of the distribution feeders, upto 25A and 63A respectively. A large number of overlapping ranges are available for offering closer protection to various loads.

- Transformer protection**

A separate 3VU13 range can be offered to protect the primary side of the transformers. The range is available upto 20A. To take care of the inrush current due to transformer switching, the S/C release is set at 19 times the rated current unlike 12 times of the rated current available in standard range.

- Fuse Monitoring**

3VU1340-1MS00 is offered for Fuse Monitoring application. This device is connected in parallel to the fuses. In case one of the fuses blows, the rated current will flow through the corresponding phase of this MPCB. MPCB, through its auxiliary contacts, provides a tripping signal to the contactor and thus the motor will be switched off. Hence, the motor will be protected from single phasing. (Refer page 51 for connection diagram)



### Standard

3VU motor protection circuit breakers confirm to IS/IEC 60947-1, IS/IEC 60947-2, IS/IEC 60947-4-1, DIN VDE 0660

### Range

3VU13: 0.16 - 25A

3VU16: 10 - 63A

### Benefits and features


#### High performance

- Instantaneous Tripping**

3VU circuit breakers operate on the **Current Limiting Principle**.

#### Current Limiting Principle

In case of short-circuit condition motor protection circuit breaker trips before the short-circuit current reaches the prospective peak. Hence, for circuit breaker to be current limiting it must interrupt the short-circuit current in half cycle or less as shown below.

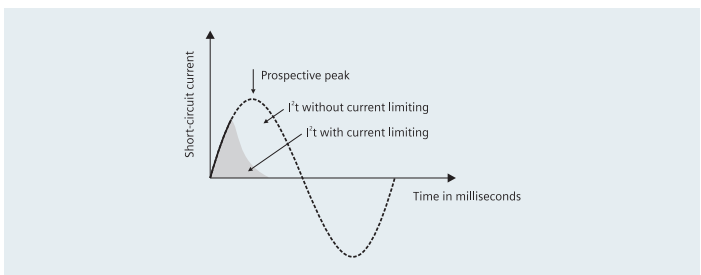

### Current Limiting is achieved in 3VU as follows

In case of a short circuit, the contacts are opened electro-dynamically by the short circuit current. The instantaneous overcurrent release, through the switching mechanism, trips all the three poles of the breaker. A large arc voltage is quickly built up in the arc chamber limiting the short circuit current. Thus ensures faster fault clearing.

- Ambient temperature compensation upto 55°C hence no deration required upto 55°C.

### Safety

#### • Trip Free Mechanism

The breakers have a trip-free mechanism. Even by holding the toggle, tripping operation can not be stopped or blocked once it is started. Thus ensure positive opening in the event of fault.

- Positive ON/OFF indication through toggle switch
- Compact and space saving

### User friendliness and safety

- SIGUT® connection technique ensures ease of wiring (can obviate use of lug)
- Fingers touch proof terminals ensures operator safety
- Separate trip indication on short circuit and overload fault using alarm contact

### Flexibility

- Can be used as a main and EMERGENCY STOP switch.
- Identical accessories reduce stock levels

### Selection and ordering data

#### 3VU13 Circuit - breakers with 1NO+1NC auxiliary contacts for motor and plant protection

Rated Current In A	Overload release range A	Shortcircuit release setting A	Type <sup>s</sup>	Recommended 415V Motor Rating in Kw/HP (DOL)	Std. pkg. (nos.)
0.16	0.1 - 0.16	1.9	3VU1340-1MB00	—	1
0.24	0.16 - 0.24	2.9	3VU1340-1MC00	—	
0.4	0.24-0.4	4.8	3VU1340-1MD00	—	
0.6	0.4-0.6	7.2	3VU1340-1ME00	—	
1	0.6-1	12	3VU1340-1MF00	0.25/0.33	
1.6	1-1.6	19	3VU1340-1MG00	0.37/0.5	
2.4	1.6-2.4	29	3VU1340-1MH00	0.75/1	
3.2	2-3.2	38	3VU1340-1NH00	1.1/1.5	
4	2.4-4	48	3VU1340-1MJ00	1.5/2	
5	3.2-5	60	3VU1340-1NJ00	2.2/3	
6	4-6	72	3VU1340-1MK00	3/4	
8	5-8	96	3VU1340-1NK00	3.7/5	
10	6-10	120	3VU1340-1ML00	4/5.4	
13	8-13	156	3VU1340-1NL00	5.5/7.5	
16	10-16	190	3VU1340-1MM00	7.5/10	
20	14-20	240	3VU1340-1MN00	9.3/12.5	
25	18-25	300	3VU1340-1MP00	11/15	

#### 3VU13 Circuit - breakers with 1NO+1NC auxiliary contacts for line-side protection of transformers with high inrush current

Rated Current In A	Overload release range A	Shortcircuit release setting A	Type	Std. pkg. (nos.)
0.6	0.4-0.6	12	3VU1340-1TE00	1
1	0.6-1	15	3VU1340-1TF00	
1.6	1-1.6	29	3VU1340-1TG00	
2.4	1.6-2.4	48	3VU1340-1TH00	
4	2.4-4	72	3VU1340-1TJ00	
6	4-6	120	3VU1340-1TK00	
10	6-10	190	3VU1340-1TL00	
16	10-16	300	3VU1340-1TM00	
20	14-20	300	3VU1340-1TN00	

#### Fuse monitoring motor protection circuit - breakers with 1NO+1NC auxiliary contacts

Rated Current In A	Overload release range A	Shortcircuit release setting A	Type	Std. pkg. (nos.)
0.2	0.2	1.2	3VU1340-1MS00	1

#### 3VU16 Circuit - breakers with 1NO+1NC auxiliary contacts for motor and plant protection

Rated Current In A	Overload release range A	Shortcircuit release setting A	Type <sup>s</sup>	Recommended 415V Motor Rating in Kw/HP (DOL)	Std. pkg. (nos.)
10	6-10	120	3VU1640-1ML00	4/5.4	1
16	10-16	190	3VU1640-1MM00	7.5/10	
25	16-25	300	3VU1640-1MN00	11/15	
32	22-32	380	3VU1640-1MP00	15/20	
40	28-40	480	3VU1640-1MQ00	18.5/25	
52	36-52	600	3VU1640-1MR00	22/30	

#### 3VU16 Circuit - breakers for plant protection

Rated Current In A	Overload release range A	Shortcircuit release setting A	Type <sup>s</sup>	Std. pkg. (nos.)
63	45-63	600	3VU1640-1LS00	1

<sup>s</sup> The 3VU13 and 3VU16 circuit breakers are also available without auxiliary contacts. To order the same, the 8th place of the type number is to be replaced with the digit 0.



## Technical Data

According to DIN VDE 0660; IS/IEC 60947-1; IS/IEC 60947-2; IS/IEC 60947-4-1

Type		3VU13		3VU16	
Number of poles		3		3	
Max. rated current $I_n$					
• motor protection	A	25		52	
• distribution	A	25		63	
Permissible ambient temperature					
• at full rated current	°C	-20 ... +55			
• in storage	°C	-50 ... +80			
Rated operational voltage $U_e$	V	690			
Rated frequency	Hz	50/60			
Rated insulation voltage $U_i$	V	750			
Rated impulse withstand voltage $U_{imp}$	kV	6			
Utilization category					
• to IS/IEC 60947-2 (motor starter protection)		A			
• to IS/IEC 60947-4-1 (motor starters)		AC-3			
Mechanical endurance	Operating cycles				
• up to 25 A	1/h	100,000		100,000	
• 25 A upwards	1/h	–		30,000	
Number of operating cycles/h (on load)	1/h	25		25	
Degree of protection with open terminals/with conductors connected		IP00/IP20			
Temperature compensation	to IS/IEC 60947-4-1	Yes			
Phase failure sensitivity	to IS/IEC 60947-4-1	Yes			
Auxiliary contact for 3VU13 and 3VU16					
Rated operational voltage $U_e$	AC V	230	400	500	
Rated operational current $I_e$	A	3	1.5	1.2	
Utilization category		AC-15			
Rated operational voltage $U_e$ DC L/R 200 ms	DC V	24	60	220	
Rated operational current $I_e$	A	2.3	0.7	0.3	
Utilization category		DC-13			
Wattloss Per Breaker					
		Current rating	Watt	Current rating	Watt
		0.6	5	2.4	8
		4	6	6	7
		6	7	25	14
		25	9	63	23
Cross-section for main conductors					
Solid or stranded	mm²	2 x (1 ... 6)		1 x 1.5 ... 2 x 16 or 1 x 25 + 1 x 10	
Finely stranded with end sleeve	mm²	2 x (1 ... 4)		1 x 1.5 ... 2 x 10 or 1 x 16 + 1 x 10	
Cross-sections for auxiliary and control connecting leads					
Solid or stranded	mm²	1 x 0.5 ... 2 x 2.5			
Finely stranded with end sleeve	mm²	1 x 0.5 ... 2 x 2.5			

## Technical data for accessories:

		3VU13	3VU16
<b>Undervoltage Release</b>			
Consumption During Pick-up	VA/W	10/6	
Consumption During Running	VA/W	4.7/2	
Dropout	V	0.7 to 0.35 X Ue	
Pickup	V	85 to 110% of Ue	
Max Operating Time	ms	20	
<b>Shunt Release</b>			
Consumption	VA/W	10/6	
Max Continuous Rating	Sec	5	
Pickup	V	0.7 to 1.1 X Ue	
<b>Current Limiter for 3VU13</b>			
Rated current In		56 Amps	
Rated Voltage Ue		500 V, 50 / 60 Hz.	
Power Connection	mm <sup>2</sup>	2 x (1 to 6)	
<b>Mounting</b>			
		on DIN Rail in any position.	

**Table 1 3VU13/3VU16 breaking capacity at 415V**





### 3VU13

Rated current	A	0.16-1	1.6	2.4	3.2-4	5-6	8-10	13-16	20-25
Rated Short circuit breaking capacity @ 415V									
Icu	kA	100	100	100	100	100	10(50)	6(50)	6(50)
Ics	kA	100	100	100	100	100	10(50)	6(50)	6(50)
<b>Maximun back up fuse (gL/gG)</b>									
Diazed	A	*	*	*	*	*	80	80	80
NH	A	*	*	*	*	*	80	80	80
( ) Values in bracket are with current limiter; * Fuse not required									
For 3VU13 breakers of ratings 8A & above, in place of fuses, the Current Limiter can be used to increase the S/C breaking capacity.									
<b>Rated Breaking Capacity DC; t = 15ms</b>									
1 Contact	2 Contacts in series	3 Contacts in series	10 kA						
110-150V	220-300V	330-450V							


### 3VU16

Rated current	A	1.6-2.4	4	6	10	16	25	32-63
Rated Short circuit breaking capacity @ 415V								
Icu	kA	100	100	100	100	100	100	35
Ics	kA	100	100	100	100	100	50	17
<b>Maximun back up fuse (gL/gG); * Fuse not required</b>								
Diazed	A	*	*	*	*	*	*	-
NH	A	*	*	*	*	*	*	200
<b>Rated Breaking Capacity DC; t = 15ms, upon enquiry</b>								

Characteristic Curves

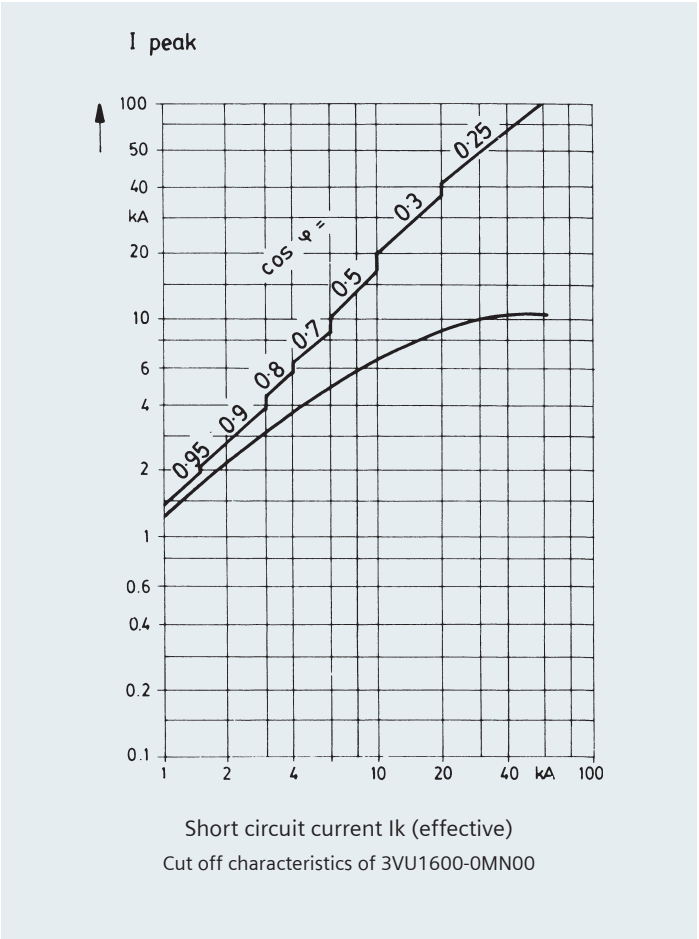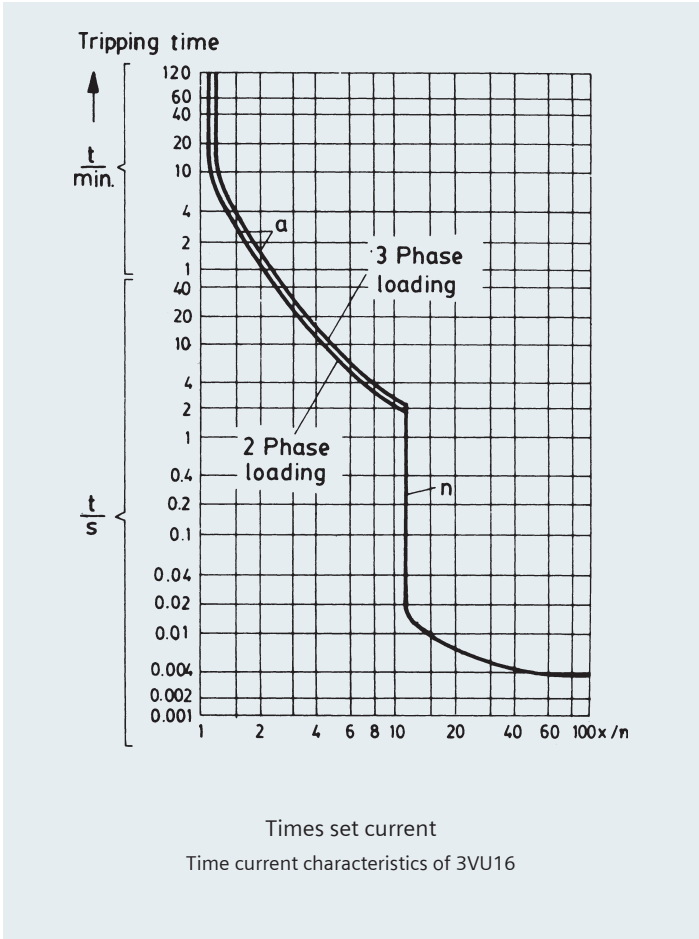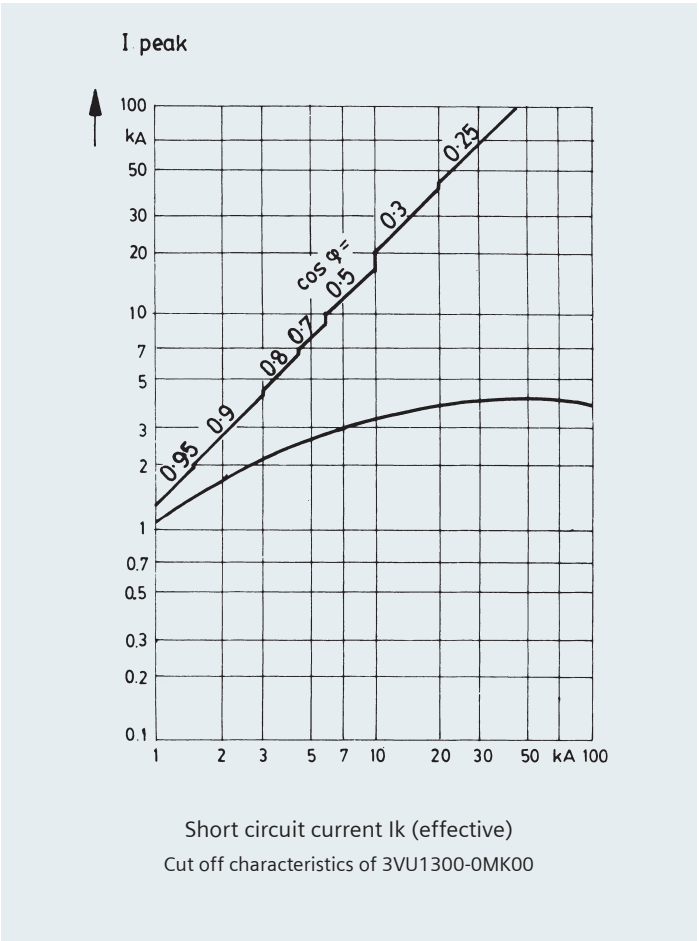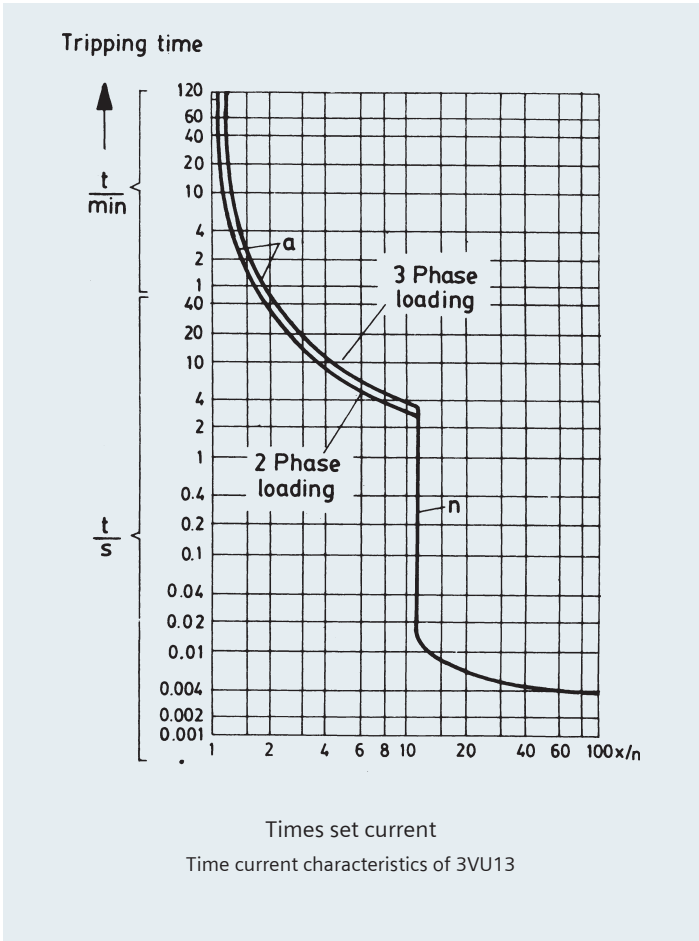


Accessories:

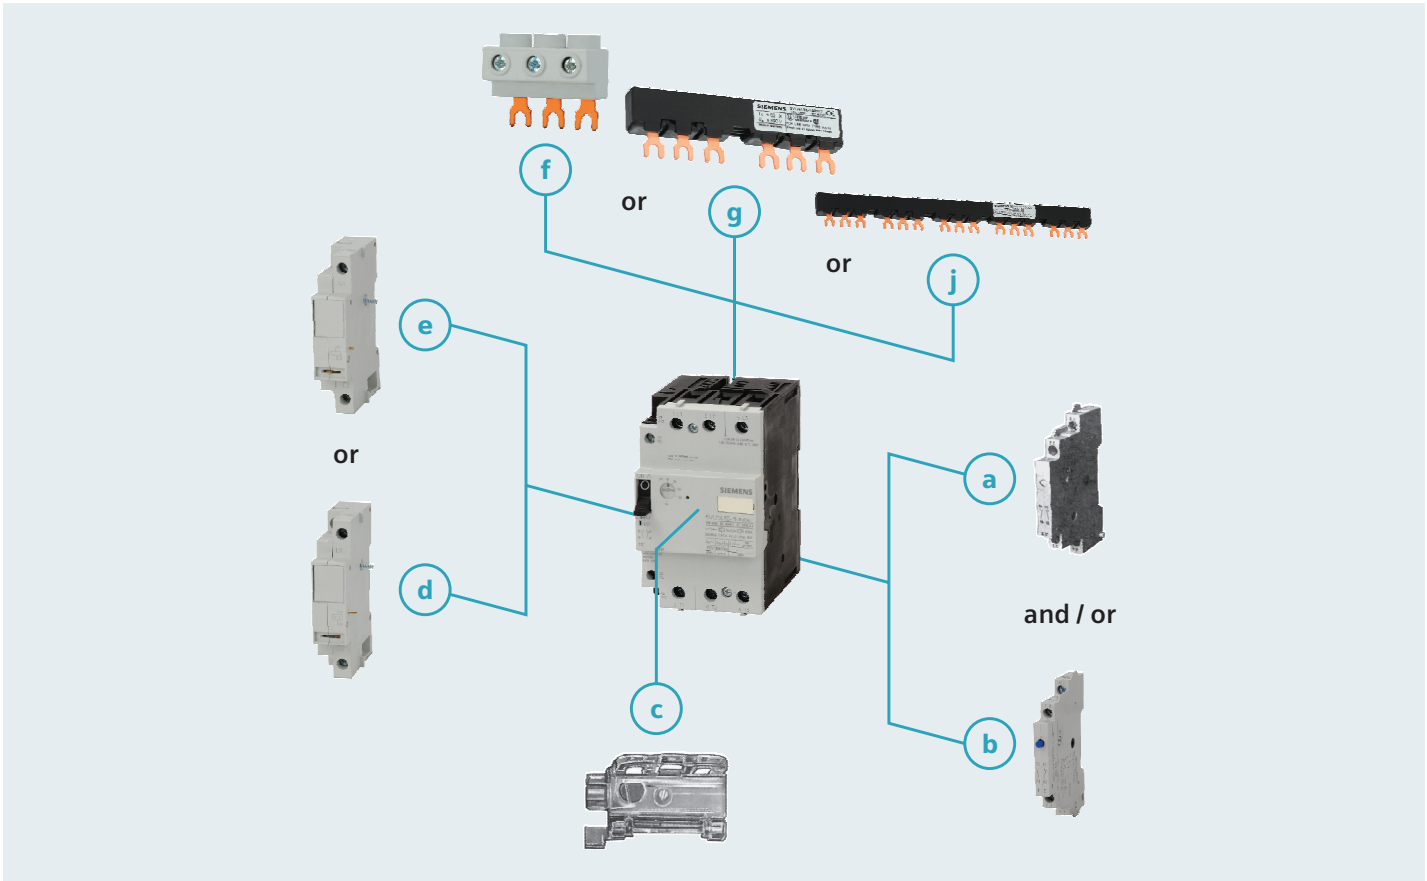

	Accessory	MLFB	Configuration	Description
a	Add-on auxiliary block	3VU9131-3AA0	1NO+1NC	This contact can be added to the MPCB with or without built -in 1NO+1NC contact
b	s/c trip indicating contact	3VU9131-7AA00	1NO+1NC	When short circuit (and not overload) occurs, alarm contact 1NO+1NC changes over which can be used to give indication.
c	Padlocking for toggle	3VU9168-0KA00	–	Handle of 3VU13/16 can be padlocked to prevent unauthorized operation
d	Under-voltage release	3VU9132-0AB15	220/230V 50Hz	It trips the MPCB on voltage interruption, preventing the undesirable restart of the motor
e	Shunt release	3VU9132-0AB55 3VU9132-0AB50 3VU9132-0AB73	220/230V 50Hz 24V/50Hz DC 110-240V	Shunt trip is used for remotely tripping the MPCB
f	3-phase in-feed terminal	3RV19 25-5AB	Max. 63Amps	It provides a convenient means of energy supply and distribution
g	3-phase bus-bar (2 breakers)	3VU9135-1AB02	Max. 63Amps	It provides a convenient solution for connecting group of MPCB's together
h	3-phase bus-bar (3 breakers)	3VU9135-1AB03	Max. 63Amps	It provides a convenient solution for connecting group of MPCB's together
i	3-phase bus-bar (4 breakers)	3VU9135-1AB04	Max. 63Amps	It provides a convenient solution for connecting group of MPCB's together
j	3-phase bus-bar (5 breakers)	3VU9135-1AB05	Max. 63Amps	It provides a convenient solution for connecting group of MPCB's together
k	Current limiter	3VU9138-2AB00	Max. 56Amps	This accessory can used to provide a higher breaking capacity up to 50kA

Door operating mechanism for 3VU13/16\*

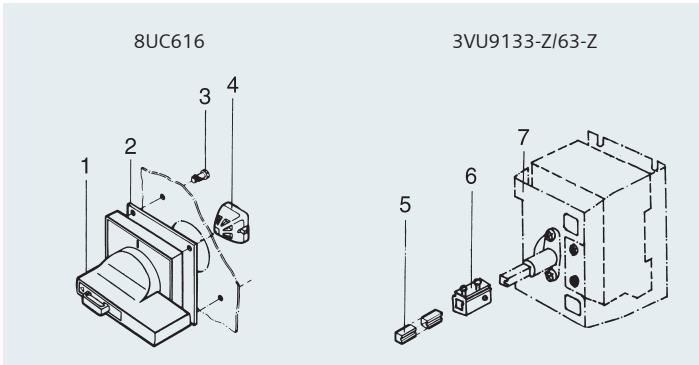

- 1. Handle with masking frame
- 2. Gasket
- 3. Fixing screws
- 4. Drive coupling
- 5. Extension shaft-300mm
- 6. Adaptor
- 7. Breaker Operator

\* 1 set available with breaker operator kit and 8UC front drive together

Breaker Operating Kit for 3VU13 – 3VU9133-Z  
Breaker Operating Kit for 3VU16 – 3VU9163-Z

Note : All the above accessories have a standard package no. = 1

Current-Limiter




The breaking capacity of 3VU13 is 100kA upto 6A. However for 3VU circuit breakers with rated current of 8A and 10A the short-circuit breaking capacity is 10kA. For circuit breakers with rated current from 16A to 25A the short-circuit breaking capacity is 6kA. In order to enhance the breaking capacity to 50kA, for these ratings (8A to 25A), the current limiter can be used. Thus the need of back up fuses is obviated.





The current limiter is connected in series with 3VU13 MPCB.

When a short circuit occurs, the limiter trips and in turn opens the downstream MPCB. The auxiliary contacts of the current limiter (1NO+1NC) can be used for signaling whether the limiter has tripped or not.





Several MPCBs can also be connected at the output of a current limiter. However the summation of current ratings of individual MPCBs should not be greater than 56A.

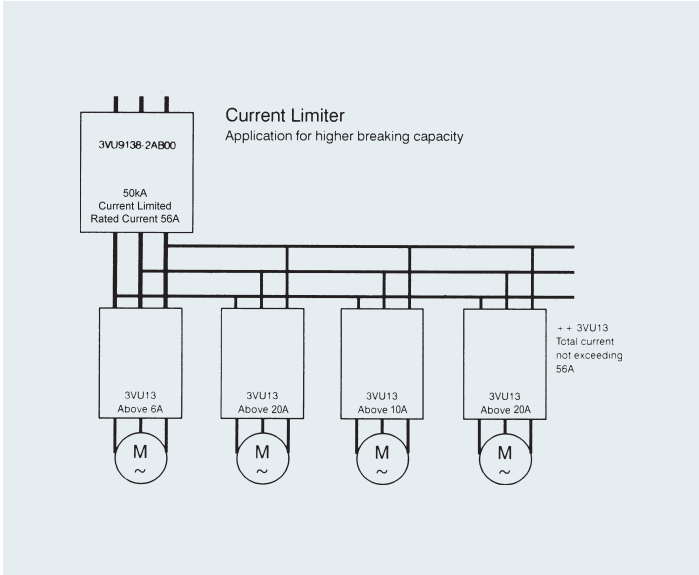

Connection diagrams

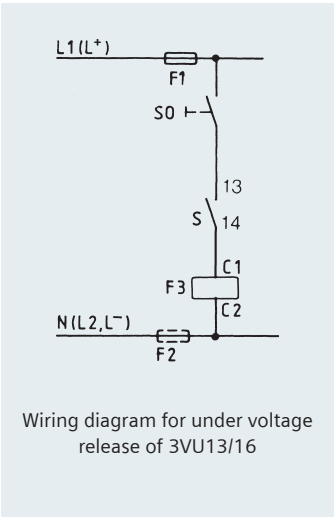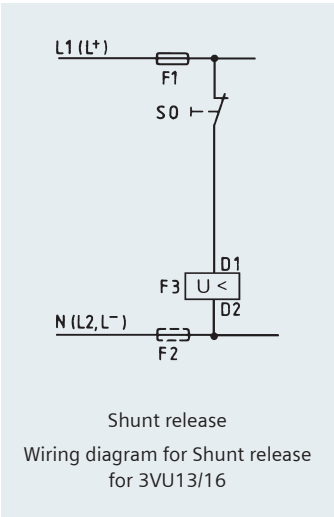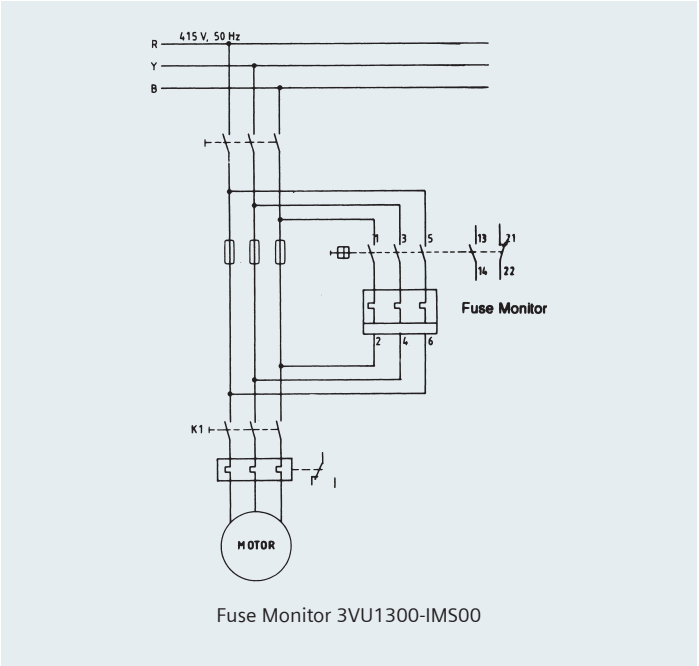
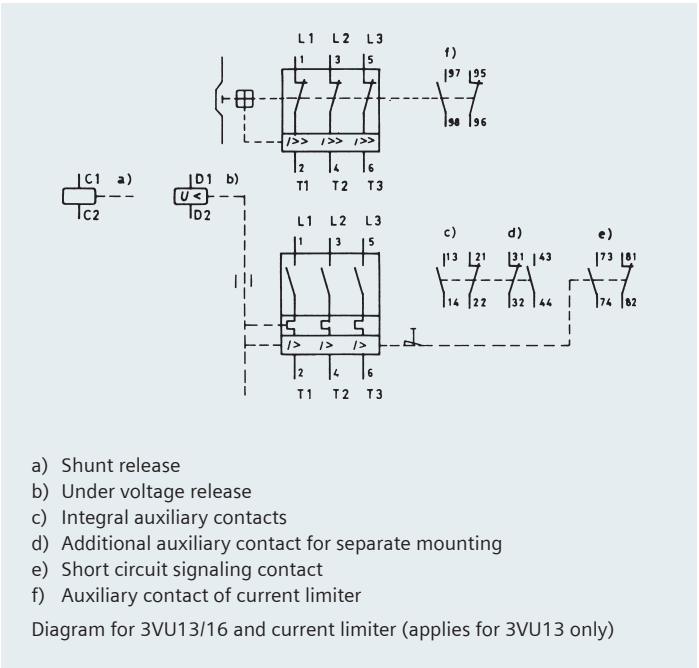


### 3VU13 circuit-breakers and accessories

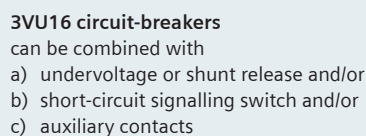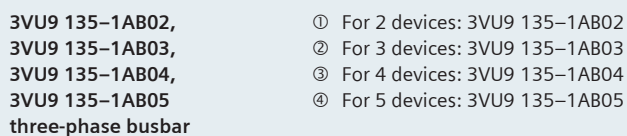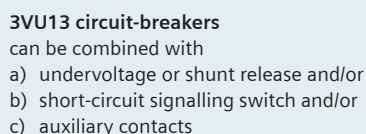

### Required space above arc chutes for 3VU13 and 3VU16

Minimum clearance to adjacent parts as well as non-insulated live parts.

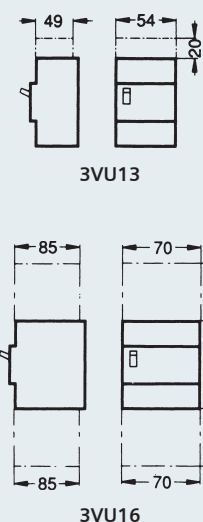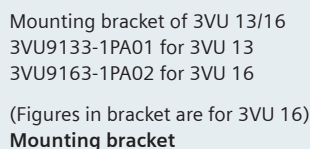











# Get the right start with Siemens


## Range of ready to use Motor starters

For more than 125 years, Siemens has been developing and manufacturing world-class, control products. Siemens offers a wide range of starters to cater to diversified demands from various sectors. These products are specially designed to provide smart, easy and reliable motor starting solution.

They employ tried and tested Siemens contactors and relays and this ensures the right start for motors requiring direct online starting or star delta starting.

### Range:

					
<b>DOL</b> 3TW42 up to 10HP (with bi-relay)	<b>HSD</b> 3LW42 up to 15HP (with bi-relay)	<b>ASD</b> 3TE02 up to 25HP (with bi-relay)	<b>DOL</b> 3TW04 up to 75HP (without bi-relay)	<b>ASD</b> 3TE04 up to 75HP (without bi-relay)	<b>ASD</b> 3TE05 up to 180HP (with bi-relay)



Wide Range of Motor starters

## Applications:

DOL: As we know, a direct on line starter can be used if the high inrush current of the motor does not cause excessive voltage drop in the supply circuit. It can be used to start small water pumps, compressors, fans and conveyor belts etc.

ASD: As these starters are available up to 180HP, wide range of applications can be catered for example - Textiles, Food and Beverages, Sugar Plants, Small scale machine tools, Paper & Printing, Cold Storages, Plastic Welding Machines etc.

## Features and Benefits

### Flexibility:

- 3TW04 and 3TE04 has provision for mounting relay but the relay is not provided in the starter. Thus offering flexibility of selecting relay range as per requirement

### Reliability:

- 3RW42 range of DOL starters are having option of 200-400 V and 3TE02 star delta starters are having option of 230-400 V coil voltage which takes care of wide fluctuations in the supply voltage occurring especially in the remote places
- Accurate protection under single phasing & overload

### High performance:


- Compliance to latest standard IS 13947 (3TW04, 3TE04, 3TE05)
- Assembly of world class contactor and relays inside each of the starter gives high mechanical and electrical life
- Easy to maintain
- Field tested for adverse conditions and many more advantages



### Fully automatic star delta starters (ASD: Range extension)

ASD starters with bi-relay from 75kW to 132kW (100HP to 180HP)

### Key highlights:

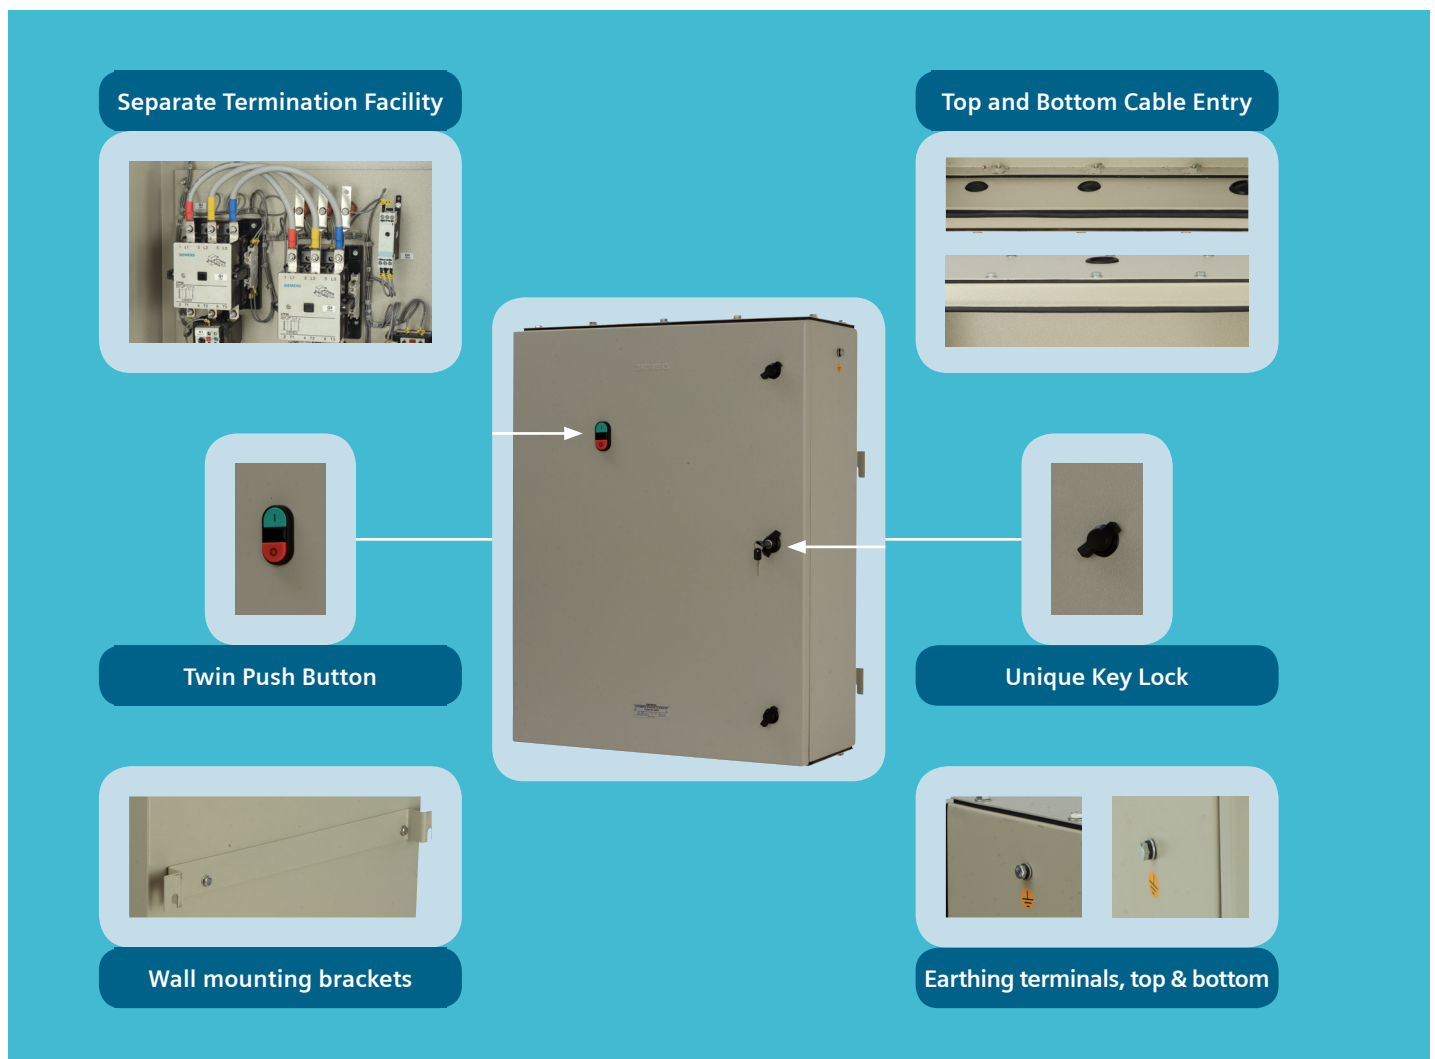

## Ordering data

### RAJA DOL - Direct online starters (with bi relay)



Motor rating at 415V, 3ph, 50Hz		Type <sup>1)</sup> (DOL)	Relay range A	Std. pkg. (nos.)
HP	kW			
0.33	0.25	3TW42 90-1A.64	0.63-1	1
0.75	0.55	3TW42 90-1A.66	1-1.6	
1	0.75	3TW42 90-1A.68	1.6-2.5	
1.5	1.1	3TW42 90-1A.69	2-3.2	
2	1.5	3TW42 90-1A.71	3.2-5	
3	2.2	3TW42 90-1A.72	4-6.3	
5	3.7	3TW42 90-1A.74	6.3-10	
–	–	3TW42 90-1A.75	8-12.5	
7.5	5.5	3TW42 90-1A.77	10-16	
10	7.5	3TW42 90-1A.78	12.5-20	

<sup>1)</sup> Enter code for coil voltage, 50Hz (B for 200-400V, W for 415V)

### HSD - Handle operated star delta starters (with bi relay)



Motor rating at 415V, 3ph, 50Hz		Type <sup>1)</sup> (HSD)	Relay range	Std. pkg. (nos.)
HP	kW			
5	3.7	3LW42 90-0A.72	4-6.3	1
10	7.5	3LW42 90-0A.74	6.3-10	
12.5	9.3	3LW42 90-0A.75	8-12.5	
15	11	3LW42 90-0A.77	10-16	

<sup>1)</sup> Enter code for coil voltage, 50Hz (B for 200-400V, W for 415V)

### ASD - Fully automatic star delta starters (with bi relay)



Motor rating at 415V, 3ph, 50Hz		Type <sup>2)</sup> (ASD)	Relay range	Std. pkg. (nos.)
HP	kW			
12.5	9.3	3TE02 90-0A.75	8-12.5	1
15	11	3TE02 90-0A.77	10-16	
20	15	3TE02 90-0A.78	12.5-20	
25	18.5	3TE02 90-0A.79	16-25	

<sup>2)</sup> Enter code for coil voltage, 50Hz (D for 230-400V, W for 415V)

### DOL - Direct online starters (without bi relay)



Motor rating at 415V, 3ph, 50Hz		Type <sup>3)</sup> (DOL)	Birelay (recommended)	Std. pkg. (nos.)
HP	kW			
20	15	■ 3TW04 94-2A..	3UA55 (20-32A)	1
25	18.5	■ 3TW04 95-2A..	3UA55 (25-36A)	
30	22	■ 3TW04 96-2A..	3UA58 (32-50A)	
40	30	3TW04 97-2A..	3UA58 (40-57A)	
50	37	3TW04 98-2A..	3UA58 (57-70A)	
75	55	3TW05 90-2A..	3UA5830 (85-105A)	

<sup>3)</sup> Enter code for coil voltage, 50Hz ("RO" for 415V, "PO" for 230V)

## ASD - Fully automatic star delta starters (without bi relay)



Motor rating at 415V, 3ph, 50Hz		Type <sup>3)</sup> (ASD)	Birelay (recommended)	Std. pkg. (nos.)
HP	kW			
30	22	3TE04 94-2A..	3UA55 (16-25A)	1
40	30	3TE04 94-2A..	3UA55 (20-32A)	
50	37	3TE04 95-2A..	3UA55 (32-40A)	
60	45	3TE04 96-2A..	3UA58 (32-50A)	
75	55	3TE04 97-2A..	3UA58 (40-57A)	

<sup>3)</sup> Enter code for coil voltage, 50Hz ("RO" for 415V, "PO" for 230V)



## ASD - Fully automatic star delta starters (with bi relay)



Motor rating at 415V, 3ph, 50Hz		Type ASD <sup>†</sup>	Std. pkg. (nos.)
HP	kW		
100	75	3TE05 94-2AR0	1
125	90	3TE05 95-2AR0	1
150	110	3TE05 96-2AR0	1
180	132	3TE05 97-2AR0	1

## Contactor & Birelay list for 3TE04/ 3TE05 type ASD starter

HP	KW	3TE04/ 3TE05 type starter	Contactor Line/ Delta	Contactor Star	Bi-relay <sup>†††</sup>
30	22	3TE04 94-2A....	3TF34	3TF34	3UA55 (16-25A)
40	30	3TE04 94-2A....	3TF34	3TF34	3UA55 (20-32A)
50	37	3TE04 95-2A....	3TF35	3TF34	3UA55 (32-40A)
60	45	3TE04 96-2A....	3TF46	3TF34	3UA55 (32-50A)
75	55	3TE04 97-2A....	3TF47	3TF34	3UA55 (40-57A)
100	75	3TE05 94-2A....	3TF49	3TF47	3UA58 (70-95A)
125	90	3TE05 95-2A....	3TF50	3TF47	3UA58 (70-95A)
150	110	3TE05 96-2A....	3TF50	3TF50	3UA58 (95-120A)
180	132	3TE05 97-2A....	3TF51	3TF50	3UA62 (115-180A)

<sup>†††</sup> 3TE05 have in-built birelay whereas 3TE04 doesn't have in-built birelay

## Spares for starters

### Spares for 3TW42/3LW42 starters

Description	Type	Std. pkg. (nos.)
Contactor	3TW0 290-0A.51 <sup>1)</sup>	1
Main contact kit - single pole	3TX0 200-0YA1	1
Main contact kit - 3 pole	3TX0 200-0YA0	1
Coil	3TX0 203-0Y.6 <sup>1)</sup>	1
Moving contact carrier	3TX0 200-0YD0	10
Arc chamber	3TX0 202-0YA0	10
Aux. fixed contacts	3TX0 200-1YB0	10
Aux. moving contacts	3TX0 200-1YC0	10
Birelay	3UW5 002.. <sup>§</sup>	1
'On' actuator for 3TW42	3TX0 204-1YA0	1
'Off' actuator for 3TW42	3TX0 204-1YB0	1
'Reset' actuator for HSD	3TX0 204-1YR0	1
On/Off contact	3SX1 551-1YA	1
Switch for HSD starter	3LA0 204-4YB	1

### Spares for 3TE02 starters

Description	Type	Std. pkg. (nos.)
Contactor (1NO+1NC)	3TW0 311-0A&51	1
Contactor (2NO)	3TW0 320-0A&51	1
Main contact kit three pole	3TX0 300-0YA0	1
Main contact kit single pole	3TX0 300-0YA1	1
Coil	3TX0 303-0Y&6	1
Aux. fixed contacts (NO)	3TX0 300-1YB0	10
Aux. fixed contacts (NC)	3TX0 300-1YD0	10
Aux. moving contacts	3TX0 300-1YC0	10
Birelay	3UW5 002.. <sup>§</sup>	1
Star-delta timer	3RP15 76 1N#20 8K	1

& Enter code for coil voltage, 50Hz (D for 230-400V, W for 415V)

# Enter control voltage code (M for 200-240V / 380-440V, P for 230-400V)

### Spares for 3RW04, 3TE04, 3TE05

Description	Type	Std. pkg. (nos.)
Main, aux contacts & spare coils	Refer page 42	-
On/Off actuators	3SX1 552-1YA	1
On/Off contact	3SX1 551-1YA	1
On/Off actuator for 3TE05 only	3SB5201-7EC01	1
Electronic Timer	3RP15 76-1NM20 8K	1
Accessory for independent mounting of 3UA58	3UX1421-0XA	1

<sup>†</sup> Enter code for coil voltage F0 (110V), P0 (230V), R0 (415V)

For replacing 3TF44 order 3TF3422 and for replacing 3TF45 order 3TF3522

<sup>#</sup> 1NO + 1NC      <sup>@</sup> 2NO + 2NC


### <sup>§</sup> Coil codes for relay 3UW5:

Relay range	0.63-1	1-1.6	1.6-2.5	2-3.2	3.2-5	4-6.3	6.3-10	8-12.5	10-16	12.5-20	16-25
Code	0J	1A	1C	1D	1F	1G	1J	1K	2A	2B	2C




Single line diagram SLD


A: DOL - in S.S. Housing SLD– 3phase motor

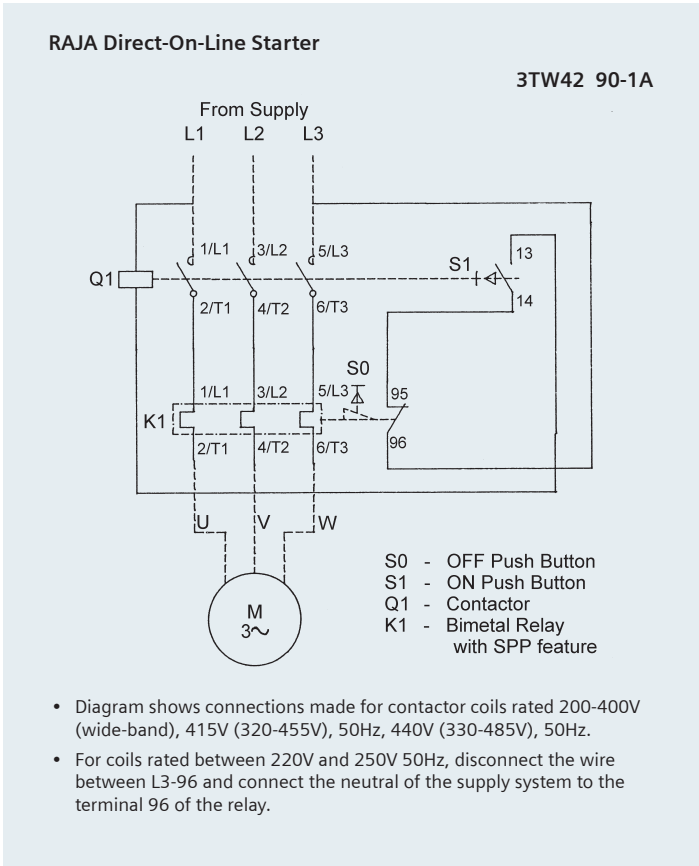


DOL - in S.S. Housing SLD– 1phase motor

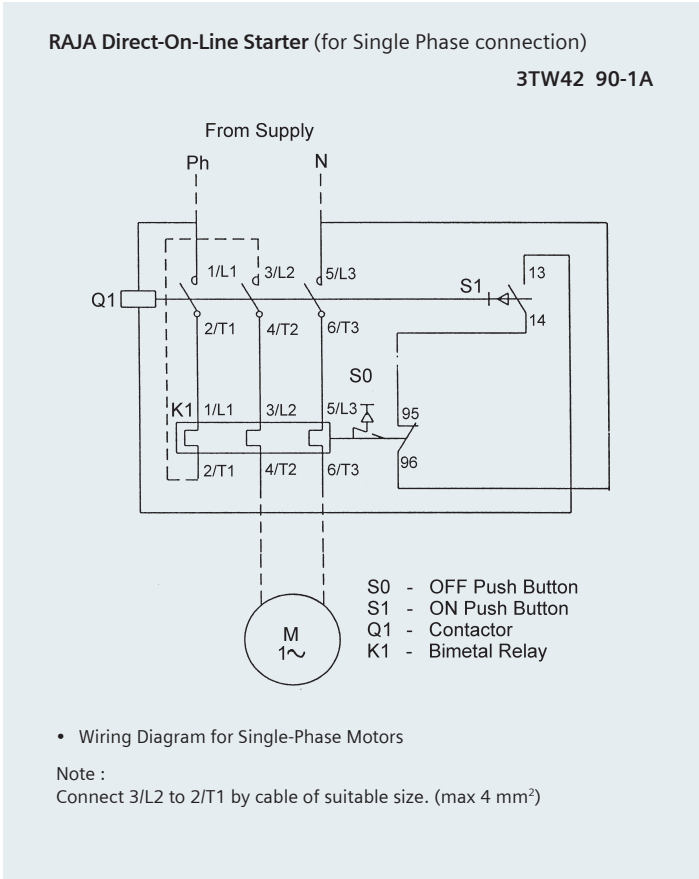


DOL – Remote reset - SLD

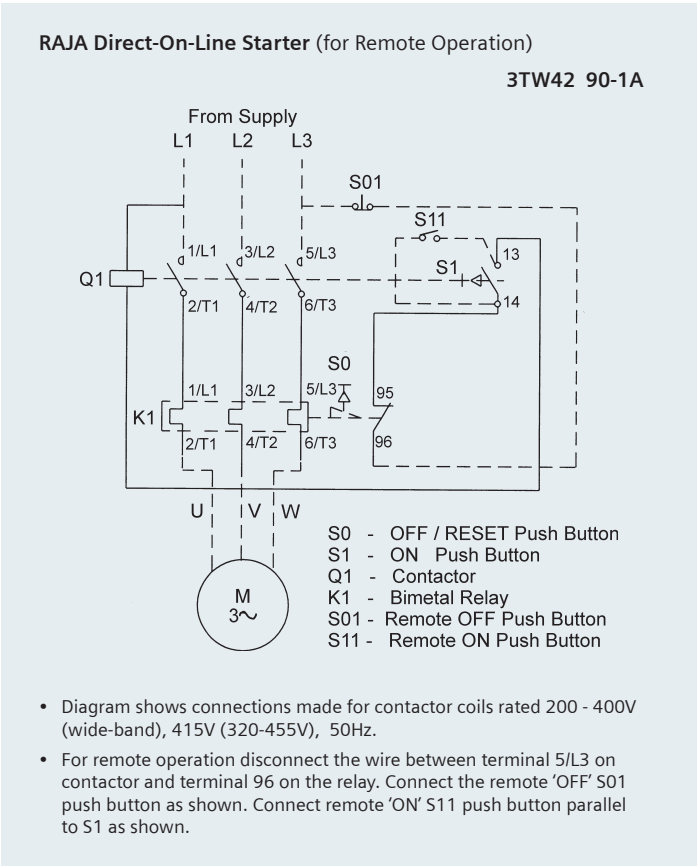

B2: Handle Operated Star delta starter

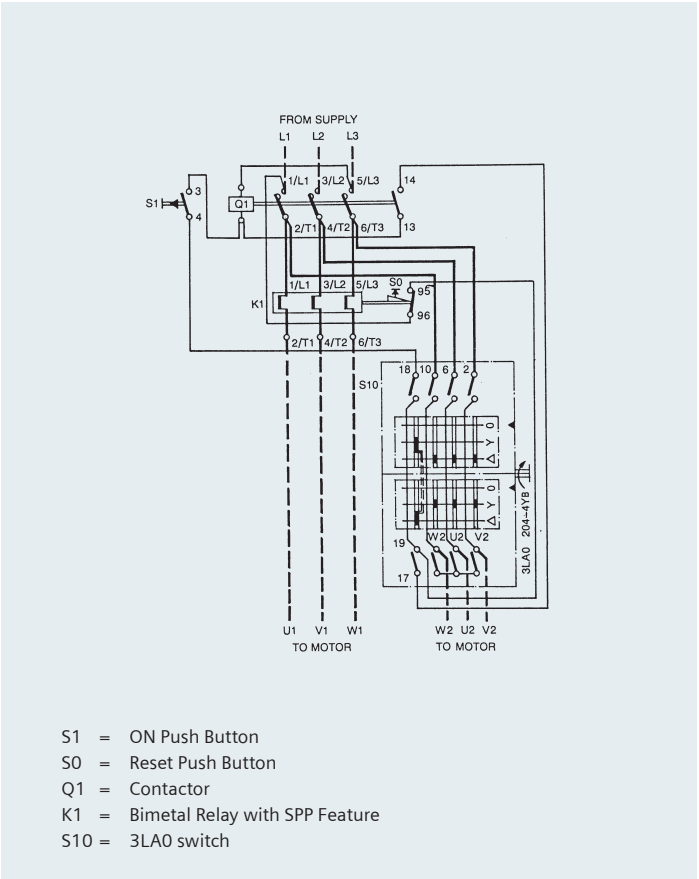


Star delta Starter

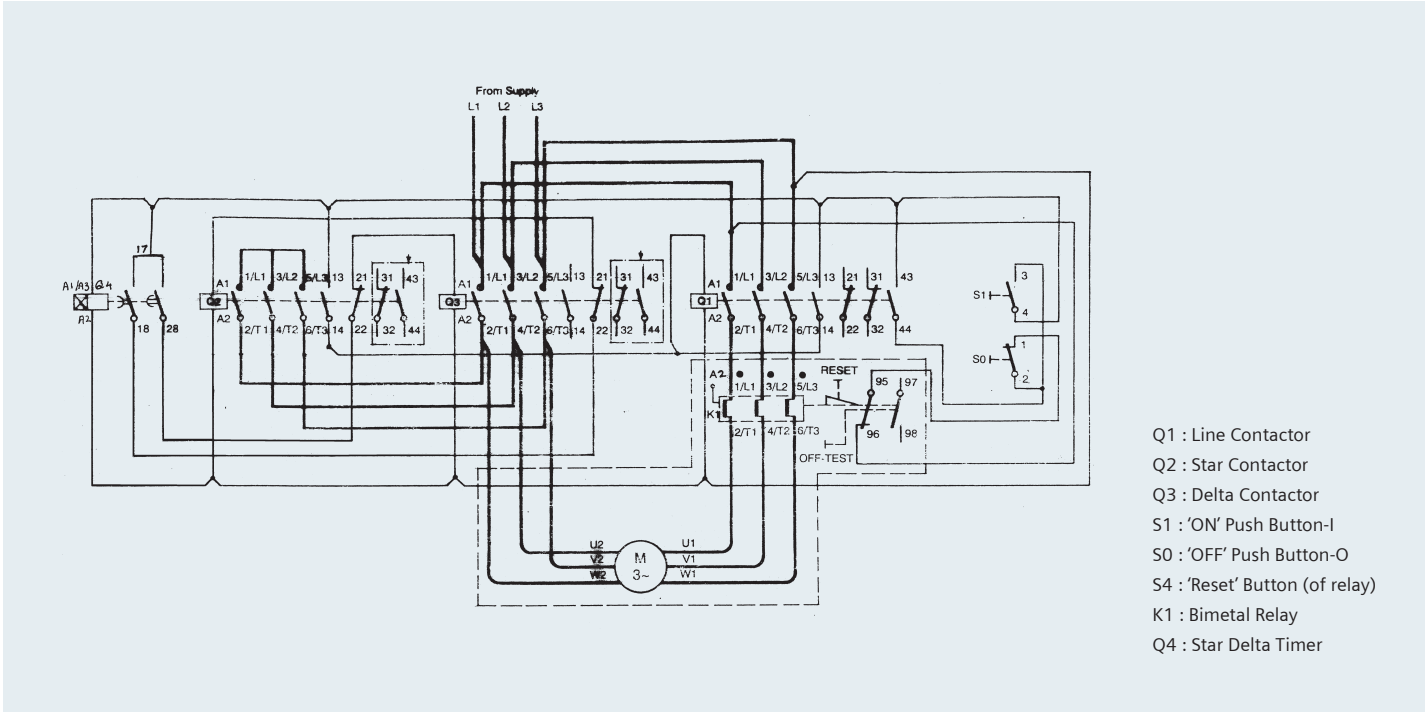


Dimensional drawings

RAJA DOL starter 3TW42

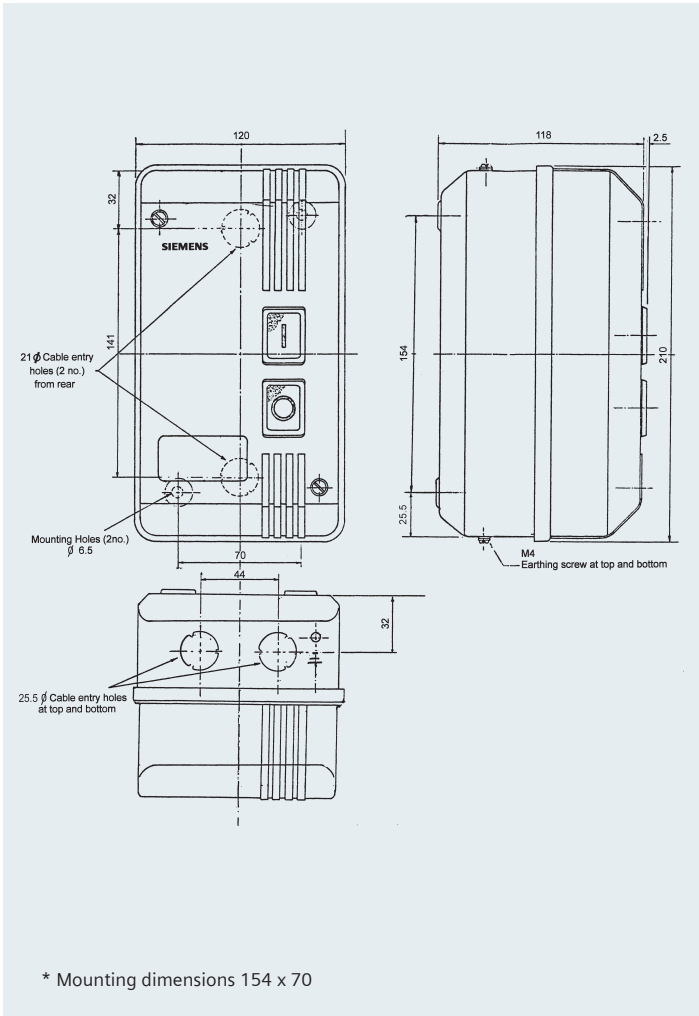


Handle operated Star delta starter 3LW4



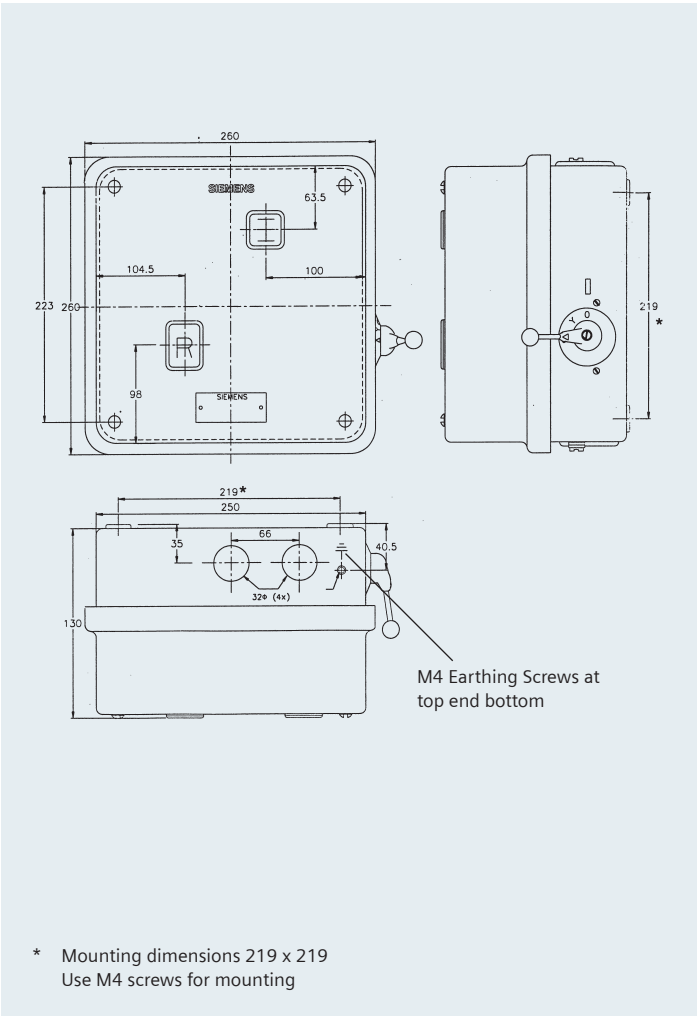






Fully automatic star delta starter 3TE02

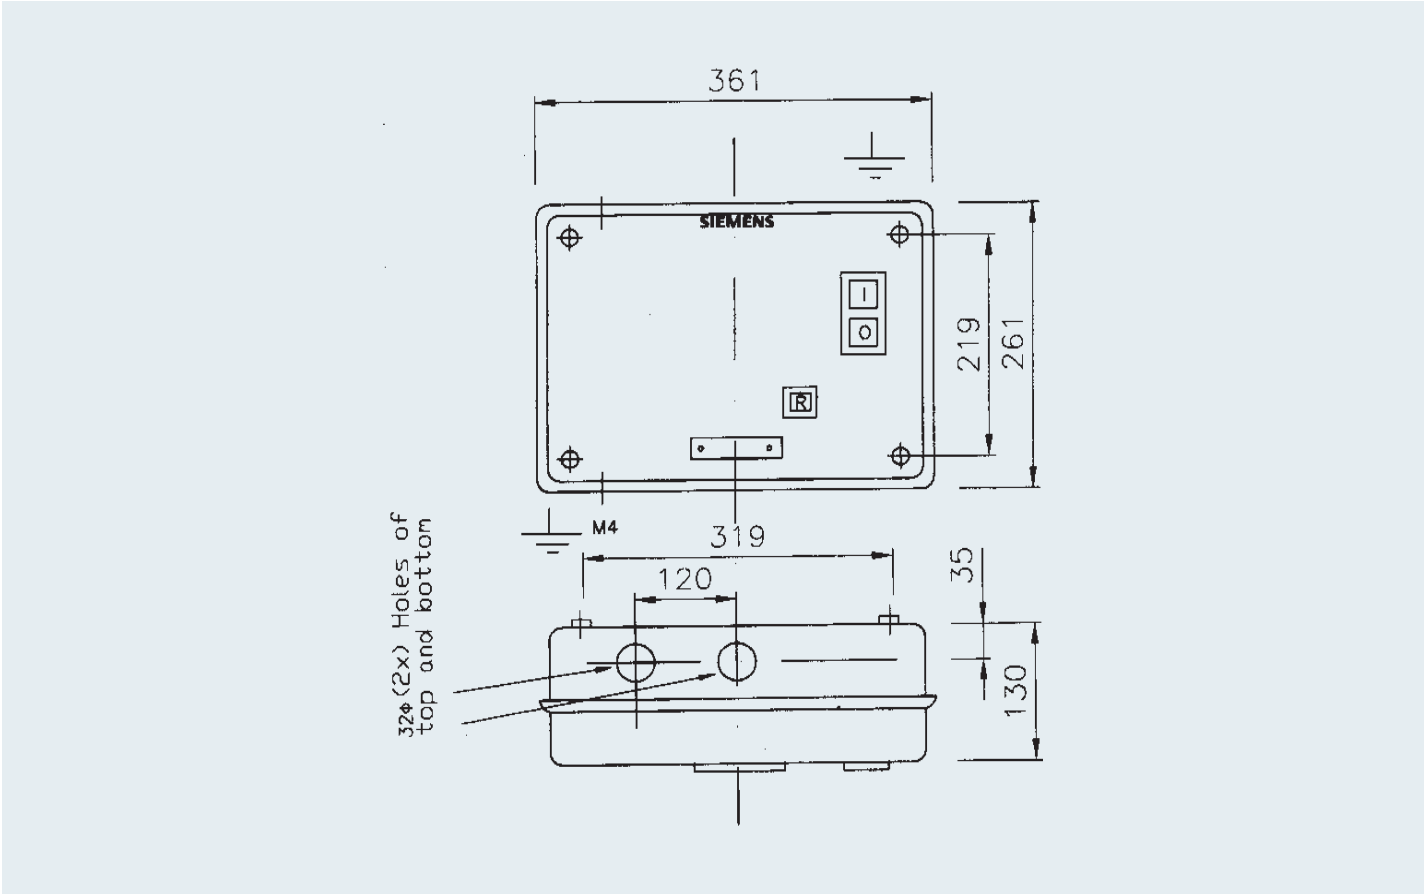


DOL without relay 3TW04

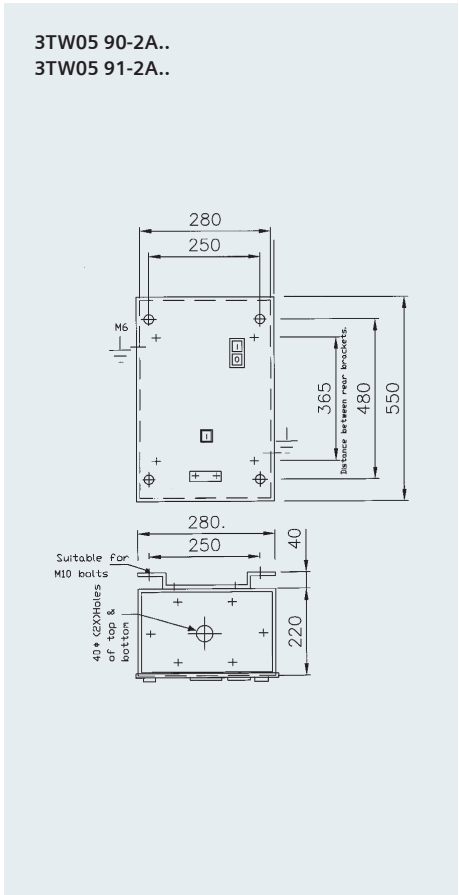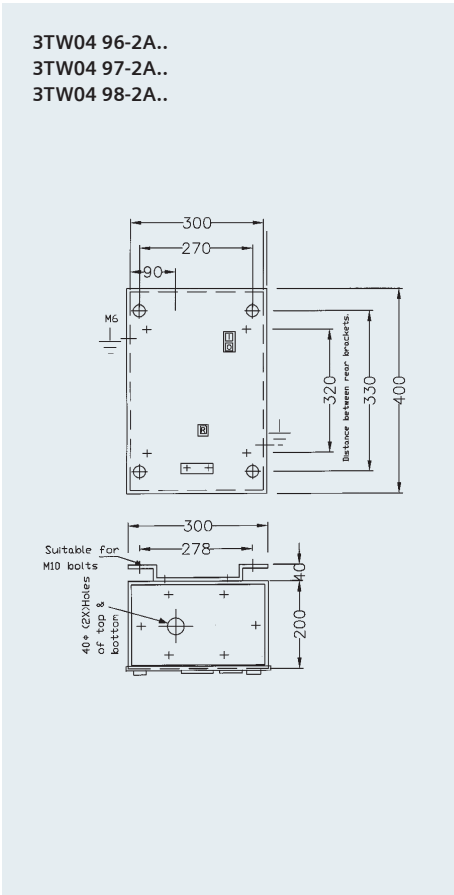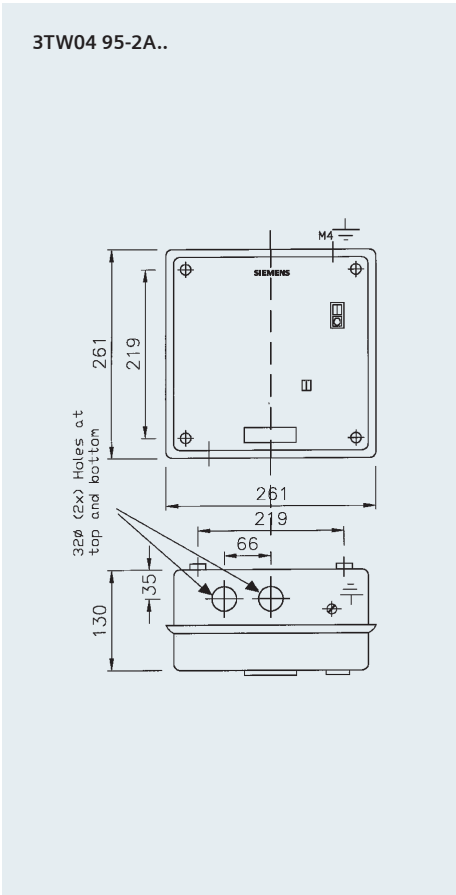

Fully automatic star delta starter with out bi relay (3TE04)

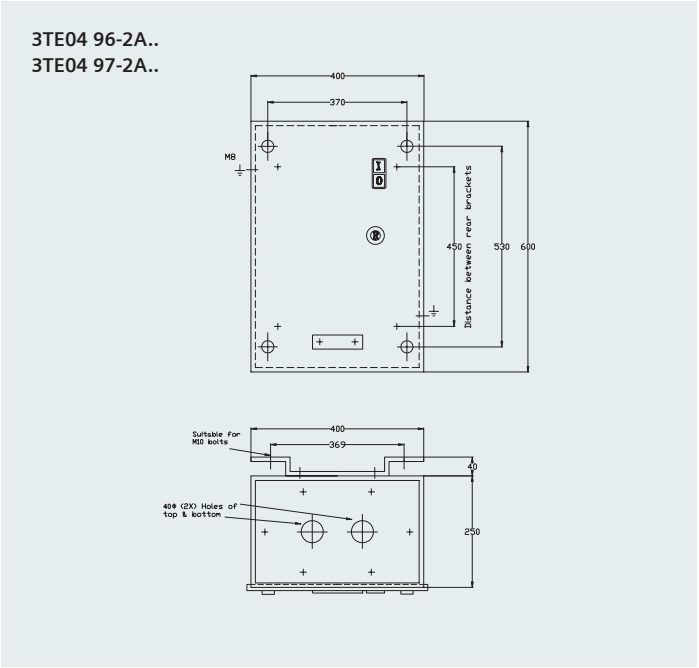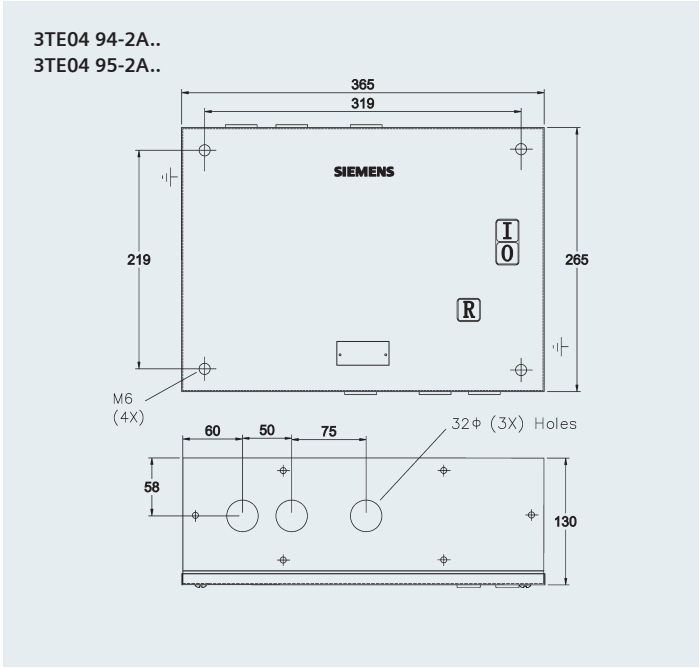


Fully automatic star delta starter with bi relay (3TE05)

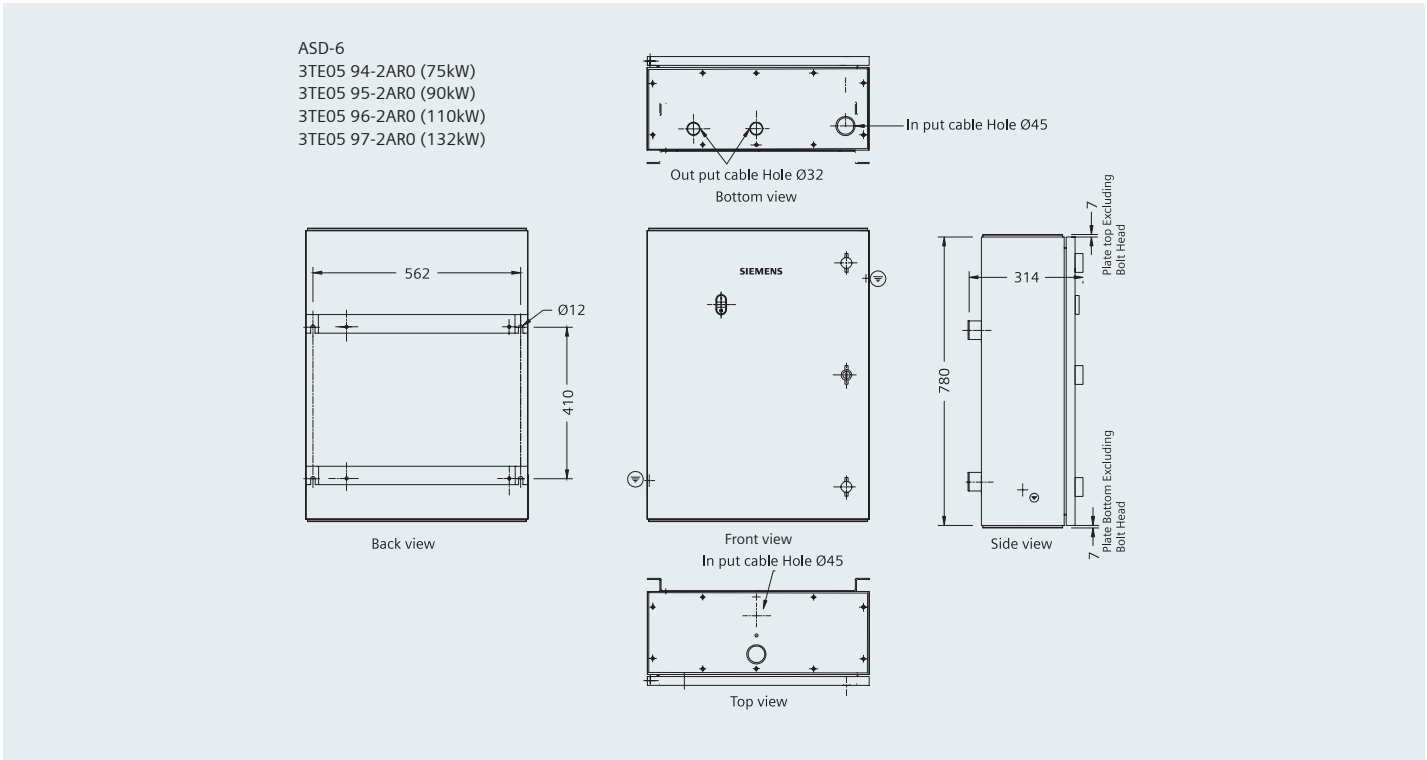

## Useful technical information

### Method of starting

#### A. DOL starting method:

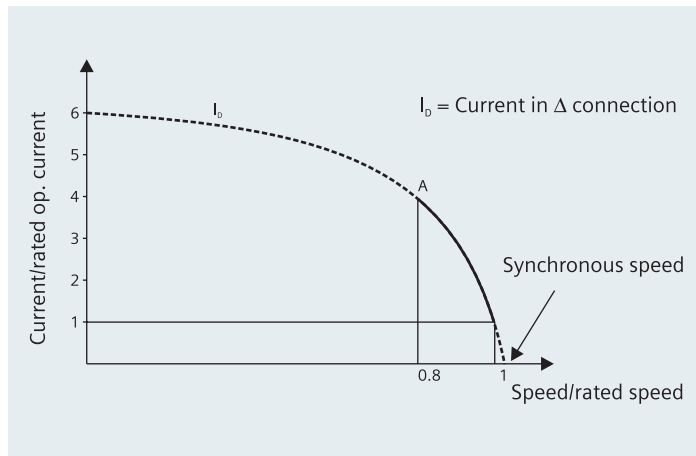

The most economical and popular method of starting squirrel cage induction motors, is direct-on-line, where the starter is connected directly across the supply. However, the starting current at the moment of switching Direct-on-line can be as high as 6-8 times the rated current.

**Advantages:** High starting torque, shorter starting time, simple construction and wiring, space saving etc.

**Disadvantages:** High starting current

#### DOL: RAJA 3TW42

##### Construction



##### Contactor:

The DOL starter up to 10 HP is fitted with 3TW02 contactor. This contactor is specially designed by Siemens considering the requirements of industry as well as agriculture. Considering the specific need of the agricultural pump set applications, Siemens has designed a special wide band coil (200- 400V). This coil operates reliably even when there is wide voltage fluctuation. The contact rating of this contactor is 20 A. This high contactor rating has made RAJA starter the most suitable starter for applications where current for given HP is higher than that of the conventional motors' e.g.. Submersible pumps etc.

#### DOL: 3TW04



This starter is similar to RAJA DOL starter with sheet steel housing (3TW42901A). In order to offer flexibility of selecting exact 3UA relay range by the customer, this starter has only provision for mounting the bi-relay but the birelay is not provided in the starter. Customer is required to select the suitable bi-relay and mount it in the starter before putting it in service.

##### Bimetal Overload Relay:

The RAJA direct-on-line starter is fitted with 3UW50 relay. These relays are computer calibrated and therefore, offer accurate protection. The main benefit of this bimetal relay is the built-in single phasing protection in addition to the overload protection. This relay is automatic reset type and can not be reset by hand.

##### Push buttons

Push buttons are used for switching 'ON' and 'OFF' the starter.

##### Operation:

In DOL starting, the 'ON' push button is pressed, which energizes the contactor coil, thus switching on the circuit. When the 'OFF' push button is pressed, the contactor is de-energized, switching off the circuit. The bimetal relay under normal functioning of motor plays no active part in the starter. But under overload, single phasing or locked rotor conditions of Motor, the bimetal relay cuts-off the supply to the contactor coil, tripping the circuit. The contactor itself provides the necessary 'no-voltage' protection in so far as it will drop out in the case of a supply failure, and for restarting on resumption of supply, the 'ON' push button will have to be pressed again.


#### B. Star delta starting method:

In star delta starting, initially the motor windings are connected in star. This reduces the starting current by  $1/\sqrt{3}$  rd of the full load current also the voltage by  $(1/\sqrt{3})$  of the rated value. As the torque is proportional to the square of the voltage, the starting torque also get reduced to  $1/3$  rd of it's full load value. Once the motor attains approximately 80% of the rated speed, the windings get connected in the delta formation.

Thus by star delta starting, the starting current is reduced to 2 to 2.5 times the rated current unlike DOL starting, where it is 7 to 8 times of the rated current.

**Advantages:** low starting current

**Disadvantages:** Low / medium starting torque, longer starting time, less simpler construction and wiring, requires more space etc.

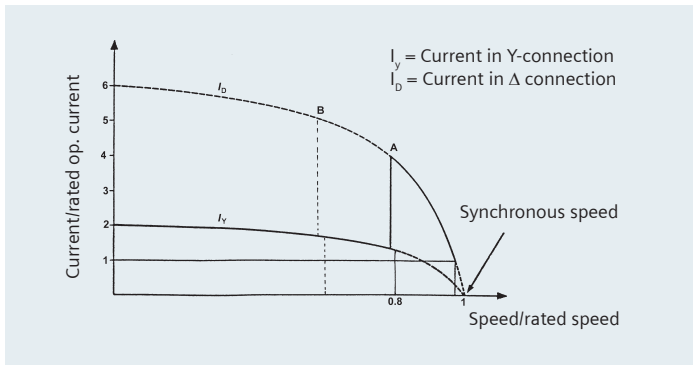

In this starter, the changeover from 'star' to 'delta' is done automatically after a preset time by using a timer.



#### B1. Handle Operated Star Delta Starter (3LW42)



In this starter, the changeover from 'star' to 'delta' is done manually through a control switch.

#### Construction:

It consists of a star-delta switch (3LAO), contactor (3TW02), an overload relay (3UW50), "Reset" push button and a safety 'ON' push button.

#### Operation:

To start the motor, move the 3LAO switch handle from 'O' position to 'star' (Y) position with the right hand and press the start' - (I) push button with your left hand. The motor starts and when it has almost come to its rated speed (indicated when the motor hum reaches a steady pitch), turn the handle to 'delta' position, still ensure to keep the push button pressed. After switching to delta, the push button and the switch handle can be released. To stop the motor, bring the handle of the switch to 'O' position. If the starter trips automatically due to any fault, the switch handle is first to be brought to 'O' position and the bimetal relay has to be reset.

#### ASD: 3TE04 and 3TE05

These starters are similar to star delta starter (3TE02). 3TE04 starters offers flexibility of selection of 3UA relays. The new range extension starters of ASD 3TE05 starters come with inbuilt bi relays.



Fuse protected selection type 2, Iq = 50kA, IS/IEC: 60947-4-1

- The selection is valid only for complete Siemens combinations i.e. SDF + DIN Fuse + Contactor + Birelay (+ timer).
- In case this combination is changed to accommodate another brand/rating of SDF/DIN Fuse/Contactor/BMR, it shall be the responsibility of the person making such a change to assure type 2 performance.
- Selection is for **normal starting** conditions with starting time ≤ 6 seconds. For **heavy starting** applications (e.g. ID/FD fans, reciprocating compressors, ball mills etc.), please **consult Siemens**.
- At 60°C service temperature the bi-relay has to be derated. The bi-relay can be used upto the maximum current setting indicated. For example - A bi-relay with setting 32-50A, at 60°C can be used only upto 47A. This however does not mean that at 60°C, the 50A setting corresponds to 47A. It means that, the bi-relay should not be set beyond 47A.
- The electronic star-delta timer type 3RP should be used in star-delta feeders.
- SDF: Switch Disconnecter Fuse. All fuses are DIN HRC type.
- Tested Type 2 combinations
- Low LCC = Low Life Cycle Cost

Direct-on-line feeder, for Low LCC

SL Motor	Motor	SDF		HRC Fuse		Contactor		Bi-Relay		Bi-Relay	
kW/HP 415V, 3ph, 50Hz	I <sub>L</sub> Amp	Type	Rating	Type 3NA7	Amp	Type	Amp	Type (50°C)	Set-Range Amp	Type (60°C)	Available Set-Range Amp
0.37/0.5	1	3KL811	20	3NA7804	4	3TF30	9	3UA5000-0K	0.8 - 1.25	3UA5000-0K	0.8 - 1.17
0.55/0.75	1.3	3KL811	20	3NA7804	4	3TF30	9	3UA5000-1A	1 - 1.6	3UA5000-1A	1 - 1.5
0.75/1	1.9	3KL811	20	3NA7801	6	3TF30	9	3UA5000-1B	1.25 - 2	3UA5000-1C	1.6 - 2.3
1.1/1.5	2.6	3KL811	20	3NA7801	6	3TF30	9	3UA5000-1D	2 - 3.2	3UA5000-1D	2 - 3
1.5/2	3.7	3KL811	20	3NA7803	10	3TF30	9	3UA5000-1E	2.5 - 4	3UA5000-1E	2.5 - 3.7
2.2/3	4.8	3KL811	20	3NA7805	16	3TF30	9	3UA5000-1F	3.2 - 5	3UA5000-1G	4 - 5.9
3.7/5	7.8	3KL811	20	3NA7807	20	3TF30	9	3UA5000-1H	5 - 8	3UA5000-1J	6.3 - 9.4
5.5/7.5	11.2	3KL812	32	3NA7810	25	3TF31	12	3UA5000-1K	8 - 12.5	3UA5000-1K	8 - 11.7
7.5/10	16	3KL812	32	3NA7812	32	3TF32	16	3UA5200-2A	10 - 16	3UA5200-2B	12.5 - 18.7
9.3/12.5	19	3KL815	63	3NA7820	50	3TF34	32	3UA5500-2B	12.5 - 20	3UA5500-2C	16 - 23.4
11/15	20.8	3KL815	63	3NA7820	50	3TF34	32	3UA5500-2C	16 - 25	3UA5500-2C	16 - 23.4
15/20	28	3KL815	63	3NA7822	63	3TF34	32	3UA5500-2D	20 - 32	3UA5500-2D	20 - 30
18.5/25	34	3KL815	63	3NA7822	63	3TF35	38	3UA5500-2Q	25 - 36	3UA5500-2R	32 - 37.4
22/30	40	3KL821	100	3NA7824	80	3TF46	45	3UA5800-2FZ1	32 - 50	3UA5800-2FZ1	32 - 47
30/40	53	3KL821	100	3NA7830	100	3TF47	63	3UA5800-2TZ1	40 - 57	3UA5800-2PZ1	50 - 59
37/50	65	3KL822	125	3NA7832	125	3TF477	70	3UA5800-2VZ2	57 - 70	3UA5800-2VZ2	57 - 65.5
45/60	78	3KL822	125	3NA7832	125	3TF49	85	3UA5800-8YZ1	70 - 95	3UA5800-8YZ1	70 - 88.9
55/75	96	3KL823	160	3NA7836	160	3TF50	110	3UA5830-5C	85 - 105	3UA5830-5C	85 - 98.2
75/100	131	3KL831	200	3NA7140	200	3TF51	140	3UA6230-5A	85 - 135	3UA6230-5B	115 - 168
90/125	156	3KL832	250	3NA7144	250	3TF52	170	3UA6230-5B	115 - 180	3UA6230-5B	115 - 168
110/150	189	3KL832	250	3NA7144	250	3TF53	205	3UA6230-5C	160 - 250	3UA6230-5C	160 - 234
132/180	227	3KL833	315	3NA7252	315	3TF54	250	3UA6230-5D	160 - 250	3UA6230-5C	160 - 234
160/215	271	3KL834	400	3NA7260	400	3TF55	300	3UA6230-5D	200 - 320	3UA6230-5D	200 - 299
200/270	339	3KL841	500	3NA7365	500	3TF56	400	3UA6230-5E	250 - 400	3UA6230-5E	250 - 374
250/335	398	3KL841	500	3NA7365	500	3TF57	475	3UA6830-3F	320 - 500	3UA6830-5F	320 - 468

Star-Delta feeder, for Low LCC

SL Motor	Motor		SDF		HRC Fuses		Contactor Line/Delta		Contactor Star		Bi-Relay		Bi-Relay		Timer
kW/HP 415V, 3ph, 50Hz	I <sub>L</sub> Amp.	I <sub>ph</sub> Amp	Type	Rating	Type 3NA7	Amp	Type	Amp	Type	Amp	Type (50°C)	Set-Range Amp	Type (60°C)	Available Set-Range Amp	Type
2.2/3	4.8	2.8	3KL811	20	3NA7801	6	3TF30	9	3TF30	9	3UA5000-1D	2-3.2	3UA5000-1D	2-3	3RP15
3.7/5	7.8	4.5	3KL811	20	3NA7803	10	3TF30	9	3TF30	9	3UA5000-1F	3.2-5	3UA5000-1F	3.2-4.7	3RP15
5.5/7.5	11.2	6.5	3KL811	20	3NA7805	16	3TF30	9	3TF30	9	3UA5000-1H	5-8	3UA5000-1H	5-7.5	3RP15
7.5/10	16	9.2	3KL811	20	3NA7807	20	3TF31	12	3TF30	9	3UA5000-1J	6.3-10	3UA5000-1J	6.3-9.4	3RP15
9.3/12.5	19	11	3KL812	32	3NA7810	25	3TF31	12	3TF30	9	3UA5000-1K	8-12.5	3UA5000-1K	8-11.7	3RP15
11/15	20.8	12	3KL812	32	3NA7810	25	3TF31	12	3TF30	9	3UA5000-1K	8-12.5	3UA5000-2S	10-13.6	3RP15
15/20	28	16.2	3KL812	32	3NA7812	32	3TF33	22	3TF32	16	3UA5200-2B	12.5-20	3UA5200-2B	12.5-18.7	3RP15
18.5/25	34	19.7	3KL815	63	3NA7820	50	3TF34	32	3TF34	32	3UA5500-2B	12.5-20	3UA5500-2C	16-23.4	3RP15
22/30	40	23.2	3KL815	63	3NA7820	50	3TF34	32	3TF34	32	3UA5500-2C	16-25	3UA5500-2D	22-30	3RP15
30/40	53	30.6	3KL815	63	3NA7822	63	3TF34	32	3TF34	32	3UA5500-2D	20-32	3UA5500-2Q	25-33.7	3RP15
37/50	65	37.5	3KL821	100	3NA7824	80	3TF35	38	3TF34	32	3UA5500-2R	32-40	3UA5500-8M	36-45	3RP15
45/60	78	45	3KL821	100	3NA7830	100	3TF46	45	3TF34	32	3UA5800-2FZ1	32-50	3UA5800-2FZ1	32-47	3RP15
55/75	96	55.4	3KL821	100	3NA7830	100	3TF47	63	3TF34	32	3UA5800-2TZ1	40-57	3UA5800-2PZ1	50-59	3RP15
75/100	131	75.6	3KL823	160	3NA7836	160	3TF49	85	3TF47	63	3UA5800-8YZ1	70-95	3UA5800-8YZ1	70-88.9	3RP15
90/125	156	90.1	3KL823	160	3NA7836	160	3TF50	110	3TF47	63	3UA5830-5B	70-95	3UA5830-5C	85-98.2	3RP15
110/150	189	109	3KL831	200	3NA7140	200	3TF50	110	3TF50	110	3UA5830-5D	95-120	3UA5830-5D	95-112	3RP15
132/180	227	131.1	3KL832	250	3NA7144	250	3TF51	140	3TF50	110	3UA6230-5B	115-180	3UA6230-5B	115-168	3RP15
160/215	271	156.5	3KL833	315	3NA7252	315	3TF52	170	3TF50	110	3UA6230-5B	115-180	3UA6230-5B	115-168	3RP15
200/270	339	195.7	3KL834	400	3NA7260	400	3TF54	250	3TF52	170	3UA6230-5C	160-250	3UA6230-5C	160-234	3RP15
250/335	398	229.8	3KL841	500	3NA7260	400	3TF54	250	3TF54	250	3UA6230-5C	160-250	3UA6230-5D	200-299	3RP15

Fuseless selection type 2, Iq = 50kA, IS/IEC: 60947-4-1

- The selection is valid only for complete Siemens combinations i.e. MPCB / MCCB + contactor + bi-relay (+timer).
- In case this combination is changed to accommodate another brand/rating of MPCB/MCCB/contactor/BMR, it shall be the responsibility of the person making such a change to assure Type 2 performance.
- Selection is for **normal starting** conditions with starting time ≤ 6 seconds. For **heavy starting** applications (e.g. ID/FD fans, reciprocating compressors, ball mills etc.), please **consult Siemens**.
- The **electronic star-delta timer type 3RP** should be used in star-delta feeders.
- Truly tested Type 2 combinations at neutral authorities.
- Low LCC = Low life cycle cost

Direct-on-line feeder, for low LCC

SL motor		Circuit breaker		Contactor		Bi-relay	
kW/HP 415V, 3ph, 50Hz	I <sub>L</sub> A	Type	A	Type	A	Type (50°C)	Range (A)
0.37/0.5	1	3RV11 21-0KA10	1.25	3TF30	9	#	0.9 - 1.25
0.55/0.75	1.3	3RV11 21-1AA10	1.6	3TF30	9	#	1.1 - 1.6
0.75/1	1.9	3RV11 21-1BA10	2	3TF30	9	#	1.4 - 2
1.1/1.5	2.6	3RV11 21-1DA10	3.2	3TF31	12	#	2.2 - 3.2
1.5/2	3.7	3RV11 21-1EA10	4	3TF32	16	#	2.8 - 4
2.2/3	4.8	3RV11 21-1FA10	5	3TF32	16	#	3.5 - 5
3.7/5	7.8	3RV11 21-1HA10	8	3TF32	16	#	5.5 - 8
5.5/7.5	11.2	3RV11 21-1KA10	12.5	3TF34	32	#	9 - 12.5
7.5/10	16	3RV11 21-4AA10	16	3TF34	32	#	11 - 16
9.3/12.5	19	3RV11 21-4BA10	20	3TF34	32	#	14 - 20
11/15	20.8	3RV11 21-4CA10	22	3TF34	32	#	17 - 22
15/20	28	3RV11 31-4EA10	32	3TF35	38	#	22 - 32
18.5/25	34	3RV11 31-4FA10	40	3TF46	45	#	28 - 40
22/30	40	3RV11 31-4GA10	45	3TF48	75	#	36 - 45
30/40	53	3RV11 42-4JA10	63	3TF48	75	#	45 - 63
37/50	65	3RV11 42-4KA10	75	3TF50	110	#	57 - 75
45/60	78	3RV11 42-4LA10	90	3TF50	110	#	70 - 90
55/75	96	3RV11 42-4MA10	100	3TF52	170	#	80 - 100
75/100	131	3VL27 16-1DK36-0AA0	160	3TF52	170	3UA62 30-5A	85-135
90/125	156	3VL37 25-1DK36-0AA0	250	3TF53	205	3UA62 30-5B	115-180
110/150	189	3VL37 25-1DK36-0AA0	250	3TF53	205	3UA62 30-5C	160 - 250
132/180	227	3VL37 25-1DK36-0AA0	250	3TF54	250	3UA62 30-5C	160 - 250
160/215	271	3VL47 31-1DK36-0AA0	315	3TF55	300	3UA62 30-5D	200 - 320
200/270	339	3VL57 50-1DK36-0AA0	500	3TF57	475	3UA62 30-5E	250 - 400
250/335	398	3VL57 50-1DK36-0AA0	500	3TF57	475	3UA68 30-5F	320 - 500

# 3RV11 comes with integral relay function, hence external birelay is eliminated. MPCB with 'standard release' can also be used.

Star-delta feeder, for low LCC

SL motor			Circuit breaker		Contactor line/delta		Contactor star		Bi-relay		Timer
kW/HP 415V, 3ph, 50Hz	I <sub>L</sub> A	I <sub>ph</sub> A	Type	A	Type	A	Type	A	Type (50°C)	Range (A)	Type
2.2/3	4.8	2.8	3RV13 21-1FC10	5	3TF32	16	3TF30	9	3UA52 00-1D	2 - 3.2	3RP15
3.7/5	7.8	4.5	3RV13 21-1HC10	8	3TF32	16	3TF30	9	3UA52 00-1F	3.2 - 5	3RP15
5.5/7.5	11.2	6.5	3RV13 21-1KC10	12.5	3TF34	32	3TF30	9	3UA52 00-1H	5 - 8	3RP15
7.5/10	16	9.2	3RV13 21-4AC10	16	3TF34	32	3TF30	9	3UA52 00-1J	6.3 - 10	3RP15
9.3/12.5	19	11	3RV13 21-4CC10	22	3TF34	32	3TF30	9	3UA52 00-1K	8 - 12.5	3RP15
11/15	20.8	12	3RV13 21-4CC10	22	3TF34	32	3TF30	9	3UA52 00-1K	8 - 12.5	3RP15
15/20	28	16.2	3RV13 31-4EC10	32	3TF35	38	3TF32	16	3UA52 00-2B	12.5 - 20	3RP15
18.5/25	34	19.7	3RV13 31-4FC10	40	3TF46	45	3TF34	32	3UA52 00-2C	16 - 25	3RP15
22/30	40	23.2	3RV13 31-4GC10	45	3TF48	75	3TF34	32	3UA52 00-2C	16 - 25	3RP15
30/40	53	30.6	3RV13 41-4JC10	63	3TF48	75	3TF34	32	3UA55 00-2D	20 - 32	3RP15
37/50	65	37.5	3RV13 41-4KC10	75	3TF50	110	3TF34	32	3UA55 00-2R	32 - 40	3RP15
45/60	78	45	3RV13 41-4LC10	90	3TF50	110	3TF34	32	3UA55 00-8M	36 - 45	3RP15
55/75	96	55.4	3RV13 41-4MC10	100	3TF52	170	3TF34	32	3UA58 00-2TZ1	40 - 57	3RP15
75/100	131	75.6	3VL27 16-1DK36-0AA0	160	3TF52	170	3TF47	63	3UA58 00-8YZ1	70 - 95	3RP15
90/125	156	90.1	3VL37 25-1DK36-0AA0	250	3TF53	205	3TF47	63	3UA58 30-5B	70 - 95	3RP15
110/150	189	109	3VL37 25-1DK36-0AA0	250	3TF53	205	3TF50	110	3UA58 30-5D	95 - 120	3RP15
132/180	227	131.1	3VL37 25-1DK36-0AA0	250	3TF54	250	3TF50	110	3UA62 30-5B	115 - 180	3RP15
160/215	271	156.5	3VL47 31-1DK36-0AA0	315	3TF55	300	3TF50	110	3UA62 30-5B	115 - 180	3RP15
200/270	339	195.7	3VL57 50-1DK36-0AA0	500	3TF57	475	3TF52	170	3UA62 30-5C	160 - 250	3RP15
250/335	398	229.8	3VL57 50-1DK36-0AA0	500	3TF57	475	3TF54	250	3UA62 30-5D	160 - 250	3RP15



Recommended Selection of Switchgear for Autotransformer Starter - Fuseless

SL Motor, 415V, 3Ph, 50Hz		MPCB / MCCB*		Line contactor K3		Transformer contactor K2 for Tranformer tapping % star contactor K1 = same as transformer contactor K2								Overload Relay	
kW / HP	I <sub>L</sub> Amp	MLFB	Range Amp	Type	A	80%		70%		65%		50%		Type	A
						Type	A	Type	A	Type	A	Type	A		
2.2 / 3	4.8	3RV10211FC10	5	3TF30	9	3TF30	9	3TF30	9	3TF30	9	3TF30	9	–	–
3.7 / 5	7.8	3RV10211HC10	8	3TF30	9	3TF30	9	3TF30	9	3TF30	9	3TF30	9	–	–
5.5 / 7.5	11.2	3RV10211KC10	12.5	3TF31	12	3TF30	9	3TF30	9	3TF30	9	3TF30	9	–	–
7.5 / 10	16	3RV10214AC10	16	3TF32	16	3TF31	12	3TF30	9	3TF30	9	3TF30	9	–	–
9.3 / 12.5	19	3RV10214BC10	20	3TF33	16	3TF32	16	3TF31	12	3TF30	9	3TF30	9	–	–
11 / 15	20.8	3RV10214CC10	22	3TF33	22	3TF32	16	3TF31	12	3TF31	12	3TF30	9	–	–
15 / 20	28	3RV10314EC10	32	3TF34	32	3TF33	22	3TF32	16	3TF32	16	3TF30	9	–	–
18.5 / 25	34	3RV10314FC10	40	3TF35	38	3TF34	32	3TF33	22	3TF32	16	3TF31	12	–	–
22 / 30	40	3RV10314GC10	45	3TF46	45	3TF34	32	3TF33	22	3TF33	22	3TF31	12	–	–
30 / 40	53	3RV10414JC10	63	3TF47	63	3TF35	38	3TF34	32	3TF34	32	3TF32	16	–	–
37 / 50	65	3RV10414KC10	75	3TF477	70	3TF46	45	3TF35	38	3TF34	32	3TF33	22	–	–
45 / 60	78	3RV10414LC10	90	3TF49	85	3TF47	63	3TF46	45	3TF35	38	3TF34	32	–	–
55 / 75	96	3RV10414MC10	100	3TF50	110	3TF477	70	3TF47	63	3TF46	45	3TF34	32	–	–
75 / 100	131	3VL2716-1DK36-0AA0	160	3TF51	140	3TF49	85	3TF48	75	3TF47	63	3TF46	45	3UA6230-5A	85 - 135
90 / 125	156	3VL3725-1DK36-0AA0	250	3TF52	170	3TF50	110	3TF49	85	3TF477	70	3TF47	63	3UA6230-5B	115 - 180
110 / 150	189	3VL3725-1DK36-0AA0	250	3TF53	205	3TF51	140	3TF50	110	3TF49	85	3TF47	63	3UA6230-5C	160 - 250
132 / 180	227	3VL3725-1DK36-0AA0	250	3TF54	250	3TF52	170	3TF51	140	3TF50	110	3TF477	70	3UA6230-5C	160 - 250
160 / 215	271	3VL4740-1DK36-0AA0	400	3TF55	300	3TF53	205	3TF51	140	3TF51	140	3TF50	110	3UA6230-5D	200 - 320
200 / 270	339	3VL4740-1DK36-0AA0	400	3TF56	400	3TF54	250	3TF52	170	3TF52	170	3TF50	110	3UA6230-5E	250 - 400
250 / 335	398	3VL5763-2DK36-0AA0	630	3TF57	475	3TF55	300	3TF53	205	3TF53	205	3TF51	140	3UA6830-3F	320 - 500

- \* 3RV10 MBCC comes with built in overload protection hence no need to use an external overload relay; 3RV13 Mag only MPCB can also be used, however an external overload relay is required

  - Please use Electronic Star delta time type 3RP15 for the changeover from star to main.
  - Selection valid for Normal starting of the motors with starting time upto 10 seconds
- Minimum auxiliary contacts for K1= 1NO+1NC, for K2=1NO, for K3=1NC and for contactor relay K5=2NO
  - Selection for higher ratings upon request.

Recommended Selection of Switchgear for Autotransformer Starter - Fuse Protected

SL Motor, 415V, 3Ph, 50Hz		SDF		FUSE		Line contactor K3		Transformer contactor K2 for Tranformer tapping % star contactor K1 = same as transformer contactor K2								Overload Relay	
kW / HP	I <sub>L</sub> Amp	MLFB	Rating Amp	MLFB	Rating Amp	Type	A	80%		70%		65%		50%		Type	A
								Type	A	Type	A	Type	A	Type	A		
2.2 / 3	4.8	3KL812	32	3NA78010RC	6	3TF30	9	3TF30	9	3TF30	9	3TF30	9	3TF30	9	3UA5000-1F	3.2 - 5
3.7 / 5	7.8	3KL812	32	3NA78030RC	10	3TF30	9	3TF30	9	3TF30	9	3TF30	9	3TF30	9	3UA5000-1H	5 - 8
5.5 / 7.5	11.2	3KL812	32	3NA78050RC	16	3TF31	12	3TF30	9	3TF30	9	3TF30	9	3TF30	9	3UA5000-1K	8 - 12.5
7.5 / 10	16	3KL812	32	3NA78070RC	20	3TF32	16	3TF31	12	3TF30	9	3TF30	9	3TF30	9	3UA5200-2A	10 - 16
9.3 / 12.5	19	3KL812	32	3NA78100RC	25	3TF33	16	3TF32	16	3TF31	12	3TF30	9	3TF30	9	3UA5500-2B	12.5 - 20
11 / 15	20.8	3KL812	32	3NA78100RC	25	3TF33	22	3TF32	16	3TF31	12	3TF31	12	3TF30	9	3UA5500-2C	16 - 25
15 / 20	28	3KL815	63	3NA78120RC	32	3TF34	32	3TF33	22	3TF32	16	3TF32	16	3TF30	9	3UA5500-2D	20 - 32
18.5 / 25	34	3KL815	63	3NA78200RC	50	3TF35	38	3TF34	32	3TF33	22	3TF32	16	3TF31	12	3UA5500-2Q	25 - 36
22 / 30	40	3KL815	63	3NA78200RC	50	3TF46	45	3TF34	32	3TF33	22	3TF33	22	3TF31	12	3UA5800-2FZ1	32 - 50
30 / 40	53	3KL815	63	3NA78220RC	63	3TF47	63	3TF35	38	3TF34	32	3TF34	32	3TF32	16	3UA5800-2TZ1	40 - 57
37 / 50	65	3KL821	100	3NA78240RC	80	3TF477	70	3TF46	45	3TF35	38	3TF34	32	3TF33	22	3UA5800-2VZ1	57 - 70
45 / 60	78	3KL821	100	3NA78300RC	100	3TF49	85	3TF47	63	3TF46	45	3TF35	38	3TF34	32	3UA5800-8YZ1	70 - 95
55 / 75	96	3KL821	100	3NA78300RC	100	3TF50	110	3TF477	70	3TF47	63	3TF46	45	3TF34	32	3UA5830-5C	85 - 105
75 / 100	131	3KL831	200	3NA78360RC	160	3TF51	140	3TF49	85	3TF48	75	3TF47	63	3TF46	45	3UA6230-5A	85 - 135
90 / 125	156	3KL831	200	3NA78360RC	160	3TF52	170	3TF50	110	3TF49	85	3TF477	70	3TF47	63	3UA6230-5B	115 - 180
110 / 150	189	3KL831	200	3NA71400RC	200	3TF53	205	3TF51	140	3TF50	110	3TF49	85	3TF47	63	3UA6230-5C	160 - 250
132 / 180	227	3KL832	250	3NA71440RC	250	3TF54	250	3TF52	170	3TF51	140	3TF50	110	3TF477	70	3UA6230-5C	160 - 250
160 / 215	271	3KL833	315	3NA72520RC	315	3TF55	300	3TF53	205	3TF51	140	3TF51	140	3TF50	110	3UA6230-5D	200 - 320
200 / 270	339	3KL834	400	3NA72600RC	400	3TF56	400	3TF54	250	3TF52	170	3TF52	170	3TF50	110	3UA6230-5E	250 - 400
250 / 335	398	3KL834	400	3NA72600RC	400	3TF57	475	3TF55	300	3TF53	205	3TF53	205	3TF51	140	3UA6830-3F	320 - 500

- Please use Electronic Star delta time type 3RP15 for the changeover from star to main.
  - Selection valid for Normal starting of the motors with starting time upto 10 seconds
- Minimum auxiliary contacts for K1= 1NO+1NC, for K2=1NO, for K3=1NC and for contactor relay K5=2NO
  - Selection for higher ratings upon request.



# Your partners

## Sales offices:

**Ahmedabad**  
Mobile: +91 9617934328  
E-mail: kiran.kanhurkar@siemens.com

**Baroda**  
Mobile: +91 9925001779  
E-mail: chandrakant.keshrani@siemens.com

**Bengaluru**  
1st Floor, Jyoti Mahal  
No. 49, St. Marks Rd.  
Bengaluru - 560 001  
☎ : +91 80 33422000  
Fax: +91 80 33424131

**Bhubaneswar**  
Mobile: +91 7894436373  
E-mail: somnath.manna@siemens.com

**Chandigarh**  
Mobile: +91 9888484066  
E-mail: padam.sharma@siemens.com

**Chennai**  
4th Floor, ETA Mount Central  
Seethakathi Business Centre  
Mount Road  
Chennai - 600006  
☎ : +91 44 30474000  
Fax: +91 44 30474080

**Coimbatore**  
Mobile: +91 9849001842  
E-mail: pramod.krishna@siemens.com

**Gurgaon**  
Plot No. - 78, Tower - B  
Jagatjit Industries Building (JIL)  
Opposite SBI Academy, Sector-18  
Gurgaon - 122015  
☎ : +91 124 2842000, 3810200

**Hyderabad**  
Mobile: +91 9849111875  
E-mail: pv.ravikiran@siemens.com

**Jaipur**  
Mobile: +91 9815502480  
E-mail: rohit.jagga@siemens.com

**Jamshedpur**  
Mobile: +91 8294052647  
E-mail: shyamal.bhattacharyya@siemens.com

**Kolkata**  
3rd Floor, 43, Shanti Palli  
Rashbihari Bypass Connector  
Kolkata - 700042, India  
☎ : +91 33 30939000  
Fax: +91 33 30939010

**Lucknow**  
Mobile: +91 9619856025  
E-mail: jain.vikas@siemens.com

**Mumbai**  
Business Centre-1  
Kalwa Works  
Thane Belapur Road  
Thane - 400 601  
☎ : +91 22 39663000  
Fax: +91 22 39663721

**Nagpur**  
Mobile: +91 9930182128  
E-mail: muzafter.sayed@siemens.com

**Pune**  
Tower C, Panchshil Business Park  
Survey No. 20, Balewadi  
Pune - 411045  
☎ : +91 20 30466000  
Fax: +91 20 30466060

**Vizag**  
Mobile: +91 9701354777  
E-mail: vijaykiran.meduri@siemens.com

## Territory managers:

**Agra**  
Flat No 303, Dwarka Apartment  
Near Hanuman Mandir Crossing  
Bhagirathi Road, Khlandari  
Agra - 282002  
Mobile: +91 7800960310  
E-mail: tiwari.mayank@siemens.com

**Aurangabad**  
Flat No 811/03, Manjeet Pride Primo  
Mahanubahv Ashram Chowk  
Beed By-Pass, Aurnagabad - 531005  
Mobile: +91 8889911401  
E-mail: bhadauria.amit@siemens.com

**Belgaum**  
Anuragh Bungalow No. 2, Plot No. 7  
CTS No. 3109, RS No. 57/2/1, Cross No. 7  
Near Shanbag / Bhandari School  
Bhagya Nagar, Angol, Belgavi  
Karnataka - 590006  
Mobile: +91 97402277991  
Tel.: +91 0831 2495156  
E-mail: anand.gawade@siemens.com

**Belgaum**  
Flat No. 201, 2nd Floor  
Harimanor Apartment, 1st Cross  
Bhagya Nagar, Angol Extension, Belgavi  
Karnataka - 590006  
Mobile: +91 8105592066  
E-mail: siddu.mareguddi@siemens.com

**Belgaum**  
S4 Gokul Vrindavan Apartment  
8th Cross, Bhagya Nagar, Angol, Belgavi  
Karnataka - 590006  
Mobile: +91 7259400100  
E-mail: prathish.t.m@siemens.com

**Bharuch**  
Gold B, 804, Samruddhi Residency  
Opp. Zadeshwar Bus Stop  
Zadeshwar Road, Bharuch - 392011  
Mobile: +91 9429037805  
E-mail: kalpeshkumar.darji@siemens.com

**Bhilai**  
Flat No. 38/ E Block  
Chouhan Green Valley, Junwani  
Bhilai (CG) - 490020  
Mobile: +91 7869922211  
E-mail: pravin.deshbhatar@siemens.com

**Bhopal**  
A-111 Shahpura, Bhopal  
MP - 462016  
Mobile: +91 9823011883  
E-mail: vineet.saxena@siemens.com

**Bhopal**  
Clo Takhur Nrupal Singh, 37, DDS 2  
Aranya Nagar, Sector 78  
Near Ashadeep Hospital, Vijay Nagar  
Indore - 452010  
Mobile: +91 7506180014  
E-mail: mandeep.nanda@siemens.com

**Boisar**  
B-103, Sai Jayshree Apartments  
Yashwant Shirshti  
Boisar (West) - 400501  
Mobile: +91 9819231892  
E-mail: debashis.biswas@siemens.com

**Cochin**  
Jomer Symphony, 33/2317, 5th Floor  
Chalikkavattom, Ponnurinni North  
Vytilla, Kochi - 682019  
Mobile: +91 4028611/22, 9846006580  
E-mail: girish.v\_nair@siemens.com

**Cochin**  
Jomer Symphony, 33/2317, 5th Floor  
Chalikkavattom, Ponnurinni North  
Vytilla, Kochi - 682019  
Mobile: +91 8606117755  
E-mail: shyam.j@siemes.com

**Durgapur**  
6/15, Bengal Ambuja  
(Near Durgapur Cinema Hall), Citi Centre  
Durgapur - 713216, West Bengal  
Mobile: +91 9830317456  
E-mail: harsh.chincholkar@siemens.com

**Gandhidham**  
Clo Rishabh Electricals, Plot No.104  
Sector 1A, Gandhidham  
Mobile: +91 9725005162  
E-mail: maulikumar.patel@siemens.com

**Goa**  
Clo. Pooja Rivonkar  
Flat No. B/ 106, Gopika Vihar, B-Bldg  
Shankarwadi, Taleigao, Panjim  
North Goa, Pin - 403001  
Mobile: +91 9545553430  
E-mail: jitendra.choudhary@siemens.com

**Goa**  
Flat U303, Devashri Greens Phase II B  
Near Defence Colony, Porvorim  
Goa - 403501  
Mobile: +91 98197903558  
E-mail: supayan.deb@siemens.com

**Gorakhpur**  
H.No. 721/T, Sri Ram Nagar Colony  
Near Aluminum Factory  
Beside HK Memorial School, Basaratpur  
Gorakhpur - 273004  
Mobile: +91 8802011478  
E-mail: singh.amar@siemens.com

**Guwahati Assam**  
Shivalaya Housing Society, Flat No- B-3A  
Bylane-4, Joymatinagar, Adabari, Pandu  
Guwahati - 781012, Assam  
Mobile: +91 9864110684  
E-mail: biplab.datta@siemens.com

**Guwahati Assam**  
Mobile: +91 9051015666  
E-mail: amarnath.karmakar@siemens.com

**Guwahati Assam**  
House No. 20, 2nd Floor  
Ushanagar, Dispur Supermarket  
Guwahati - 781006, Assam, India  
Mobile: +91 9874159689  
E-mail: supravat.dey@siemens.com

**Haridwar**  
110, Lotus Towers, Opp. Ansal Courtyard  
Modipuram, Meerut - 250001, Uttar Pradesh  
Mobile: +91 9889384222  
E-mail: umesh.pandey@siemens.com

**Haridwar**  
P-4/23, Deep Ganga Apartments, Sector-5A  
SIDCUL, Haridwar - 249403, Uttarakhand  
Mobile: +91 9044678887  
E-mail: nishant.yadav@siemens.com

**Hospet**  
Mehima's, Door No.1288, 9th Ward  
Near Markendeshwara School  
M.P.Prakash Nagar, Hospet - 583201  
Distt Bellary, Karnataka  
Mobile: +91 9945859004  
E-mail: nagaraj.rk@siemens.com

**Hosur**  
Plot No. 12, Vishnu Anand Galaxy  
Chittanapally Nalur Village, Hosur - 635109  
Mobile: +91 8971200266  
E-mail: dinesh.rajaian@siemens.com

**Hubli**  
Plot No. 37, Hurkadli Building  
Near KLE School Manjunath Nagar  
Gokul Road, Hubli - 30, Karnataka  
Mobile: +91 9945961052  
E-mail: kiran.kage@siemens.com

**Indore**  
Flat No. 202, Second Floor  
88 N Savinay Apartment  
Dhanvantri Nagar, Rajendra Nagar  
Main Road, Indore - 452012 (M. P.)  
Mobile: +91 9029207888  
E-mail: gaurishankar.rao@siemens.com

**Indore**  
B - Block, 406 Shekhar Paradise  
Nipaniya, Indore - 452010  
Mobile: +91 9673333024  
E-mail: brajesh.rathor@siemens.com

**Indore**  
Clo Takhur Nrupal Singh, 37, DDS 2  
Aranya Nagar, Sector 78  
Near Ashadeep Hospital, Vijay Nagar  
Indore - 452010  
Mobile: +91 7506180014  
E-mail: mandeep.nanda@siemens.com

**Jaipur**  
Kirtan Enclave, Flat No. 316, C Block  
Chhordha Chaak, Jaipur Keonjhar Road  
Jaipur, Odisha - 755019  
(Nearest Land Mark - SBI ATM counter)  
Mobile: +91 9937189624  
E-mail: probir.mukherjee@siemens.com

**Jalandhar**  
House No. 548, FF Urban Estate  
Phase 1, Jamalpur, Chandigarh Road  
Ludhiana - 141003, Punjab  
Mobile: +91 9876047929  
E-mail: sunil.singla@siemens.com

**Jammu**  
House No. 548, FF Urban Estate  
Phase 1, Jamalpur, Chandigarh Road  
Ludhiana - 141003, Punjab  
Mobile: +91 9876047929  
E-mail: sunil.singla@siemens.com

**Jodhpur**  
A-240, 1st Floor, Shastri Nagar, Jodhpur  
Rajasthan - 342003, India  
Mobile: +91 9929110493  
E-mail: rajendra.kabra@siemens.com

**Kanpur**  
110-B, Gandhi Gram, Harjinder Nagar  
Kanpur - 208007, Uttar Pradesh  
Mobile: +91 9650235222  
E-mail: manish.sahu@siemens.com

**Kharagpur**  
Plot No. 3031, 2nd Floor  
Mouza: Basudevpur, PO: Khajanchak  
Manjushree More; District: Purba Medinipur  
Pin: 721602.  
Mobile: +91 9051384193  
E-mail: mitra.sayantan@siemens.com

**Khopoli**  
Flat No. 12, Building No. 1  
Shri Swami Samarth Krupa Nagar CHS Ltd  
Near Usha Nagar, Mogalwadi Road, Khopoli  
Tal. Khalapur, Dist Raigad - 410203  
Mobile: +91 9867748975  
E-mail: deshdpande.sachin@siemens.com

**Kolhapur**  
RS No. 84-1, Pinac Prasad, FL No. A-35  
New Palace Road, Kolhapur - 416006  
Mobile: +91 9850836839  
E-mail: vinay.todkar@siemens.com

**Kota**  
Flat No. 602, Mahalaxmi Enclave, Block - B4  
Baran Road, Kota, Rajasthan - 324001  
Mobile: +91 9771414108  
E-mail: vikash.prasad@siemens.com

**Ludhiana**  
H.No. 212A, Punjabi Bahg Extension  
66 Feet Road, Near Curo Mal  
Jalandhar - 144022, Punjab  
Mobile: +91 9872131762  
E-mail: gurvinder.singh@siemens.com

**Ludhiana**  
H.No. 728, First Floor, Sector - 33  
Chandigarh Road, Ludhiana - 141010, Punjab  
Mobile: +91 9878094677  
E-mail: rohit.bhardwaj@siemens.com

**Ludhiana**  
H.No. 1235, St. No. 3/1  
Sardar Nagar, Rahon Road  
Near Gurudwara Mata Bhagwanti  
Ludhiana - 141007, Punjab  
Mobile: +91 9872419990  
E-mail: ravinder.pal@siemens.com

**Madurai**  
Anirudhi Block, F-Top 3  
Vasudhara Apartment, B4, TPK Main Road  
Andalpuram, Madurai - 625 003, Tamil Nadu  
Mobile: +91 9894617776  
E-mail: sivaprakasam.r@siemens.com

**Managalore**  
Flat No. 303, Devi Dayal Residency,  
Near Dominic Church, Ashok Nagar Road  
Urwa Store, Managalore - 575006  
Mobile: +91 9686488166  
E-mail: lakshmissha.k@siemens.com

**Maraimalainagar**  
No.11, Ambekdar Street, SRS Buildings  
Upstairs Raga Dental Clinic, Ootheri  
Chennai - 603203  
Mobile: +91 9840392926  
E-mail: shanmuga.v@siemens.com

**Meerut**  
110, Lotus Towers, Opp. Ansal Courtyard,  
Modipuram, Meerut - 250001  
Uttar Pradesh  
Mobile: +91 9889384222  
E-mail: umesh.pandey@siemens.com

**Meerut**  
FF3, Tower A, Ansal Courtyard, Modipuram  
Meerut - 250001, Uttar Pradesh  
Mobile: +91 9889966777  
E-mail: deepshikhar.shukla@siemens.com

**Mehsana**  
C/o R. K. Enterprise  
Tirupati Complex, 2nd Floor  
Radhanpure Char Rasta, Mehsana  
Gujarat - 384002, India  
Mobile: +91 9909904993  
E-mail: piyush.thaker@siemens.com

**Mysore**  
No 980, 4th Cross, 6th Main  
Bannimantap B layout, SS Nagar  
Ludhiana - 570015  
Mobile: +91 9611311645  
E-mail: raashid.syed@siemens.com

**Naidupeta**  
5/94, I Floor, B Block, M.A.Nagar  
Chennai - 600052  
(Near Padianalur Govt School)  
Mobile: +91 9840255185  
E-mail: r.pradeep@siemens.com

**Nashik**  
Flat No. 402, "D" Wing, Hari Shrushti  
Near Jogging Track, Opposite WNS  
Indira Nagar, Nashik - 422009  
Mobile: +91 9892292275  
E-mail: dhananjay.thorat@siemens.com

**Nashik**  
202-Sree Anand Apartements  
Narhari Nagar, Pathardi Fata  
Nashik - 422009  
Mobile: +91 8055114173  
E-mail: vinaykumar.sharma@siemens.com

**Neemrana**  
F-111, Anantraj Apartments,  
Plot No. 236, Japanese Zone, Neemrana  
Alwar, Rajasthan - 301705, India  
Mobile: +91 9650481919  
E-mail: deepak.beniwal@siemens.com

**Panipat**  
137-R, First Floor, Near Sadanand Park  
Model Town, Panipath - 132103  
Mobile: +91 9871394488  
E-mail: vijay.goyal@siemens.com

**Patna**  
A-53, 5th Floor, Krishna Apartment  
Boring Road, Patna - 800001  
Mobile: +91 9641574289  
E-mail: rajendra.mitra@siemens.com

**Pondicherry**  
R.A.M Paradise, II Floor, No.4, 2nd Cross  
Kamban Nagar, Reddiarpalayam  
Puducherry - 605010  
Mobile: +91 9176609374  
E-mail: gopalakrishnan.shanmugam@siemens.com

**Raipur**  
103-Emerald, Green Meadows  
Daldal Seoni, Mowa, Raipur  
Chattisgarh - 492007  
Mobile: +91 9711007466  
E-mail: vinay.mittal@siemens.com

**Raipur**  
Mobile: +91 9049149199  
E-mail: shriddhar.kulkarni@siemens.com

**Rajahmundry**  
IVY Grand Apartment, Narasanna Nagar  
Door No 66-7-2/1A, Rajiv Gandhi Street  
Near Karanam Gari Junction  
Kakinada - 533004  
Mobile: +91 9789869754  
E-mail: lakshmi.kanth.balla@siemens.com

**Rajkot**  
Pitrurupa Street No. 5, Royal Park Society  
University Road, Near Indira Circle  
Rajkot - 360005  
Mobile: +91 8080802037  
E-mail: harsh.trivedi@siemens.com

**Ranchi**  
Raj Enclave, Flat No. 204, 2nd Floor,  
Kaju Bagan (Near DAV Hehal Jr. Section)  
Piska More, P.S. Sukhdeoanagar  
Ranchi - 834005  
Mobile: +91 9674011440  
E-mail: sarkar.saikat@siemens.com

**Ranchi**  
236 Pawan Colony, Hinoo Chowk, Hinoo  
Doranda, Ranchi - 834002  
Mobile: +91 9933650562  
E-mail: sandip.de@siemens.com

**Renukoot**  
Vijay Gupta Bhawan  
Swami Vivekanand Colony, Murdhawa  
Renukoot - 231217, Distt Sonebhadra  
Uttar Pradesh  
Mobile: +91 9984500021  
E-mail: kumardeepak@siemens.com

**Rourkela**  
C/6, Gafoor Colony, Ground Floor  
Near LIC Office, Uditi Nagar  
Rourkela - 769012, Odisha  
Mobile: +91 9861056581  
E-mail: ashirbad.das@siemens.com

**Rourkela**  
Quarter No. L/115, 2nd Floor  
Basanti Colony, Phase - I  
Rourkela - 769012, Odisha  
Mobile: +91 8124050733  
E-mail: anand.mazumdar@siemens.com

**Rudrapur**  
Shanti Vihar Colony, Chatarpur Road  
Opposite Dr. Pandey Hospital  
Rudrapur - 263153  
Distt. Udham Singh Nagar, Uttarakhand  
Mobile: +91 9839174578  
E-mail: girish.pandey@siemens.com

**Rudrapur**  
Flat No. 202, Tower Indus 'B'  
Omaxe Reviera Ltd.  
Rudrapur - 263153  
Uttarakhand  
Mobile: +91 9695890001  
E-mail: omkar.tiwari@siemens.com

**Salem**  
Rajagiragham, Lumbini illam, No. 20  
Palaniappa Nagar, Hasthampatti  
Salem - 636007  
Mobile: +91 9952389893  
E-mail: b.saravanan@siemens.com

**Siliguri**  
147 Lala Lalpat Rai Road  
Haider para, Siliguri - 734001  
West Bengal  
Mobile: +91 7278842360  
E-mail: abhishek.kar@siemens.com

**Sonepat**  
H.No. 1103, 1st Floor  
Sector-14, Sonepat  
Haryana - 131001  
Mobile: +91 9855526122  
E-mail: kumar.manish@siemens.com

**Sriperumbudur**  
Villa No.97, Casa Grande Futura  
Chengalpet Road  
Sriperumbudur  
Kanchipuram Dist - 602105  
Mobile: +91 9791045280  
E-mail: murugaraj.s@siemens.com

**Surat**  
E-203, Legend Harmony,  
Opp. Swastik Villa, Pal  
Surat - 395008  
Mobile: +91 9879110276  
E-mail: rahul.gangrade@siemens.com

**Surat**  
3/A, Navrachana Society  
Opp.D.K.Park, Bhatar Road  
Surat - 395001  
Mobile: +91 9879510191  
E-mail: mitul.kapadia@siemens.com

**Thrissur**  
Plot No. 12, Cherakekaran House  
Unity Nagar, Kuriachira P.O, Thrissur  
Kerala - 680006  
Mobile: +91 9947957839  
E-mail: nobin.babu@siemens.com

**Trichy**  
Flat No.102, ' B' Block, 2nd Floor  
Vignesh Empire Apartments  
Salai Road, Woraiyur  
Trichy - 620003  
Mobile: +91 8056025127  
E-mail: ponnivalavan.p@siemens.com

**Udaipur**  
A-39, First Floor, New Ahinsapuri  
Fatehpura, Udaipur  
Rajasthan - 313004, India  
Mobile: +91 8696222212  
E-mail: rohit.nandan@siemens.com

**Vapi**  
Flat No. 501, Ruby Heights Apartment  
Near Aaditya Hospital, Chala Vapi  
District Valsad 396191  
Mobile: +91 9768738186  
E-mail: mukhtar.khan@siemens.com

**Vapi**  
Flat No 302, 3rd Floor  
Samraiya-IV, Royal Residency  
Gokul Vihar Township  
Charwada Road  
Taluka - Pardi, Dist. Valsad  
Vapi - 396195  
Mobile: +91 9825147957  
E-mail: rohit.darji@siemens.com

**Vijayawada**  
Sarada Nilayam  
D.No 21-5-44, 2nd Floor  
Front Portion, Vanapalivari Street  
Opp RCM Church, Muthyalampau  
Vijayawada - 520011  
Mobile: +91 9642351144  
E-mail: venkateshwar.d@siemens.com

Siemens Limited  
Smart Infrastructure  
Electrical Products  
R&D Technology Centre  
Thane Belapur Road  
Airoli Node, Navi Mumbai - 400708  
For more information contact toll free 1800 209 1800  
E-mail: lvsg-rmktg.india@siemens.com

www.siemens.co.in

Order No.: 107075557  
SI-EP-CC-012021  
(This replaces DF-CP-0088-2017)

Customer Care Toll free no. 1800 209 0987  
Email: ics.india@siemens.com

Product upgradation is a continuous process. Hence, data in this catalog is subject to change without prior notice. For the latest information, please get in touch with our Sales Offices.