

Outdoor Combination Metering

Catalog Number

JA0816B1400RLTM

Enclosure


Type 3R

DEVICE RATING: 400 AMPS MAXIMUM
120/240 VOLTS~ 1 PHASE, 3 WIRE
208Y/120 VOLTS~ 1 PHASE, 3 WIRE
WITH 5TH JAW INSTALLED
(DERIVED FROM 3 PHASE - 4 WIRE
SYSTEM)

METER SOCKET: 4 JAW; LEVER OPERATED
BYPASS WITH JAW TENSION RELEASE.
RATING: 400 AMPS (320 AMPS
CONTINUOUS)

FOR OVERHEAD AND UNDERGROUND
SERVICE. SURFACE MOUNT.

FOR INSTALLATION BY A QUALIFIED
PERSON IN ACCORDANCE WITH ALL
LOCAL ELECTRICAL CODES AND/OR THE
NATIONAL ELECTRICAL CODE.®

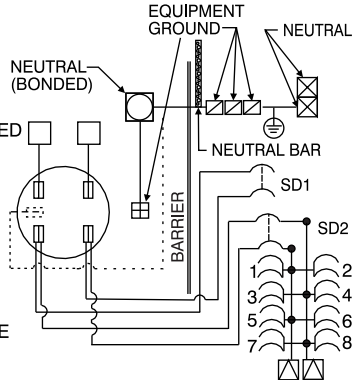

**SUITABLE ONLY FOR USE AS
SERVICE EQUIPMENT.**

CAUTION: CIRCUIT MAY BE LIVE WITH
METER REMOVED.

TERMINALS SUITABLE FOR USE WITH
60/75°C, **AL/CU** INSULATED WIRE.

REFER TO BRANCH BREAKER MARKINGS
FOR WIRE SIZE, RATING AND TORQUE.

ACCESSORIES

FILLER PLATE ECQF3
5TH JAW SHIELD . . . H35815-2

FOR HUB, ORDER FROM "HD" SERIES
COVERPLATE EC56933S
3" HUB EC56856
3 1/2" HUB EC56857
4" HUB EC56858

TERMINAL RANGES kcmil OR AWG; CU/AL	TORQUE LB.-IN.
<input type="checkbox"/> (1)600kcmil-#4 OR (2)350kcmil-1/0	500 500
<input type="checkbox"/> (1) 500kcmil-3/0 OR (2) 250kcmil-3/0	450 450
<input type="checkbox"/> (1)2/0-#12	50
<input checked="" type="checkbox"/> (1)250kcmil-4	250
<input checked="" type="checkbox"/> (1)2/0-#6	275
<input checked="" type="checkbox"/> (1)250kcmil - 4	275
NEUTRAL BAR TERMINALS	
SMALL (1) #10-#14	20
(1) #8	25
(1) #6	35
LARGE (1) #10-14	35
(1) #8	40
(1) 1/0 - #6	45

HARDWARE TIGHTENING TORQUES:
3/8" NUTS 250-300 LB.-IN.

49310786

Siemens Industry, Inc. Norcross, Georgia U.S.A.

D

4099825 Rev.H

© 2009 Copyright Siemens Industry, Inc.

SHORT CIRCUIT CURRENT RATING

(WATTHOUR METER NOT INCLUDED IN SHORT CIRCUIT CURRENT RATING).
THIS PANELBOARD HAS A MAXIMUM SHORT CIRCUIT RATING OF 22,000 RMS
SYMMETRICAL AMPERES, 120/240 V~ WITH SIEMENS (MURRAY BRAND) TYPE
MD-HTR MAIN BREAKER INSTALLED. ANY BRANCH CIRCUIT BREAKER
INSTALLED, REPLACED OR ADDED IN THIS PANELBOARD MUST BE
MANUFACTURED BY SIEMENS (MURRAY BRAND) AND MUST BE OF THE TYPES
LISTED BELOW.

WHEN THE PANELBOARD SERVICE DISCONNECT SD2* IS TYPE	AND THE BRANCH BREAKERS INSTALLED ARE TYPE:	AND THE SERVICE DISCONNECT SD1 IS TYPE	THEN THE MAXIMUM SHORT CIRCUIT CURRENT RATING IN RMS SYMMETRICAL AMPERES, 120/240V~ IS:
MD-HTR	MP-T, MP-HT, MP-MT, MH-T, MP-GT, MP-HGT, MP-AT, MP-HAT, MP-ET, MP-HET, MG, MD-TR, MD-HTR	MP-T, MD-TR	10,000
	MP-T, MP-HT, MP-MT, MH-T, MP-GT, MP-HGT, MP-AT, MP-HAT, MP-ET, MP-HET, MD-HTR	MP-HT, MD-HTR	22,000


* THE FACTORY INSTALLED MAIN IS TYPE MD-HTR

WARNING: THIS DEVICE HAS BEEN DESIGNED FOR USE ONLY WITH THOSE
CIRCUIT BREAKERS AS LISTED ABOVE. THE USE OF OTHER CIRCUIT
BREAKERS COULD RESULT IN PROPERTY DAMAGE OR PERSONAL INJURY AND
WILL VOID THE WARRANTY.

GENERAL INFORMATION:

REMOVE TWISTOUTS FROM TRIM ONLY WHERE BREAKERS WILL BE INSTALLED.
ALL OPENINGS MUST BE FILLED WITH BREAKERS OR FILLER PLATES. CIRCUIT
BREAKER OVERLOAD TRIP POSITION IS INDICATED BY HANDLE POSITION
MIDWAY BETWEEN "ON" AND "OFF." TO RESET, MOVE HANDLE TO OFF
POSITION THEN TURN ON.

DEADFRONT VIEW - TOP TWISTOUTS



IMPORTANT: DO NOT ALLOW PETROLEUM BASED (HYDROCARBON)
SPRAYS, CHEMICALS, SOLVENTS OR ANY PAINT TO CONTACT INTERIOR
COMPONENTS. PETROLEUM BASED CHEMICALS CAN CAUSE DEGRADATION
OF ELECTRICAL INSULATING MATERIALS.

49310787

4099826 Rev.H

Murray Electrical Products

Siemens Industry, Inc.
Building Technologies Division
Norcross, Georgia U.S.A.

D

MURRAY

© The National Electrical Code is a registered trademark of the National Fire Protection Association.
© 2009 Copyright Siemens Industry, Inc.