

SIEMENS

Outdoor Combination Metering

Catalog Number

MC0816B1400RLTM

Enclosure


Type 3R

DEVICE RATING: 400 AMPS MAXIMUM
120/240 VOLTS~ 1 PHASE, 3 WIRE
208Y/120 VOLTS~ 1 PHASE, 3 WIRE
WITH 5TH JAW INSTALLED
(DERIVED FROM 3 PHASE - 4 WIRE
SYSTEM)

METER SOCKET: 4 JAW; LEVER OPERATED
BYPASS WITH JAW TENSION RELEASE.
RATING: 400 AMPS (320 AMPS
CONTINUOUS)

FOR OVERHEAD AND UNDERGROUND
SERVICE. SURFACE MOUNT.

FOR INSTALLATION BY A QUALIFIED
PERSON IN ACCORDANCE WITH ALL
LOCAL ELECTRICAL CODES AND/OR THE
NATIONAL ELECTRICAL CODE.®

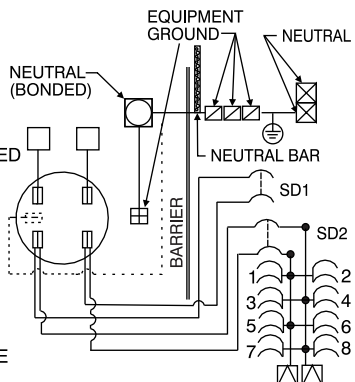

**SUITABLE ONLY FOR USE AS
SERVICE EQUIPMENT.**

CAUTION: CIRCUIT MAY BE LIVE WITH
METER REMOVED.

TERMINALS SUITABLE FOR USE WITH
60/75°C, **AL/CU** INSULATED WIRE.

REFER TO BRANCH BREAKER MARKINGS
FOR WIRE SIZE, RATING AND TORQUE.

ACCESSORIES

FILLER PLATE ECQF3
5TH JAW SHIELD . . . H35815-2

FOR HUB, ORDER FROM "HD" SERIES
COVERPLATE EC56933S
3" HUB EC56856
3 1/2" HUB EC56857
4" HUB EC56858

TERMINAL RANGES kcmil OR AWG; CU/AL	TORQUE LB.-IN.
□ (1)600kcmil-#4 OR (2)350kcmil-1/0	500 500
○ (1) 500kcmil-3/0 OR (2) 250kcmil-3/0	450 450
▣ (1)2/0-#12	50
⊠ (1)250kcmil-4	250
⊞ (1)2/0-#6	275
⊟ (1)250kcmil - 4	275
NEUTRAL BAR TERMINALS	
SMALL (1) #10-#14	20
(1) #8	25
(1) #6	35
LARGE (1) #10-14	35
(1) #8	40
(1) 1/0 - #6	45

HARDWARE TIGHTENING TORQUES:
3/8" NUTS 250-300 LB.-IN.

SHORT CIRCUIT CURRENT RATING

(WATT HOUR METER NOT INCLUDED IN SHORT CIRCUIT CURRENT RATING). THIS PANELBOARD HAS A MAXIMUM SHORT CIRCUIT RATING OF 22,000 RMS SYMMETRICAL AMPERES, 120/240 V~. THE ACTUAL RATING IS DEPENDANT ON THE SERVICE DISCONNECTS AND BRANCH BREAKERS INSTALLED IN THIS PANELBOARD. THE CORRECT SERVICE DISCONNECTS, BRANCH CIRCUIT BREAKERS AND MAIN/BRANCH BREAKER SERIES COMBINATIONS TO BE USED FOR VARIOUS SHORT CIRCUIT CURRENT LEVELS ARE LISTED IN THE TABULATION BELOW. ANY CIRCUIT BREAKER INSTALLED, REPLACED, OR ADDED IN THIS PANELBOARD MUST BE MANUFACTURED BY SIEMENS AND MUST BE OF THE CORRECT TYPE AS INDICATED IN THE TABULATIONS BELOW.

WHEN THE PANELBOARD SERVICE DISCONNECT SD2* IS TYPE	AND THE BRANCH BREAKERS INSTALLED ARE TYPE:	AND THE SERVICE DISCONNECT SD1 IS TYPE	THEN THE MAXIMUM SHORT CIRCUIT CURRENT RATING IN RMS SYMMETRICAL AMPERES, 120/240V~ IS:
QNRH	QP, QPH, HQP, QT, QPF, QPHF, QAF, QAFH, QE, QEH, QG, QNR, QNRH	QP, QNR	10,000
	QP, QPH, HQP, QT, QPF, QPHF, QAF, QAFH, QE, QEH, QNRH	QPH, QNRH	22,000


* THE FACTORY INSTALLED MAIN IS TYPE QNRH

WARNING: THIS DEVICE HAS BEEN DESIGNED FOR USE ONLY WITH THOSE CIRCUIT BREAKERS AS LISTED ABOVE. THE USE OF OTHER CIRCUIT BREAKERS COULD RESULT IN PROPERTY DAMAGE OR PERSONAL INJURY AND WILL VOID THE WARRANTY.

GENERAL INFORMATION:

REMOVE TWISTOUTS FROM TRIM ONLY WHERE BREAKERS WILL BE INSTALLED. ALL OPENINGS MUST BE FILLED WITH BREAKERS OR FILLER PLATES. CIRCUIT BREAKER OVERLOAD TRIP POSITION IS INDICATED BY HANDLE POSITION MIDWAY BETWEEN "ON" AND "OFF." TO RESET, MOVE HANDLE TO OFF POSITION THEN TURN ON.

DEADFRONT VIEW - TOP TWISTOUTS



IMPORTANT: DO NOT ALLOW PETROLEUM BASED (HYDROCARBON) SPRAYS, CHEMICALS, SOLVENTS OR ANY PAINT TO CONTACT INTERIOR COMPONENTS. PETROLEUM BASED CHEMICALS CAN CAUSE DEGRADATION OF ELECTRICAL INSULATING MATERIALS.

49310784

Siemens Industry, Inc. Norcross, Georgia U.S.A.

D

4099827 Rev.H

© 2009 Copyright Siemens Industry, Inc.

49310804

Siemens Industry, Inc. Norcross, Georgia U.S.A.

D

4099828 Rev.H

© The National Electrical Code is a registered trademark of the National Fire Protection Association.
© 2009 Copyright Siemens Industry, Inc.