



1 IF IN DOUBT ASK  
DO NOT SCALE

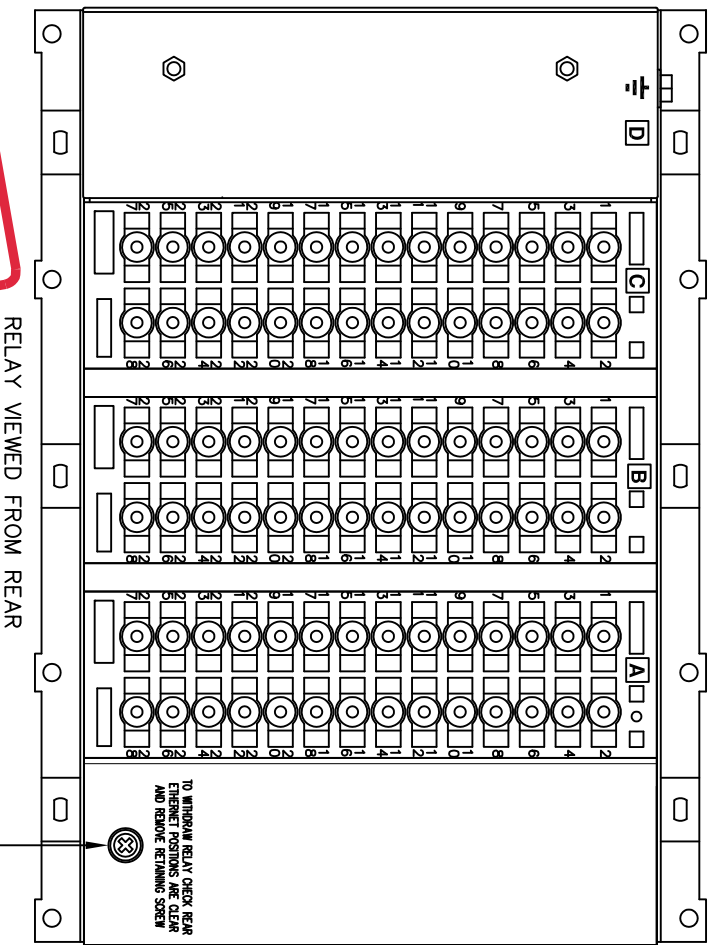

**NOT SUBJECT TO UPDATE  
ONCE COPIED / PRINTED  
OR DOWNLOADED**

TO WITHDRAW RELAY CHECK REAR  
ETHERNET POSITIONS ARE CLEAR  
AND REMOVE RETAINING SCREW

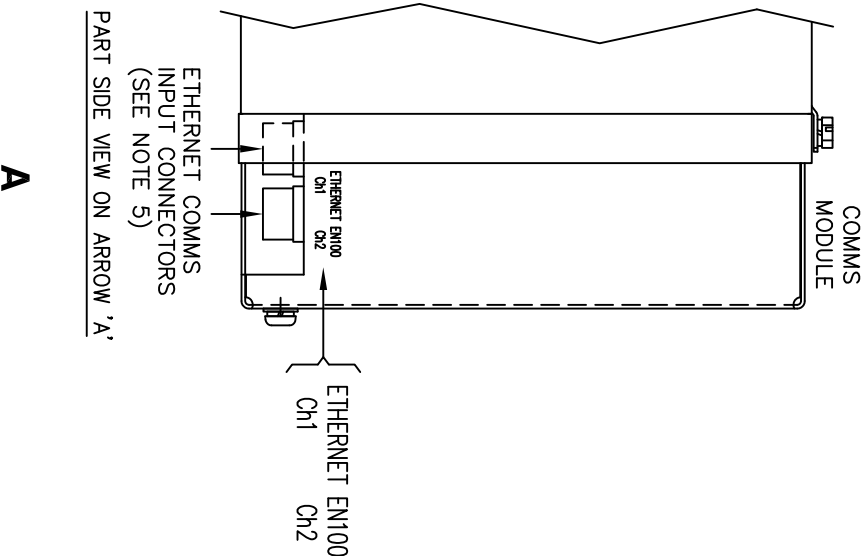

- NOTES**
- 1) TERMINALS RECOMMENDED ARE PRE-INSULATED & MUST BE CRIMPED USING APPROVED TOOLING. AMP PIDG OR PLASTI GRIP FUNNEL ENTRY (RING TONGUE) FOR M4 FIXING STUD.
  - 2) FOR OUTLINE & PANEL DRILLING, SEE 2995X10021 (A4).
  - 3) CONNECTIONS TO THIS COMMUNICATIONS FACILITY IS BY SCREENED, TWISTED PAIR CABLE, ON SITE. WHEN WIRING OTHER FACILITIES ENSURE THAT THESE TERMINALS ARE NOT OBSCURED BY OTHER WIRE RUNS.
  - 4) CONTACTS SHOWN THUS ARE INTERNAL RELAY CASE CONTACTS AND CLOSE WHEN THE RELAY CHASSIS IS WITHDRAWN FROM THE CASE.
  - 5) THE ETHERNET PORTS CAN BE EITHER -  
2X FIBRE OPTIC, DUPLEX CONNECTORS OR  
2X ELECTRICAL, RJ45 CONNECTORS.

**ABBREVIATIONS**


I-CURRENT INPUTS
V-VOLTAGE INPUTS
BI-BINARY INPUTS
BO-BINARY OUTPUTS
CO-CHANGE OVER BINARY OUTPUT CONTACTS
NO-NORMALLY OPEN BINARY OUTPUT CONTACTS
NC-NORMALLY CLOSED BINARY OUTPUT CONTACTS

**SERIAL PORT IDENTIFICATION**

COM1	RS485 (ON BLOCK 'B' TERMINALS 14,16,18 & 20)
COM2	USB TYPE 'B' PORT (ON RELAY FRONT LABEL)

**ETHERNET PORT IDENTIFICATION**

Ch1	ETHERNET PORT (ON REAR COMMS MODULE)
Ch2	ETHERNET PORT (ON REAR COMMS MODULE)

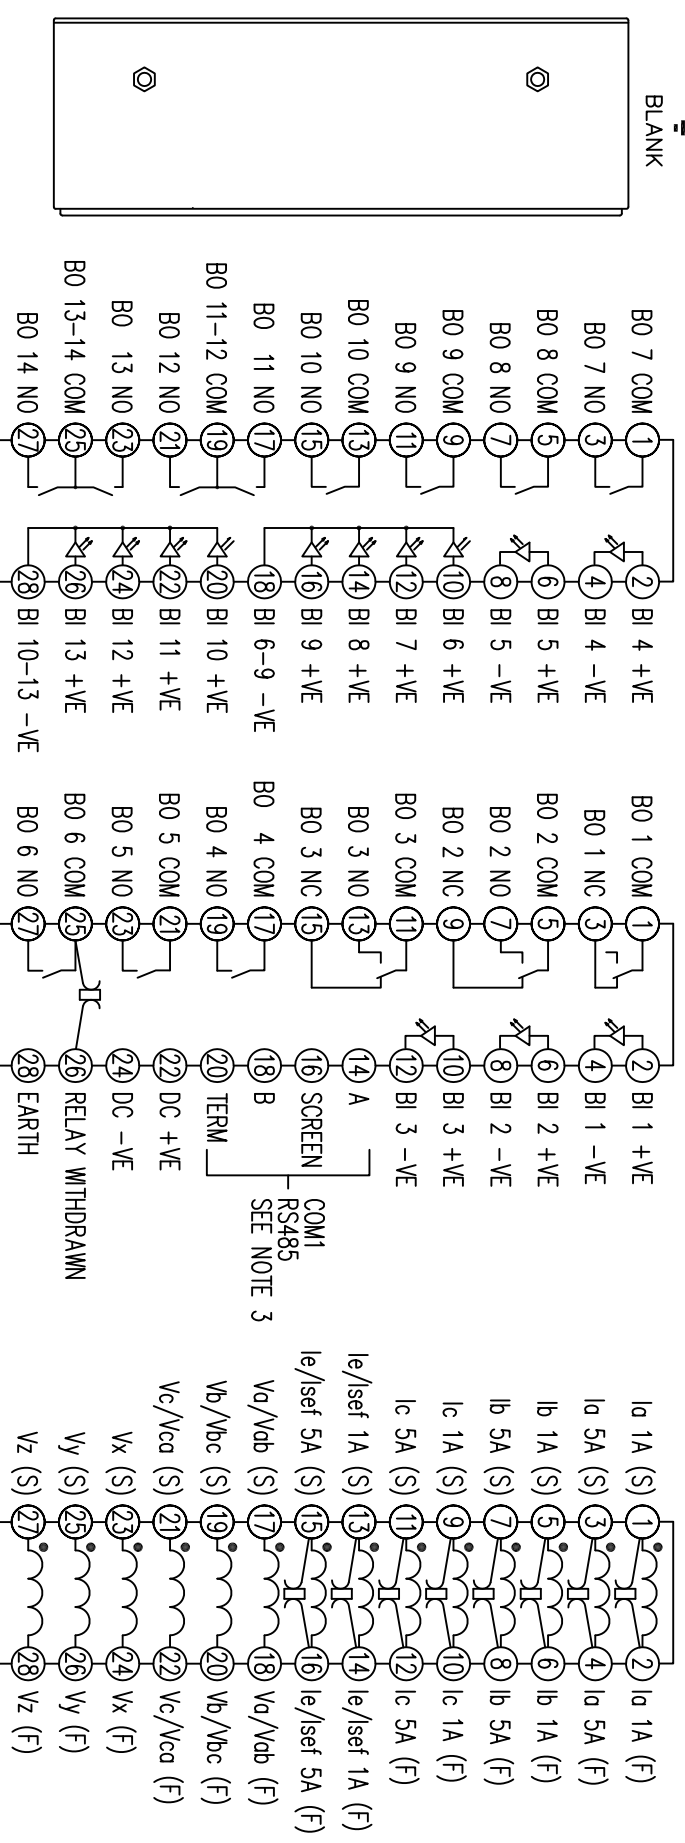

Copyright © 2009 Siemens Protection Devices Ltd. Hebburn

3 RDW	30/7/13	19.07.13	RETAINING SCREW POSITION CHANGED. MNA435/3650, 3H1770, KB
2 RDW	22/07/11	22/07/11	61850 COMMS ADDED MNS3444 KB 3J1139
1	19/05/09	19/05/09	3J0629

**MATERIAL:**  
Dimensions in millimetres : Surface texture in micrometres.  
Machine where marked  $\nabla$   
For explanation of dimensions, tolerances, notes etc. see B.S.308.  
Limit on untoleranced unmachined dimensions  $\pm$  \_\_\_\_\_  
Limits on untoleranced machined dimensions to B.S.4500:  
i.e. up to 6 $\pm$ 0.1; over 30 to 120 $\pm$ 0.3; over 315 $\pm$ 0.8;  
over 6 to 30 $\pm$ 0.2; over 120 to 315 $\pm$ 0.5;  
General unmachined angular tolerance  $\pm$  \_\_\_\_\_

Finish:

Treatment:

Title:  
7SR224 , E10, TERMINAL ID & WIRING DIAGRAM  
4I,6V,13BI,2CO,11NO,1NC, RS485 & ETHERNET(x2) COMMS

**SIEMENS PROTECTION DEVICES LTD.**

Original Scale.

NTS

Dwg. No.

2435W40053

DRAWN	MM/AL	CHECKED	RD.WATSON	APPROVED	RD.WATSON	DATE	29/06/09	IE	OPS	PCP	Purch.Spec.	TQ	EAC	CE	STD	A3
-------	-------	---------	-----------	----------	-----------	------	----------	----	-----	-----	-------------	----	-----	----	-----	----