IF IN DOUBT ASK
DO NOT SCALE

Relay Earthing

Terminal B28 of the PSU should be earthed by a direct connection to the device case earth stud.

The device case earth stud should be solidly earthed by a direct connection to the panel earth.

Terminal contacts internal to case assembly close when device is withdrawn from case.

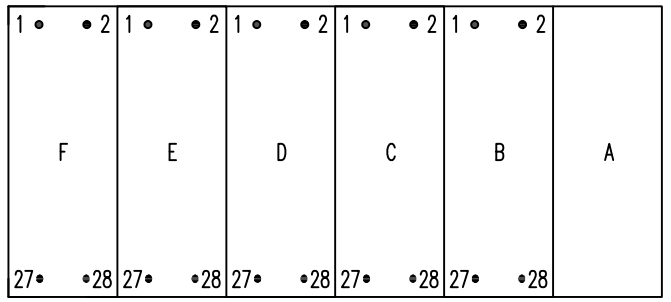

VIEWED FROM REAR

Notes – Ethernet Options

Device will be fitted with either 2 x electrical (RJ45) or 2 x optical (LC) ethernet ports.

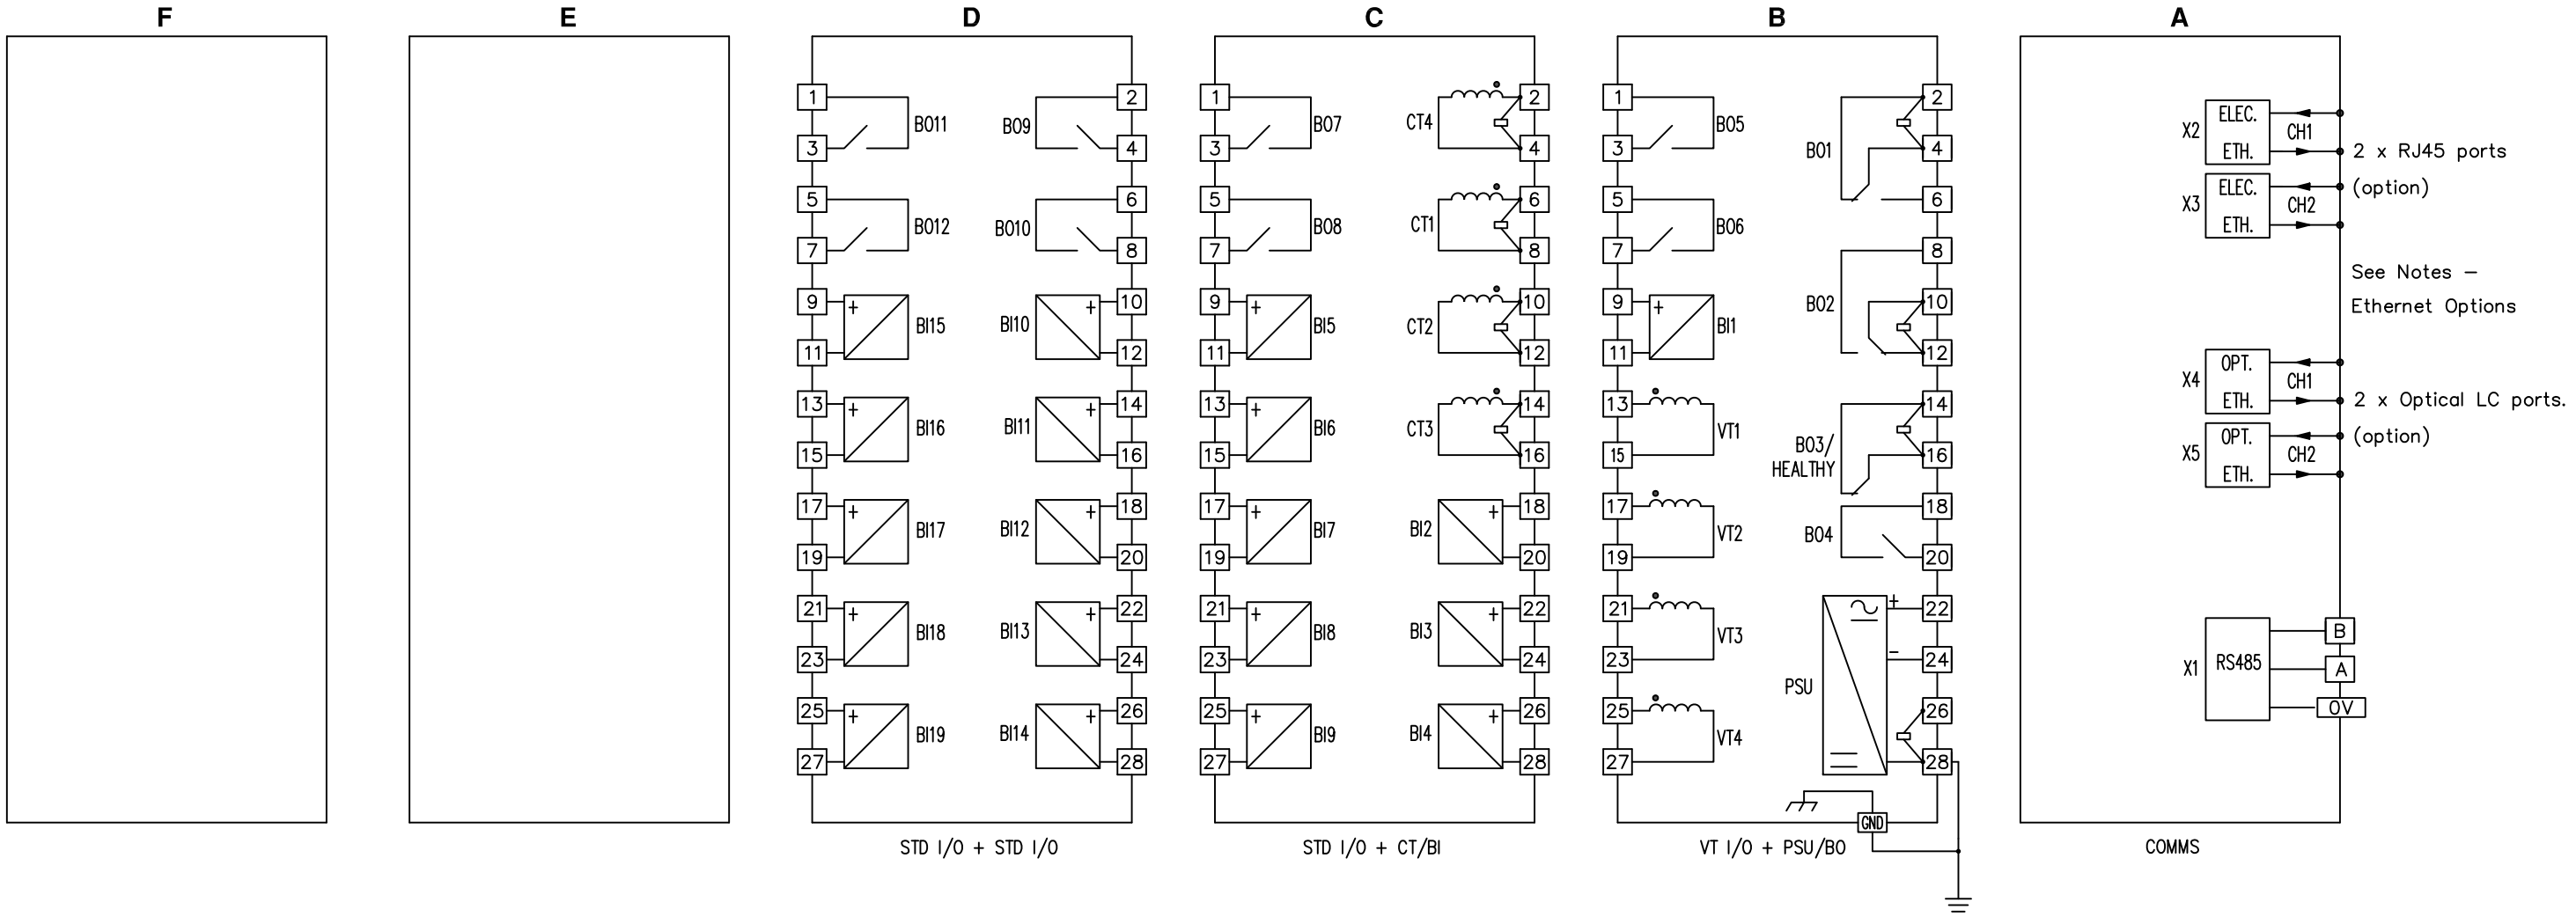

ABBREVIATIONS
CT–CURRENT TRANSFORMER
VT–VOLTAGE TRANSFORMER
BI–BINARY INPUT
BO–BINARY OUTPUT
GND–GROUND
ELEC–ELECTRICAL
OPT–OPTICAL
ETH–ETHERNET
STD I/O–STANDARD INPUT/OUTPUT
PSU–POWER SUPPLY UNIT (AUXILIARY)

FOR INTERNAL USE ONLY
UNCONTROLLED COPY
NOT SUBJECT TO UPDATE

ISSUE	DATE	
1	23/08/19	CHANGE NOTED △

Finish: –	Title: REAR TERMINAL CONNECTIONS – 7SR5111–3AAx6–0AA0 4CT, 4VT, 19BI, 12BO			First used on: —
				Similar Articles: —
				Supercedes: —
Treatment: –	SIEMENS PLC		Original Scale: NTS	Dwg No. 2518W50013
Drawn: J SPOWART	Checked: K.H	Approved: N.CAMPBELL	Date: 23/08/19	Copyright © 2019 A3 SIEMENS PLC. Hebburn

EU EXPORT CONTROLS | **ECCN: N** | **AL: N**
This document is not Export Controlled unless sending to Critical Countries.