

SIEMENS

Indoor Meter Module

Catalog Number
ML41225RJ

Enclosure
Type 1

Ratings:

Main Bus Rating: 1200 Amps.
120/240 Volts AC, 1 Phase, 3 Wire.
208Y/120 Volts AC (5th jaw may be required)
See adjacent label for Short Circuit Current Rating.

Meter Socket Rating: 200 Amps. Continuous
Branch Rating: Top branch 200 Amps Max. Bottom
3 branches 225 Amps Max. See Breaker Ratings.

Suitable For Use As Service Equipment when
used in combination with Siemens Modular Terminal
Box Series WMTB, WTB, WET, or Murray Tap Box
Series DTB_W and no more than six main
disconnecting means are provided.

For installation by a qualified person, in accordance
with all local electrical codes and/or the National
Electrical Code ®.

Terminals:

Use Copper or Aluminum Wire at all panel
terminals. Suitable for 60°/75°C Conductors.

See breaker markings for wire size and torque requirements.


Neutral Terminal: Wire Size #4-300 kcmil, Torque to 250 lb.-ins.
Ground Terminal: Wire Size #4-2/0 AWG, Torque to 50 lb.-ins.

General Information: See enclosed instruction sheet for information on mounting units.

Circuit breaker overload trip position is indicated by handle position midway between ON
and OFF. To reset, move handle to OFF position then turn ON.

Connect Modules Using: **Cat. No.** **Torque**
Quick Connect™ QC1 400-440 lb-in (35-36 ft.-lb.)

Module Description	Siemens Series#
Main Breakers	WB(M), WEB(M), WXB(M), BFT(M)
Switches	WMP, WS, WES, WXS
Tap/Terminal Boxes	WTB, WET, WT_PU, WTBN, WBT(M)
Pull Boxes	WMMB
Meter Module	(W)MM, (W)MT, (W)ML, (W)MK, (W)MLZ(F), (W)MN
Meter Combinations	WC, WCL, WCT,
Extension Box	WSP, WSPD
Bussed Elbow	BE, WELB

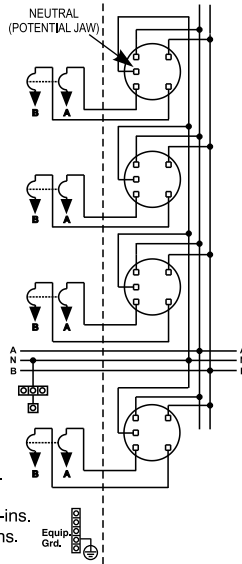

SIEMENS

Short Circuit Current Rating: (Wattour meter not included in short circuit current rating).
This panelboard has a maximum short circuit current rating of 100,000 Amps RMS
symmetrical, 120/240 V~ maximum. The actual rating is dependent on the branch breakers
installed in this panelboard and the main disconnect, if any, installed ahead of this panelboard.
The correct branch breakers and main/branch breaker series combinations to be used for
various short circuit current levels are listed in the tabulation below. Any circuit breaker
installed, replaced, or added in this panelboard must be manufactured by Siemens and must
be of the correct Type as indicated in the tabulation below.

MAIN DISCONNECT When the main protecting the system is a (Siemens Breaker Type)	BRANCH BREAKER And the branch breakers installed are Siemens type	Then the maximum short circuit current rating in RMS symmetrical Amperes, 120/240 V~ maximum is
NONE USED or JXD2(-A), JD6(-A), JXD6(-A), HJD6(-A) HJXD6(-A), LD6(-A), LXD6(-A), HLD6(-A), HLXD6(-A), MD6, MXD6, HMD6, HMXD6, ND6, NXD6, SND6-B, HND6, HNXD6, SHND6-B, NJJA, NJGA, HJGA, NLGA, HLGA, NLGB, HLG, NMG, HMG, NNG, HNG, NPG, HPG, PD6, PXD6, SPD6-B, HPD6, HPXD6, SHPD6-B, RD6, RXD6, HRD6, HRXD6, or Class J, T, R, or L Fuses	QS, QP, MP-T	10,000
NONE USED	QSH, QPH, MP-HT	
MD6, MXD6, HMD6, HMXD6, ND6, NXD6, SND6-B, HND6, HNXD6, SHND6-B, NJJA, NJGA, HJGA, NLGA, HLGA, NLGB, HLG, NMG, HMG, NNG, HNG, NPG, HPG, PD6, PXD6, SPD6-B, HPD6, HPXD6, SHPD6-B, RD6, RXD6, HRD6, HRXD6, or Class J, T, R, or L Fuses	MP-HT	22,000
NONE USED	QSHH	42,000
NONE USED	HQS, HQP, MP-MT	
JXD2(-A), JD6(-A), JXD6(-A), HJD6(-A), HJXD6(-A), LD6(-A), LXD6(-A), HLD6(-A), HLXD6(-A)	MP-HT	
JXD2(-A), JD6(-A), JXD6(-A), LD6(-A), LXD6(-A), MD6, MXD6, ND6, NXD6, SND6-B, HJGA, NJGA, NLGA, NLGB, NMG, NNG, NPG, PD6, PXD6, SPD6-B, RD6, RXD6	QS, QSH, QSHH, HQS, OPH, HQP, MP-MT	65,000
HJD6(-A), HJXD6(-A), HLD6(-A), HLXD6(-A), HMD6, HMXD6, HND6, HNXD6, SHND6-B, HJGA, HLGA, HLGB, HMG, HNG, HPG, HPD6, HPXD6, SHPD6-B, HRD6, HRXD6, or Class J, T, R, or L Fuses	QPH, HQP, MP-MT	
NONE USED	HQPH, HQSH	
HJD6(-A), HJXD6(-A), HLD6(-A), HLXD6(-A), HMD6, HMXD6, HND6, HNXD6, SHND6-B, HJGA, HLGA, HLGB, HMG, HNG, HPG, HPD6, HPXD6, SHPD6-B, HRD6, HRXD6, or Class J, T, R, or L Fuses	HQPH, QS, QSH, QSHH, QS, HQSH	100,000

Warning: This equipment has been designed for use only with circuit breakers listed above.
Use of other circuit breakers in this equipment could result in personal injury or property
damage and will void the warranty.

Important: Do not allow petroleum based (hydrocarbon) sprays, chemicals, solvents or
any paint to contact interior components. Petroleum based chemicals can cause
degradation of electrical insulating materials.

Siemens Industry, Inc. Norcross, Georgia U.S.A. **DH1** 40900808 0101 Rev.00

© The National Electrical Code is a registered trademark of the National Fire Protection Association.
© 2018 Copyright Siemens Industry, Inc.

Siemens Industry, Inc. Norcross, Georgia U.S.A. **DH1** 40900808 0201 Rev.01

© 2019 Copyright Siemens Industry, Inc.