


**IF IN DOUBT ASK
DO NOT SCALE**

Relay Earthing


Terminal B28 of the PSU should be earthed by a direct connection to the device case earth stud.

The device case earth stud should be solidly earthed by a direct connection to the panel earth.

Terminal contacts internal to case assembly close when device is withdrawn from case.

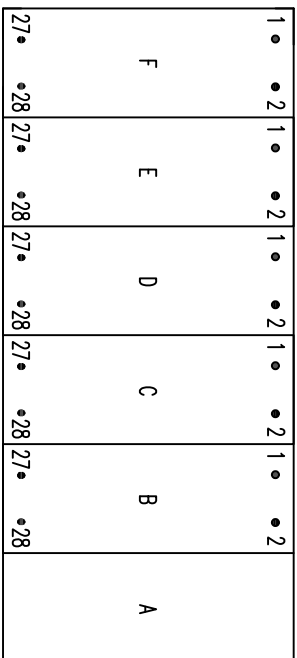

Notes – Ethernet Options
Device will be fitted with either 2 x electrical (RJ45) or 2 x optical (LC) ethernet ports.

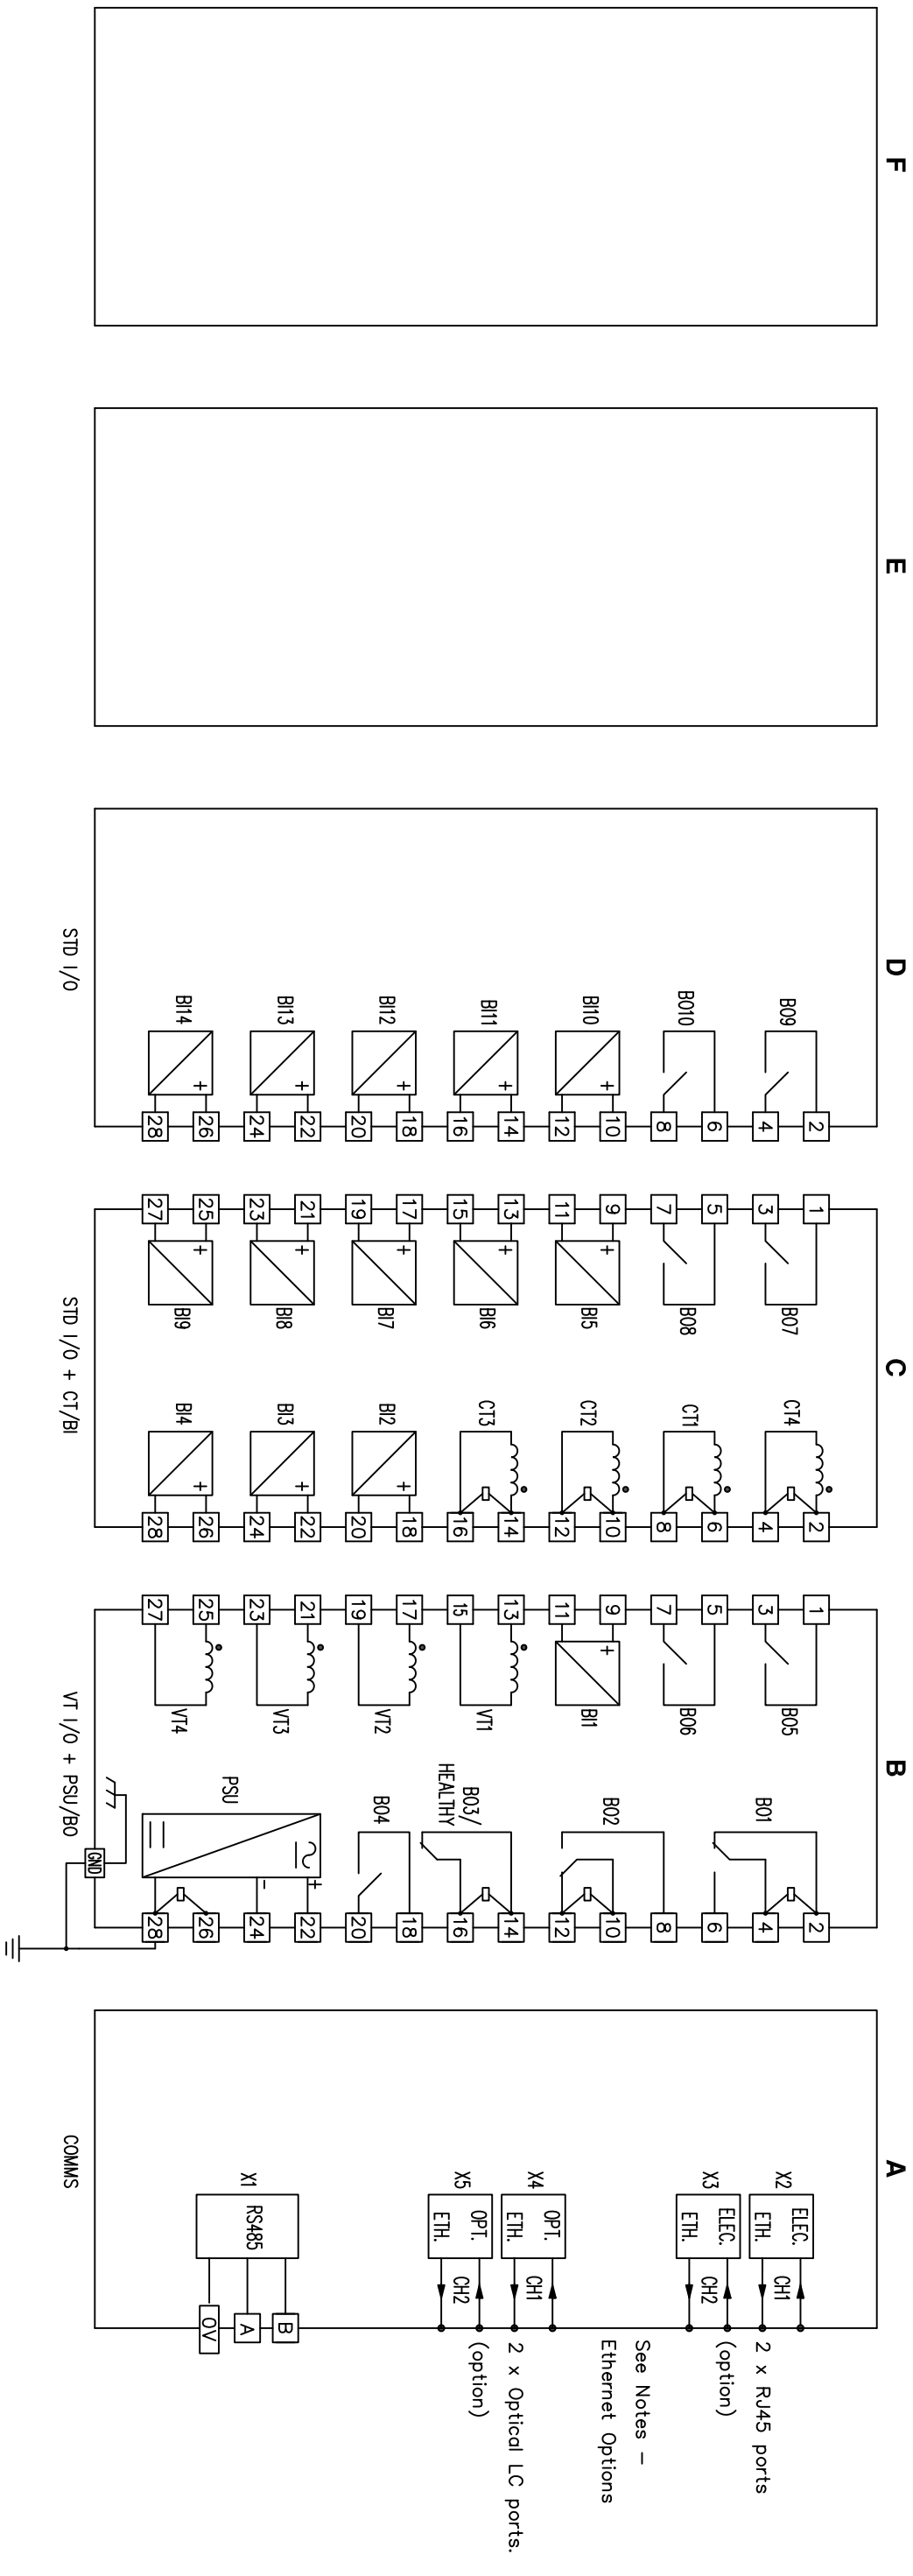

ABBREVIATIONS	
CT	CURRENT TRANSFORMER
VT	VOLTAGE TRANSFORMER
BI	BINARY INPUT
BO	BINARY OUTPUT
GND	GROUND
ELEC	ELECTRICAL
OPT	OPTICAL
ETH	ETHERNET
STD I/O	STANDARD INPUT/OUTPUT
PSU	POWER SUPPLY UNIT (AUXILIARY)

EU EXPORT CONTROLS **ECCN: N** **AL: N**

This document is not Export Controlled unless sending to Critical Countries.

Drawn: J SPOWART	Checked: K.H	Approved: N.CAMPBELL	Date: 23/08/19	Copyright © 2019
Title: REAR TERMINAL CONNECTIONS – 7SR5111–2AAx6–0AA0		Original Scale: NTS		
Finish: –		Dwg No. 2518W50012		
Treatment: –		Similar Articles: –		
Title: REAR TERMINAL CONNECTIONS – 4CT, 4VT, 14BI, 10B0		Supersedes: –		
First used on: –		CHANGE NOTED		
1		23/08/19	DATE	ISSUE